

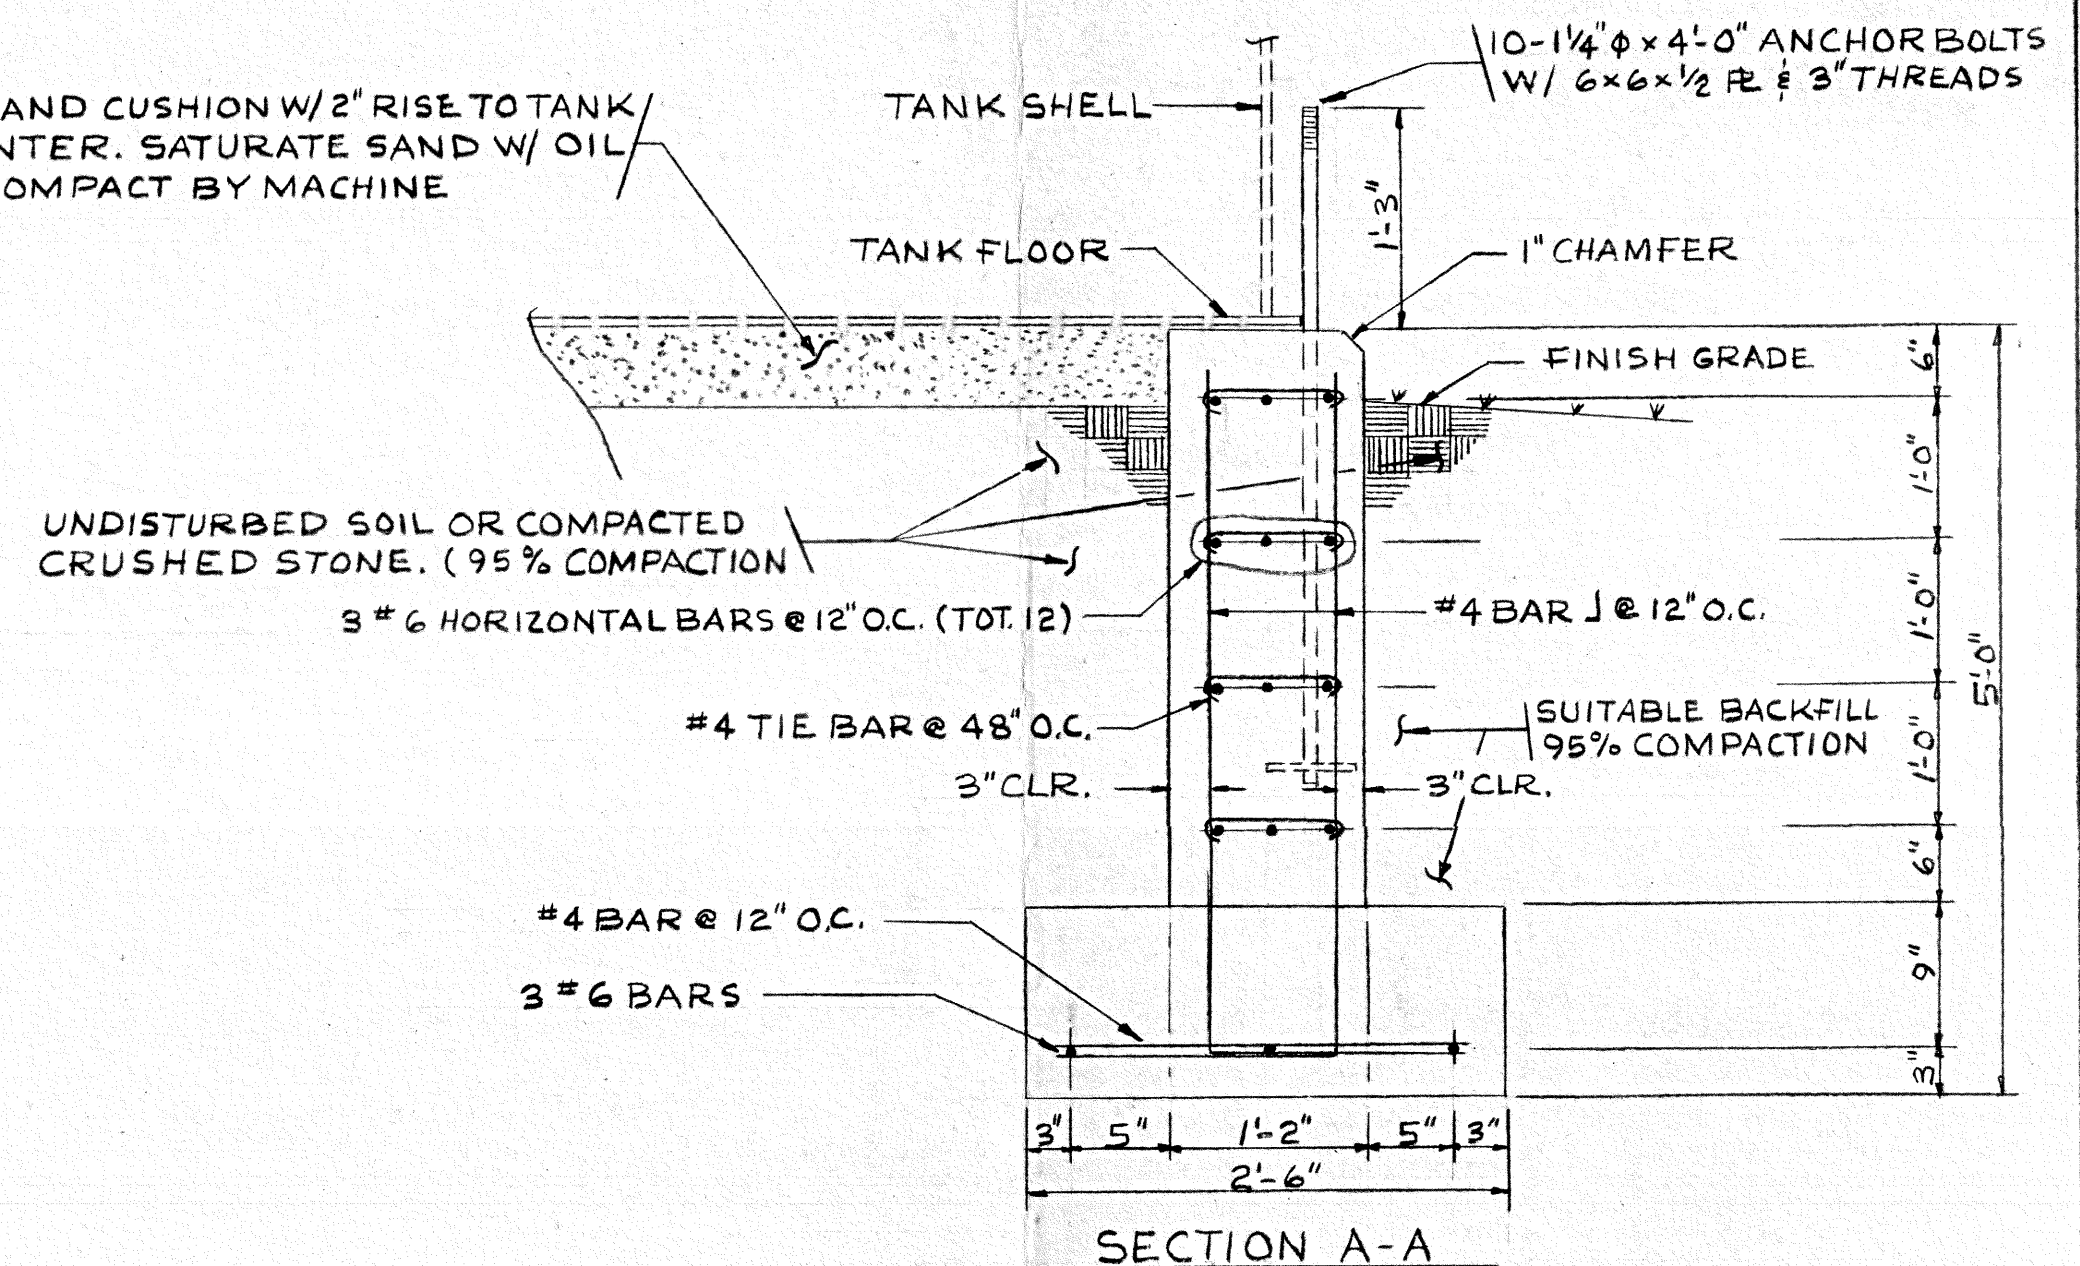
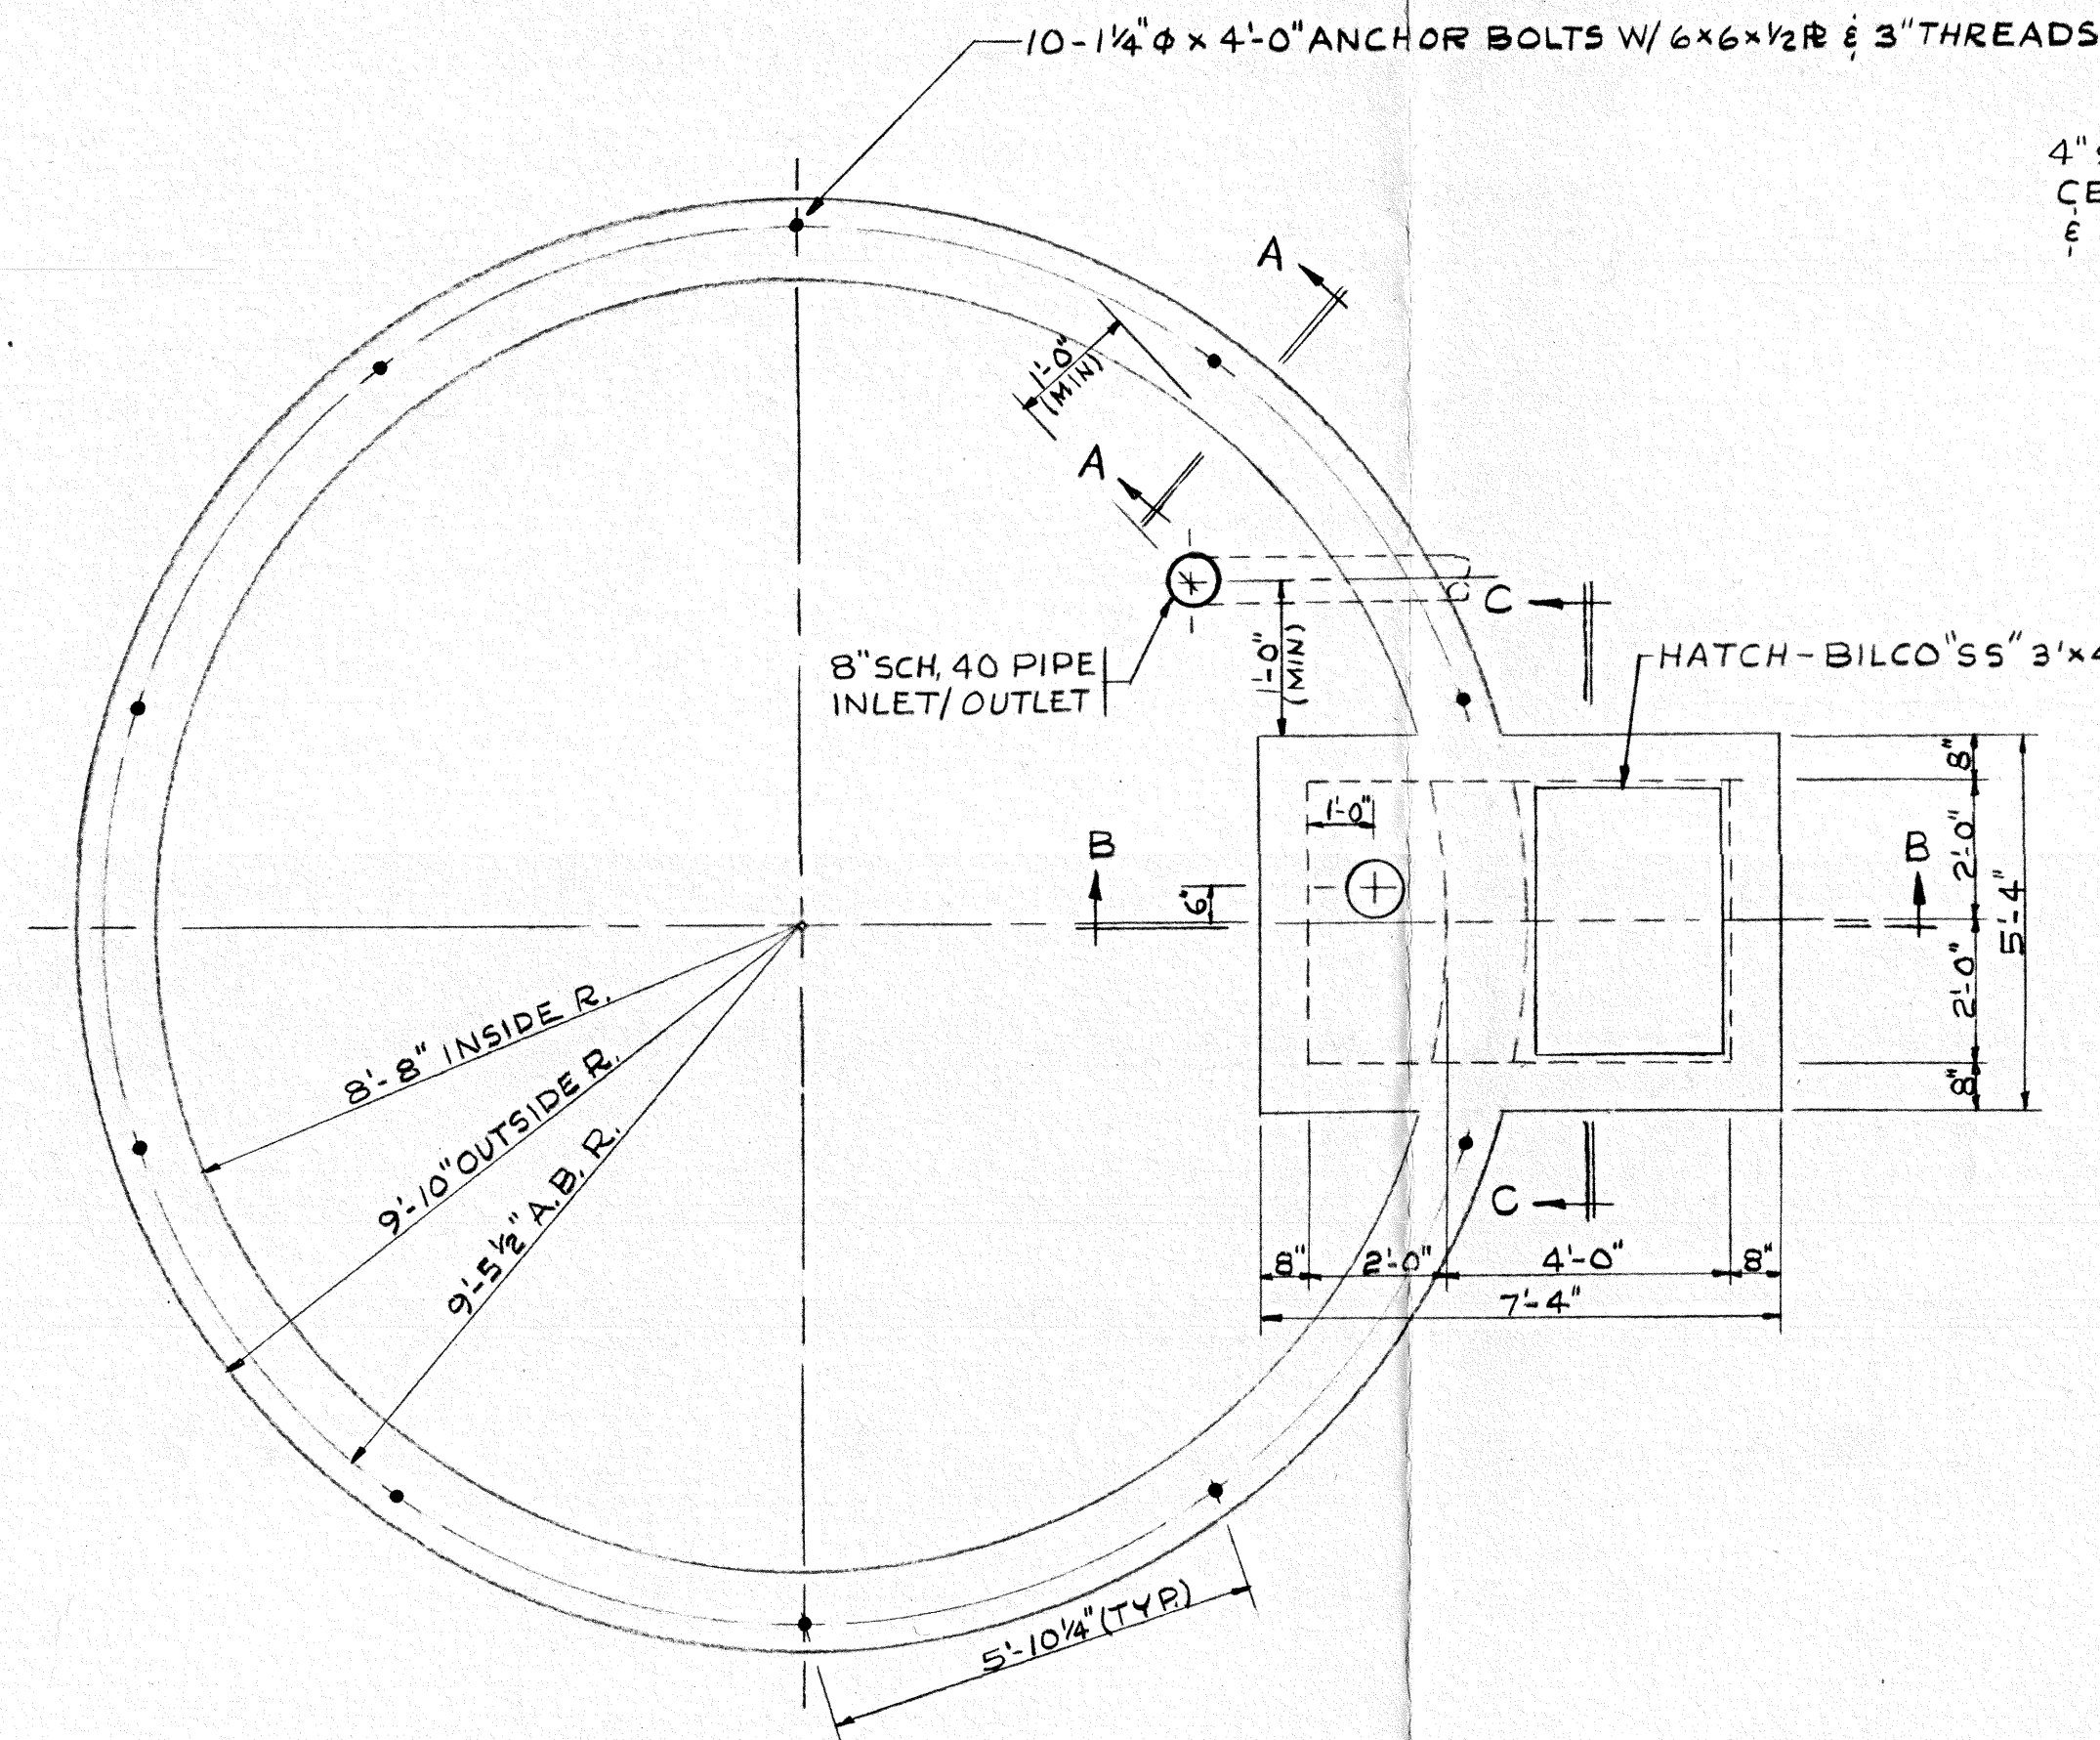


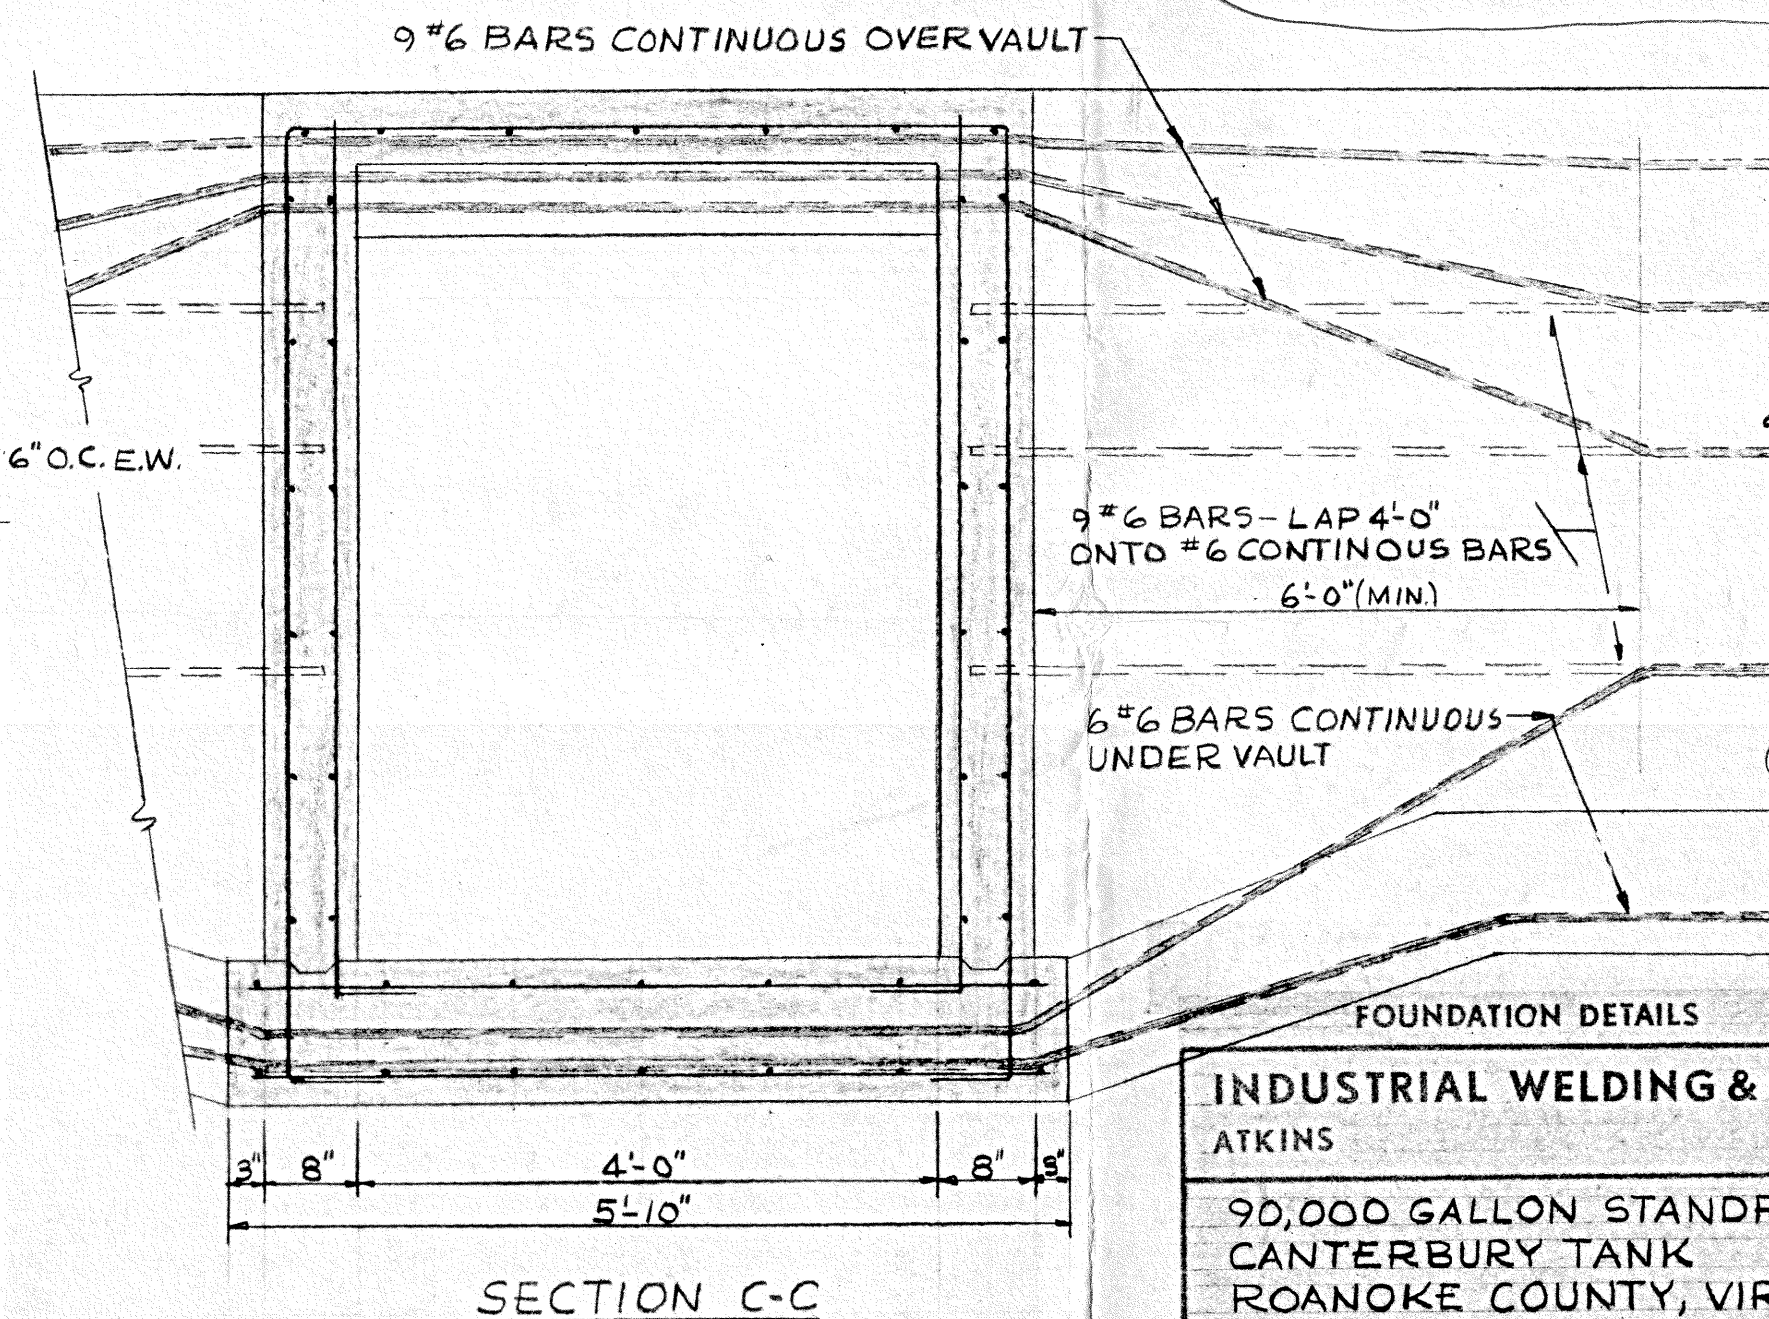

NOTES:
ALL REBAR TO BE ASTM A615, GR. 60
ALL CONCRETE TO BE 4000 P.S.I.
FOUNDATION DESIGNED FOR MIN. 3,000 P.S.F. SOIL BEARING. OWNER TO VERIFY PER AWWA D-100-79

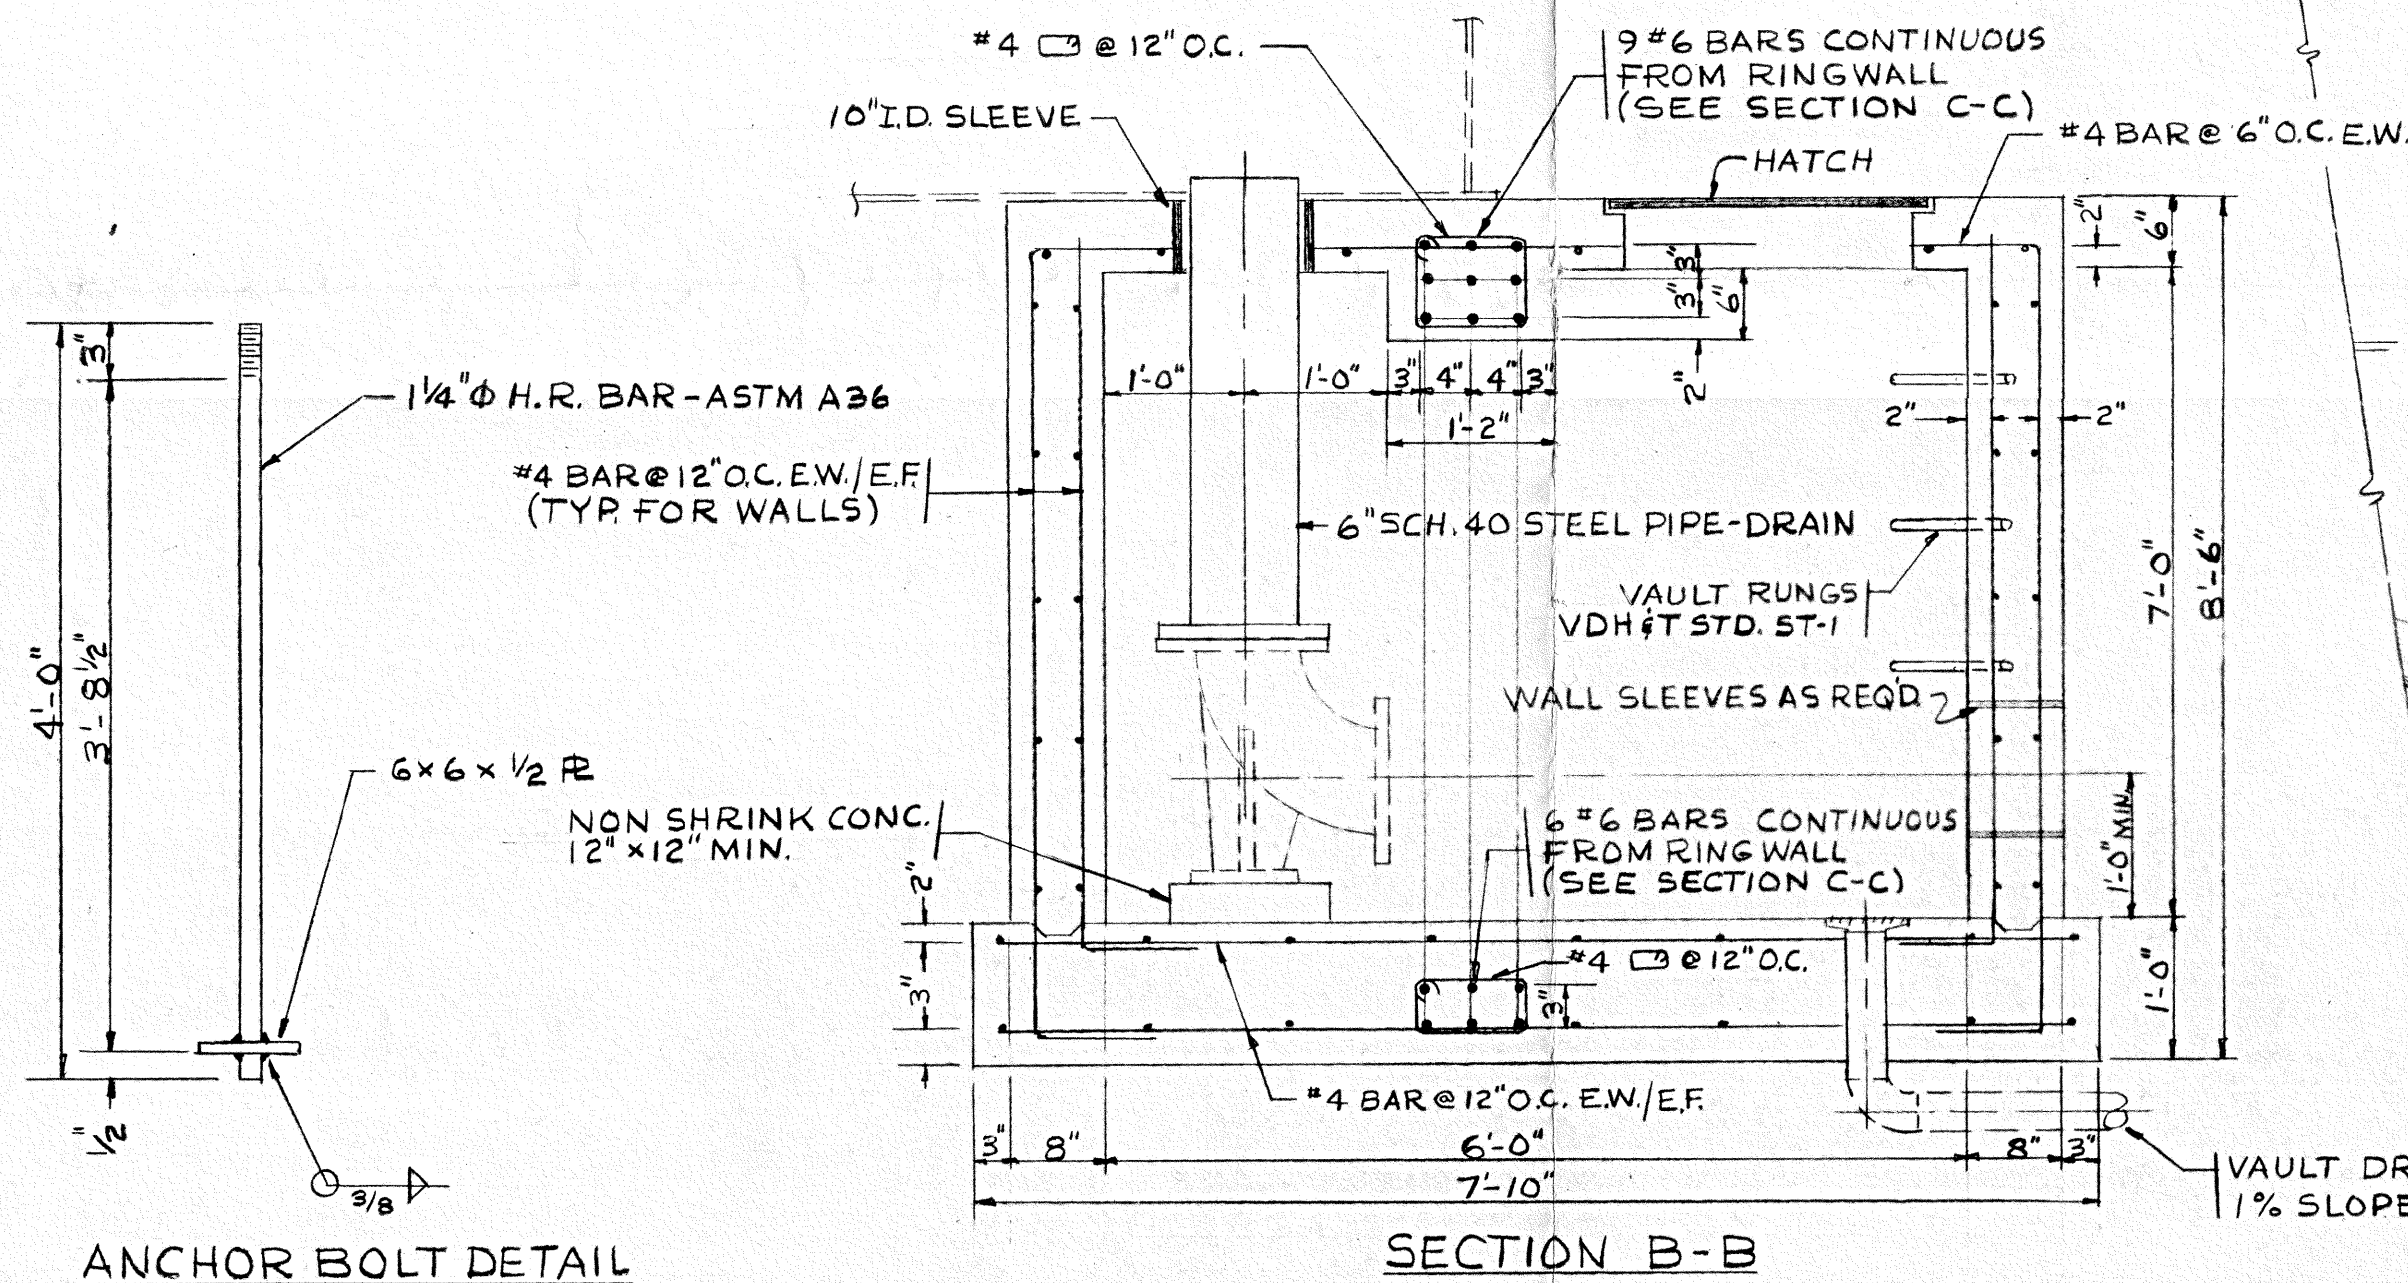

INDUSTRIAL WELDING & MACHINE CORP.
ATKINS VIRGINIA

90,000 GALLON STANDPIPE
CANTERBURY TANK
ROANOKE COUNTY, VIRGINIA

REVISIONS 3-2-87	BY DK	SHEET
	CHK	2 of 2
	DATE 1-16-87	

