
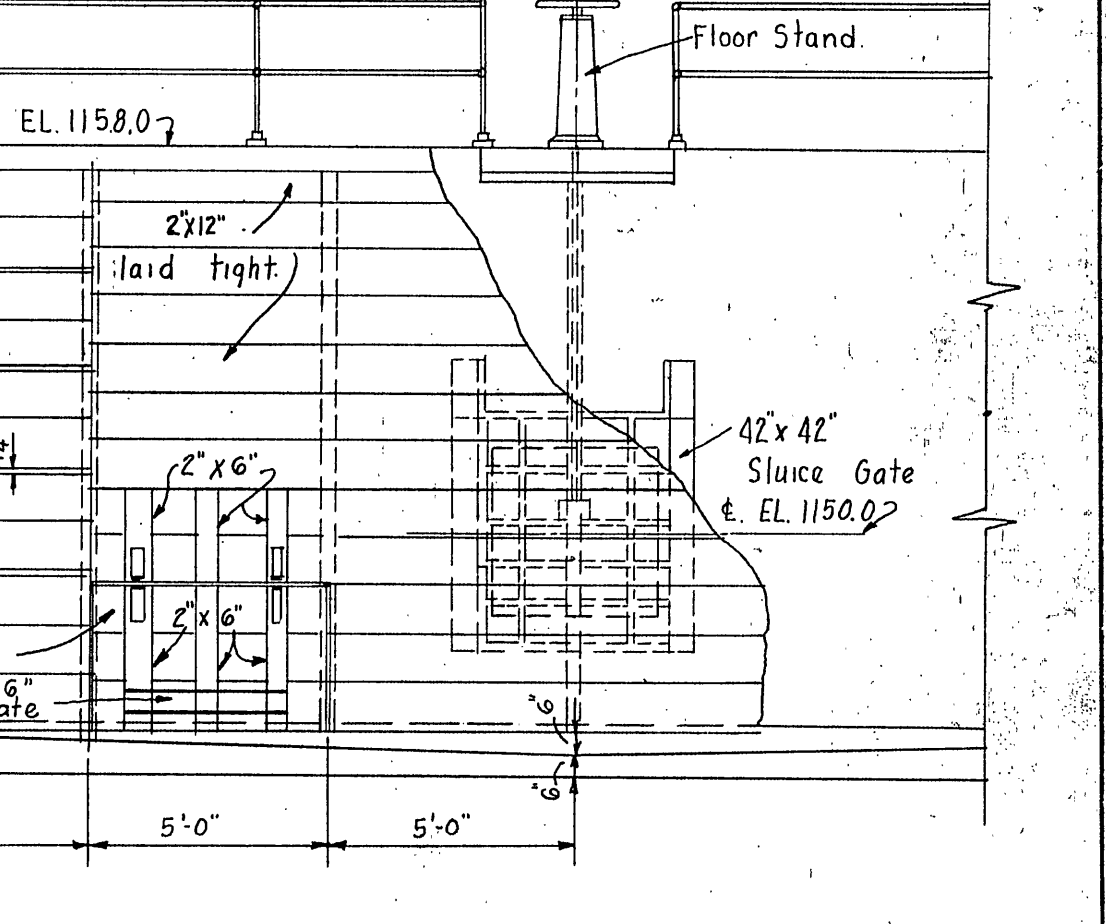
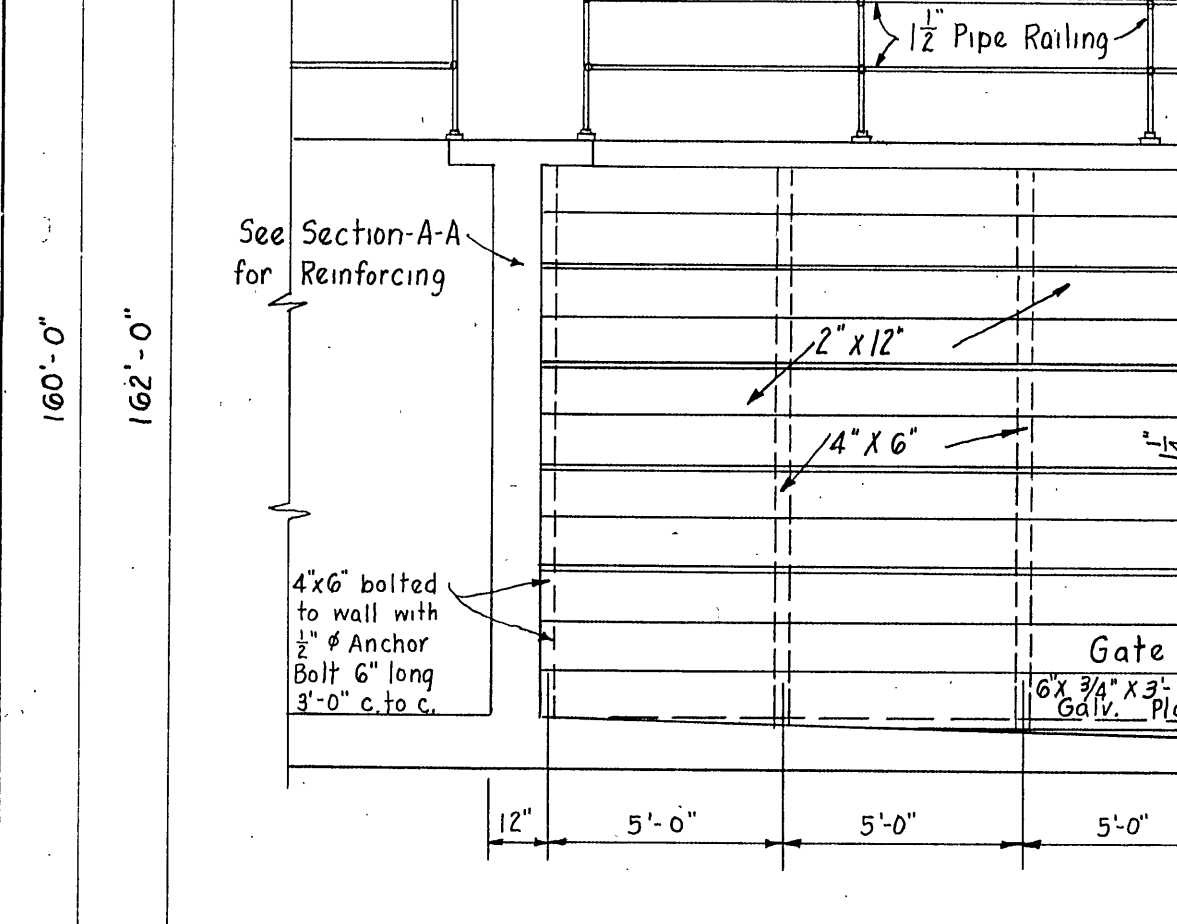
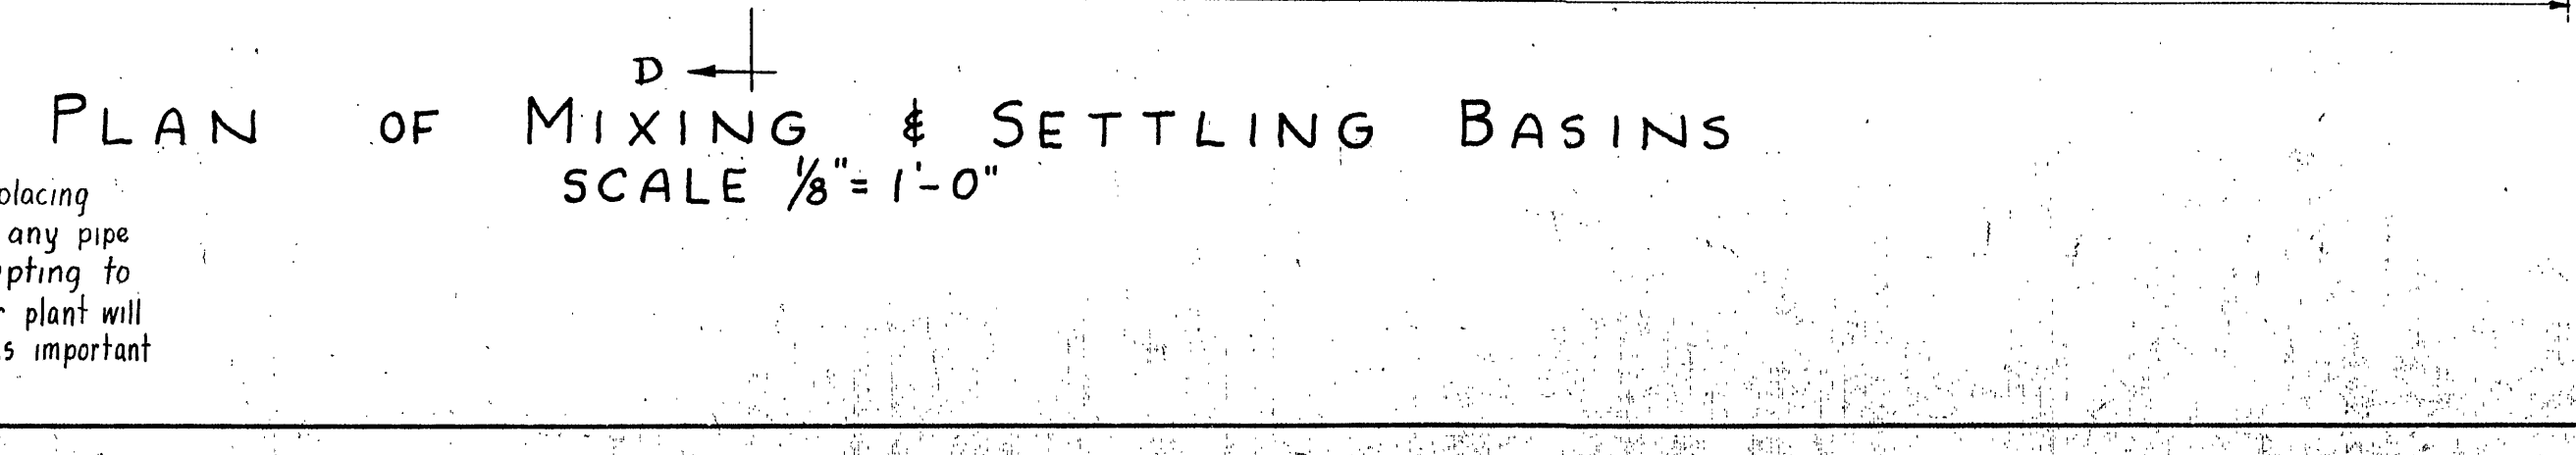
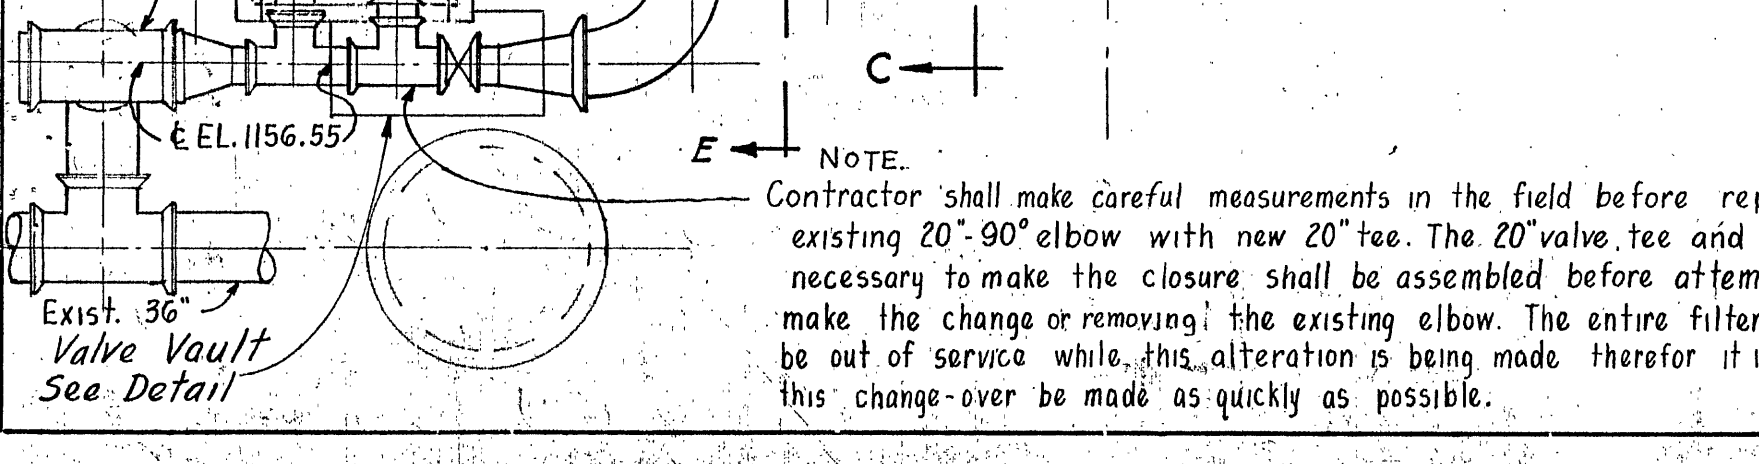
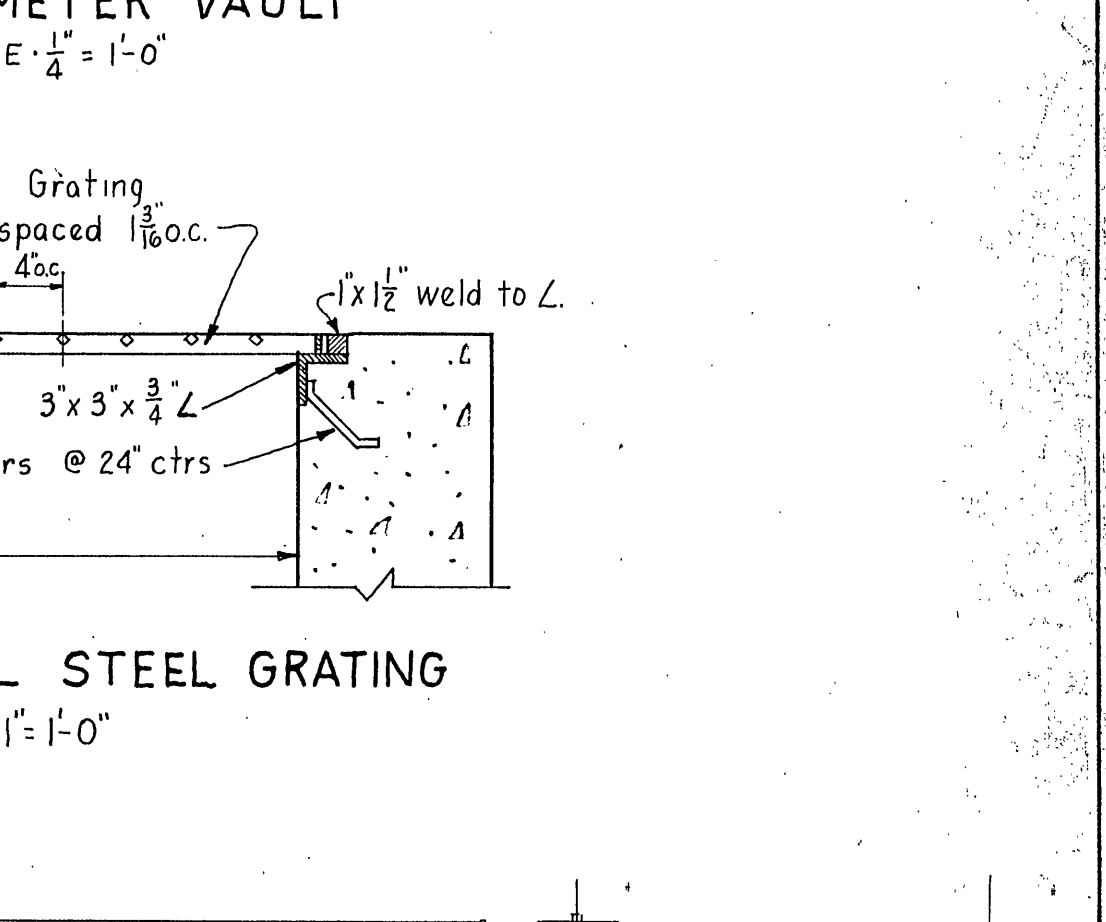
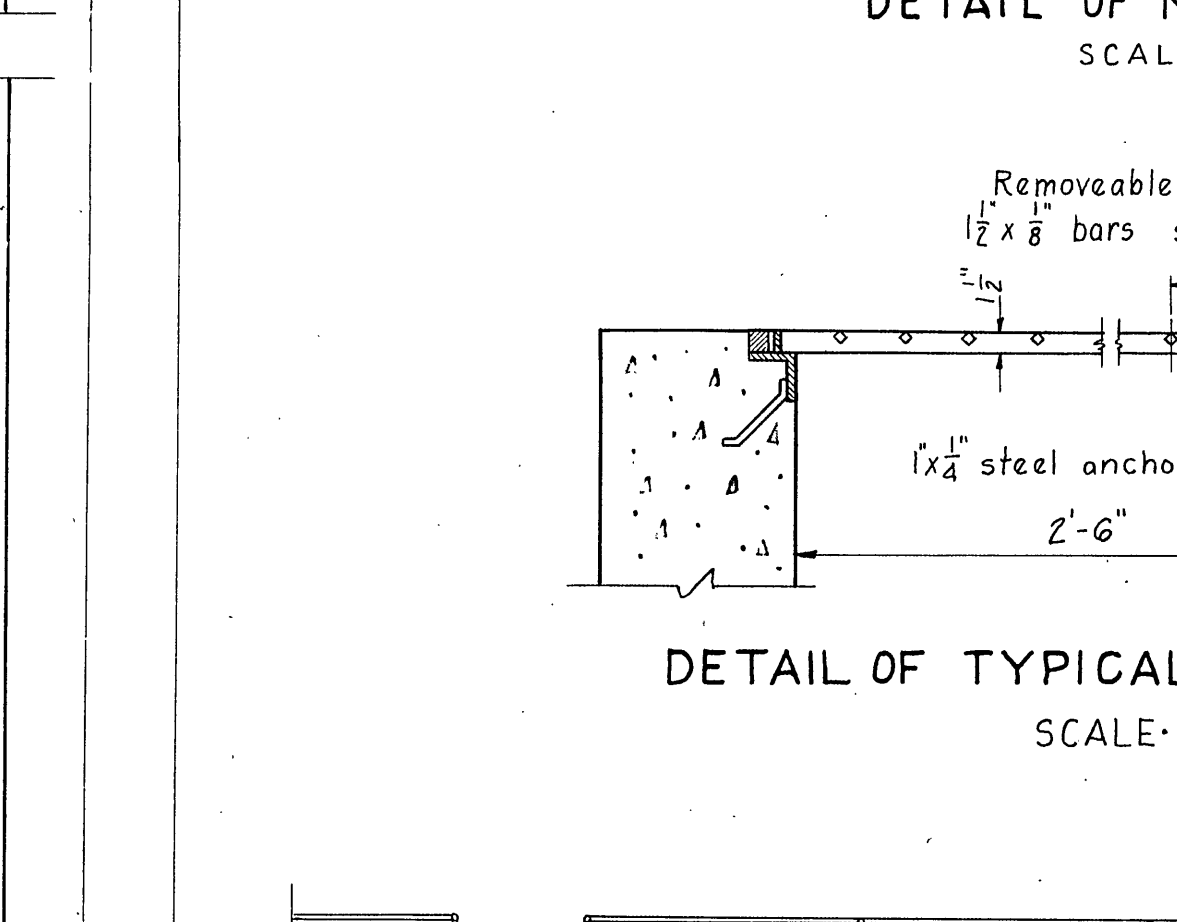
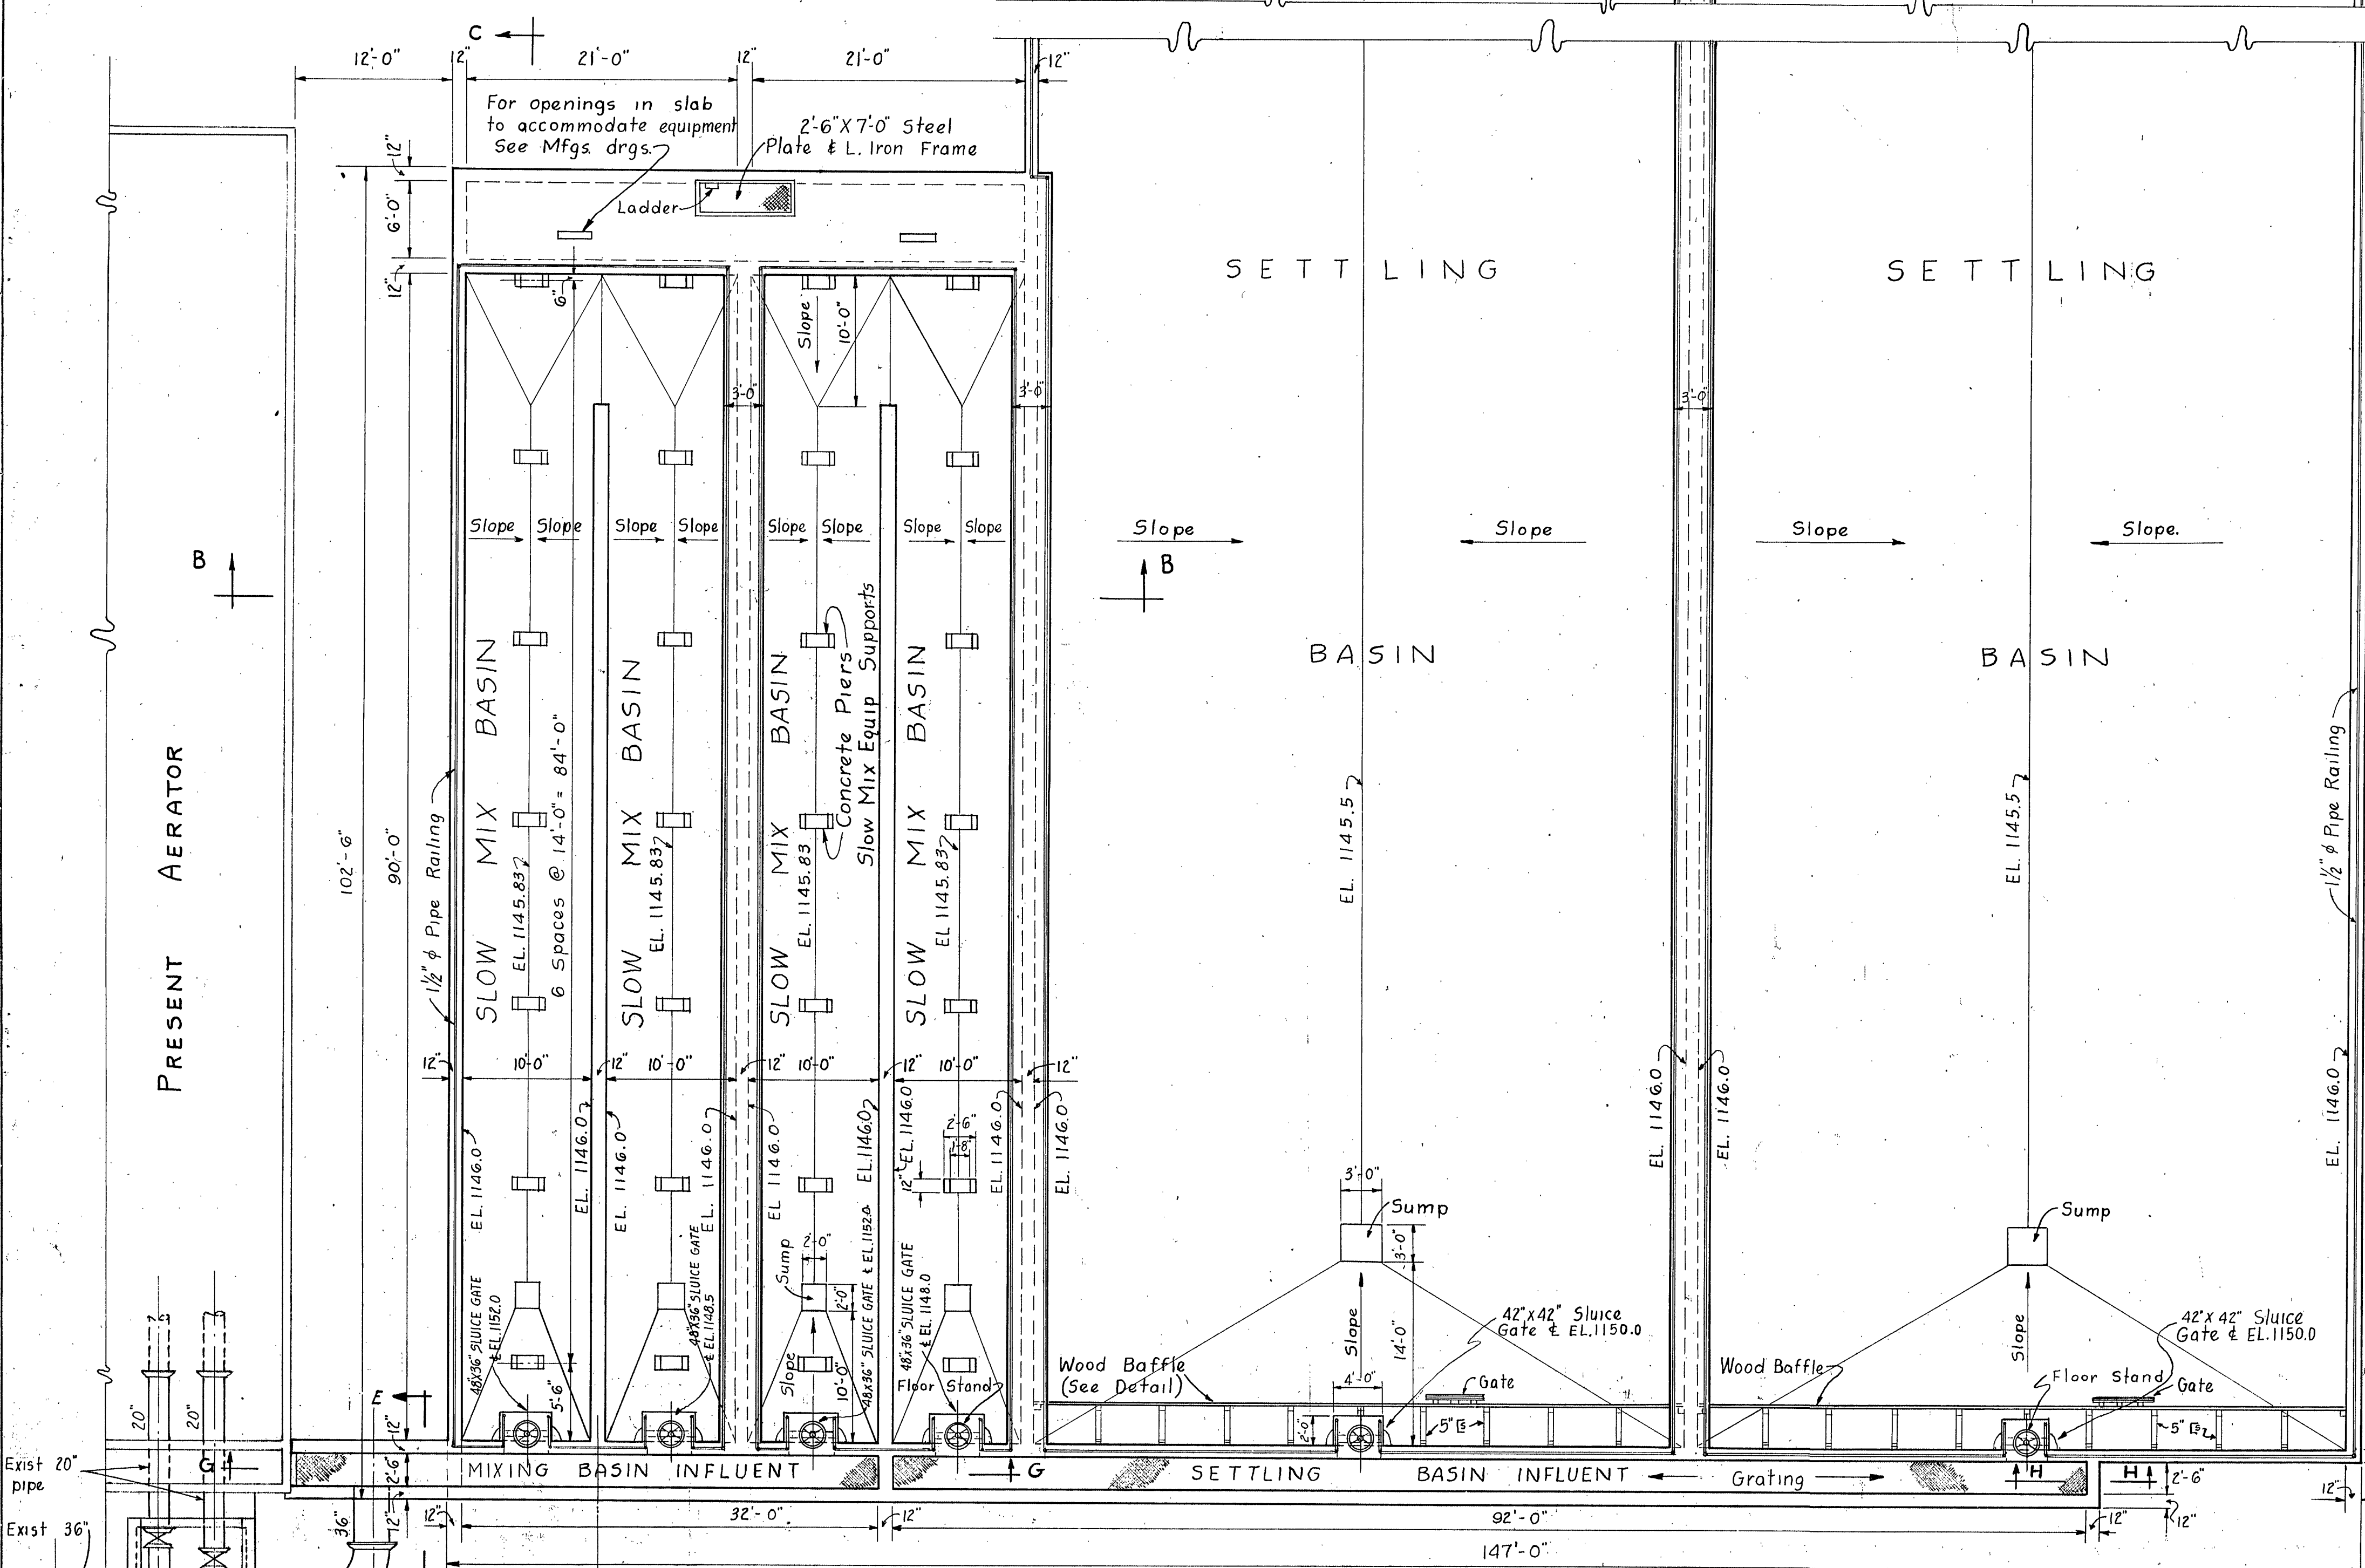
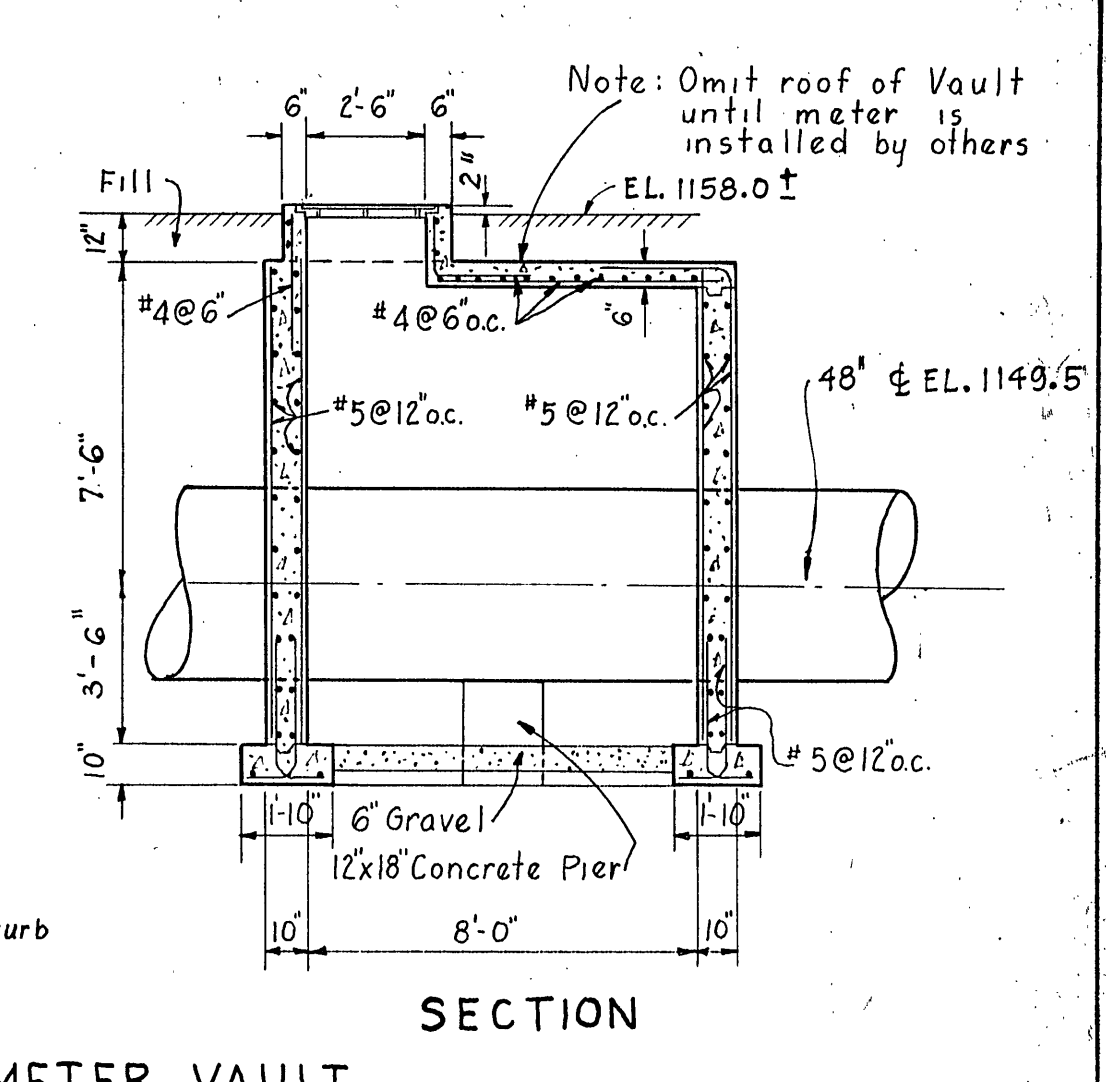
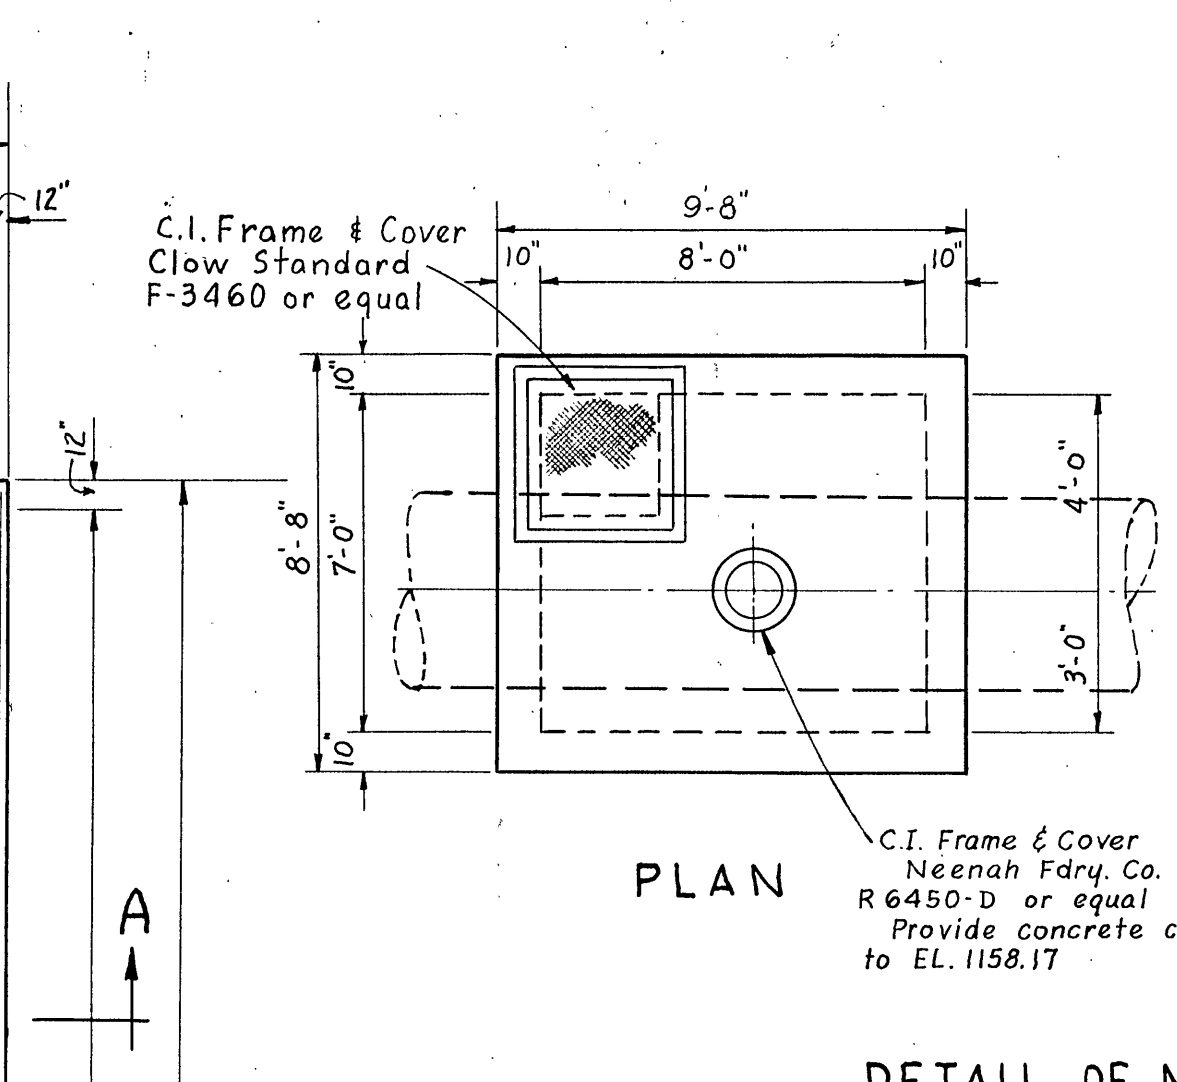
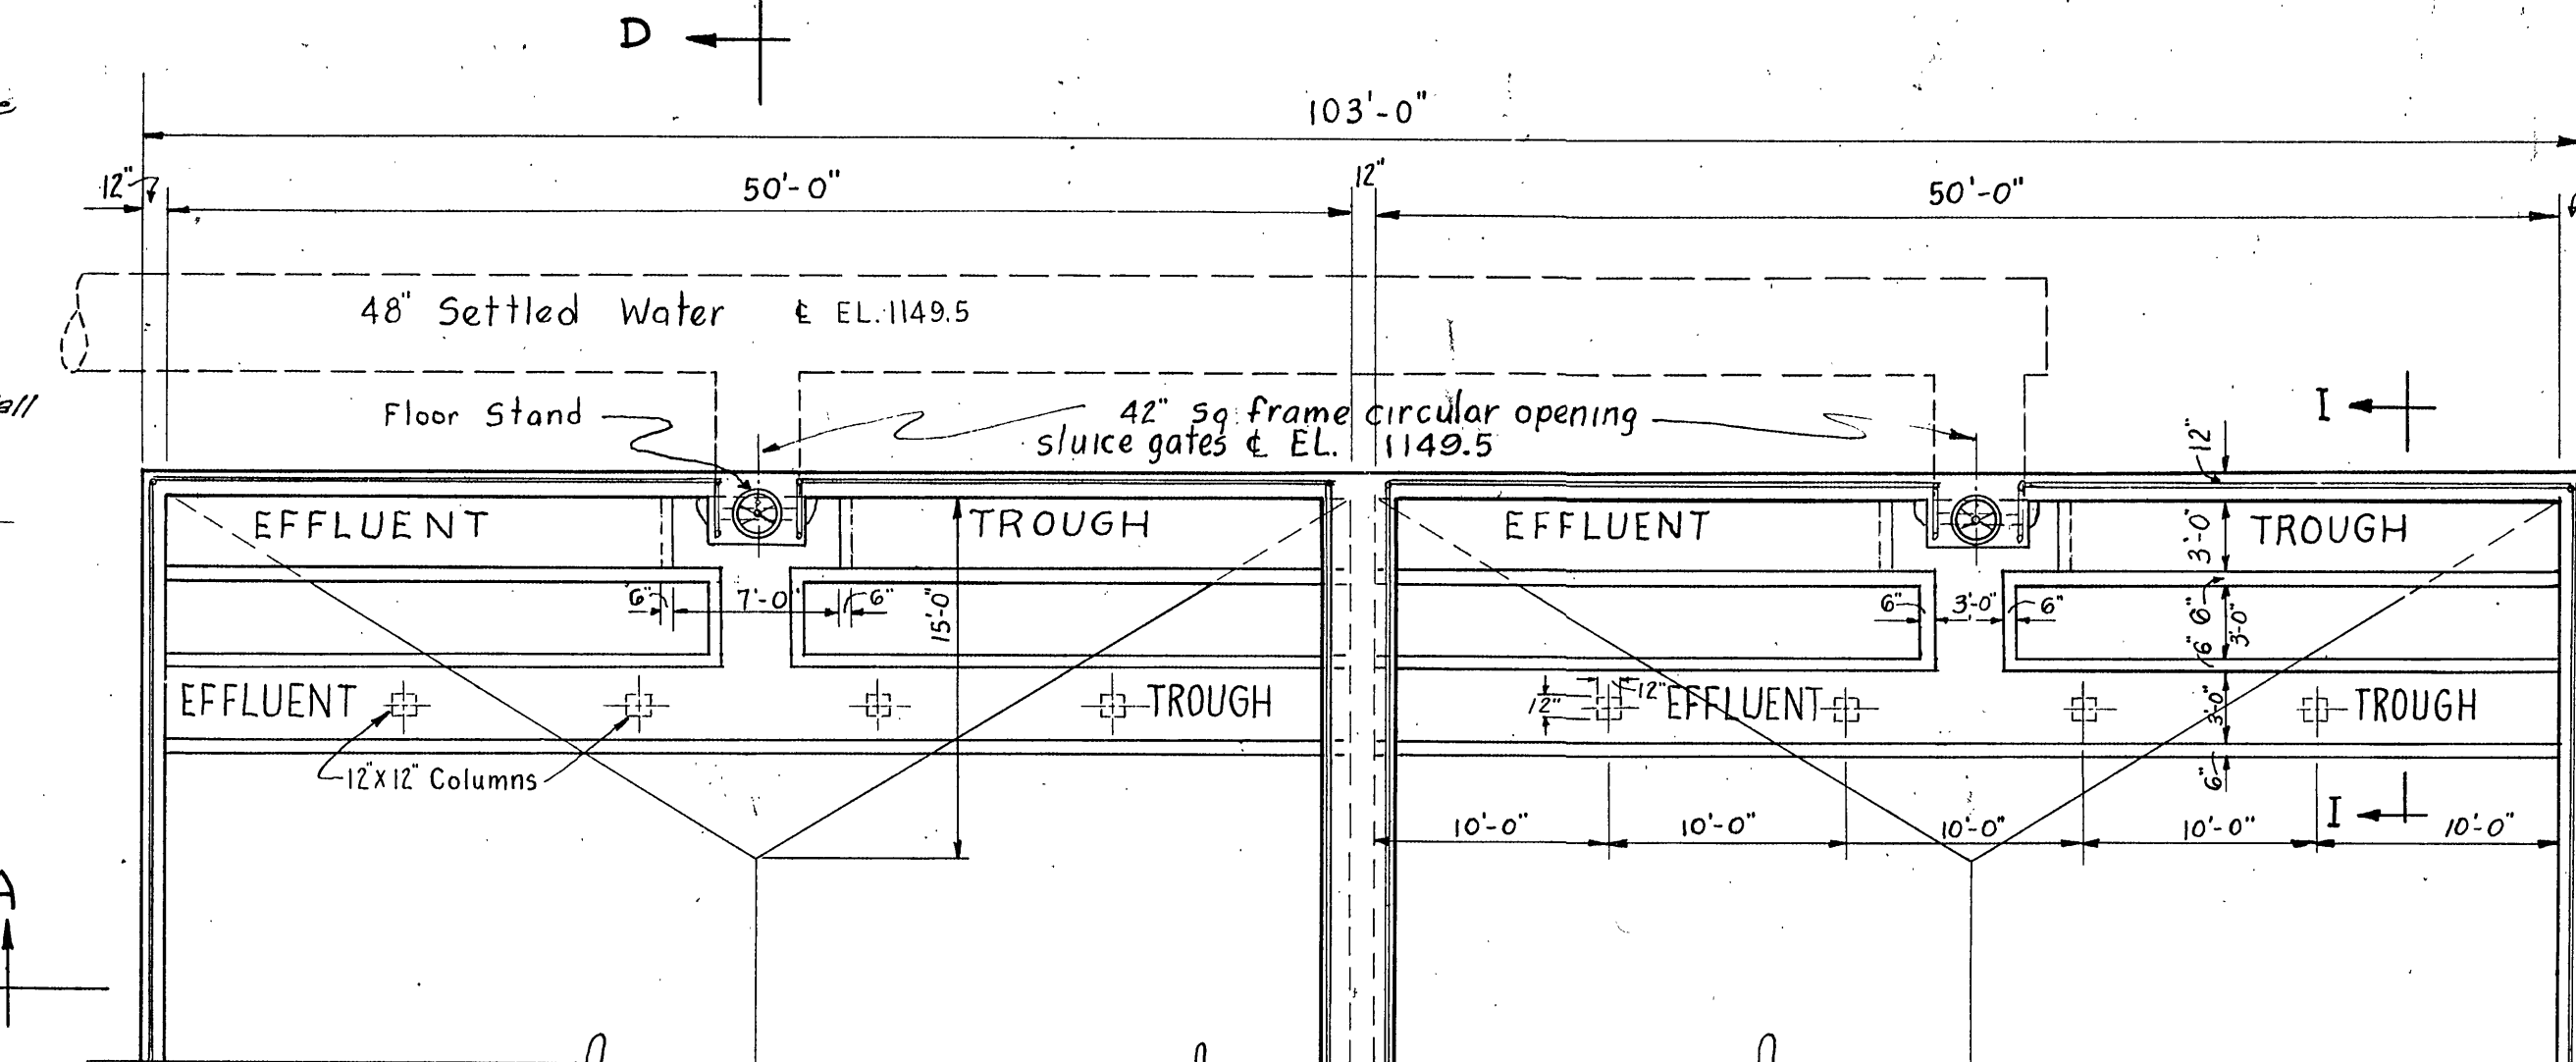


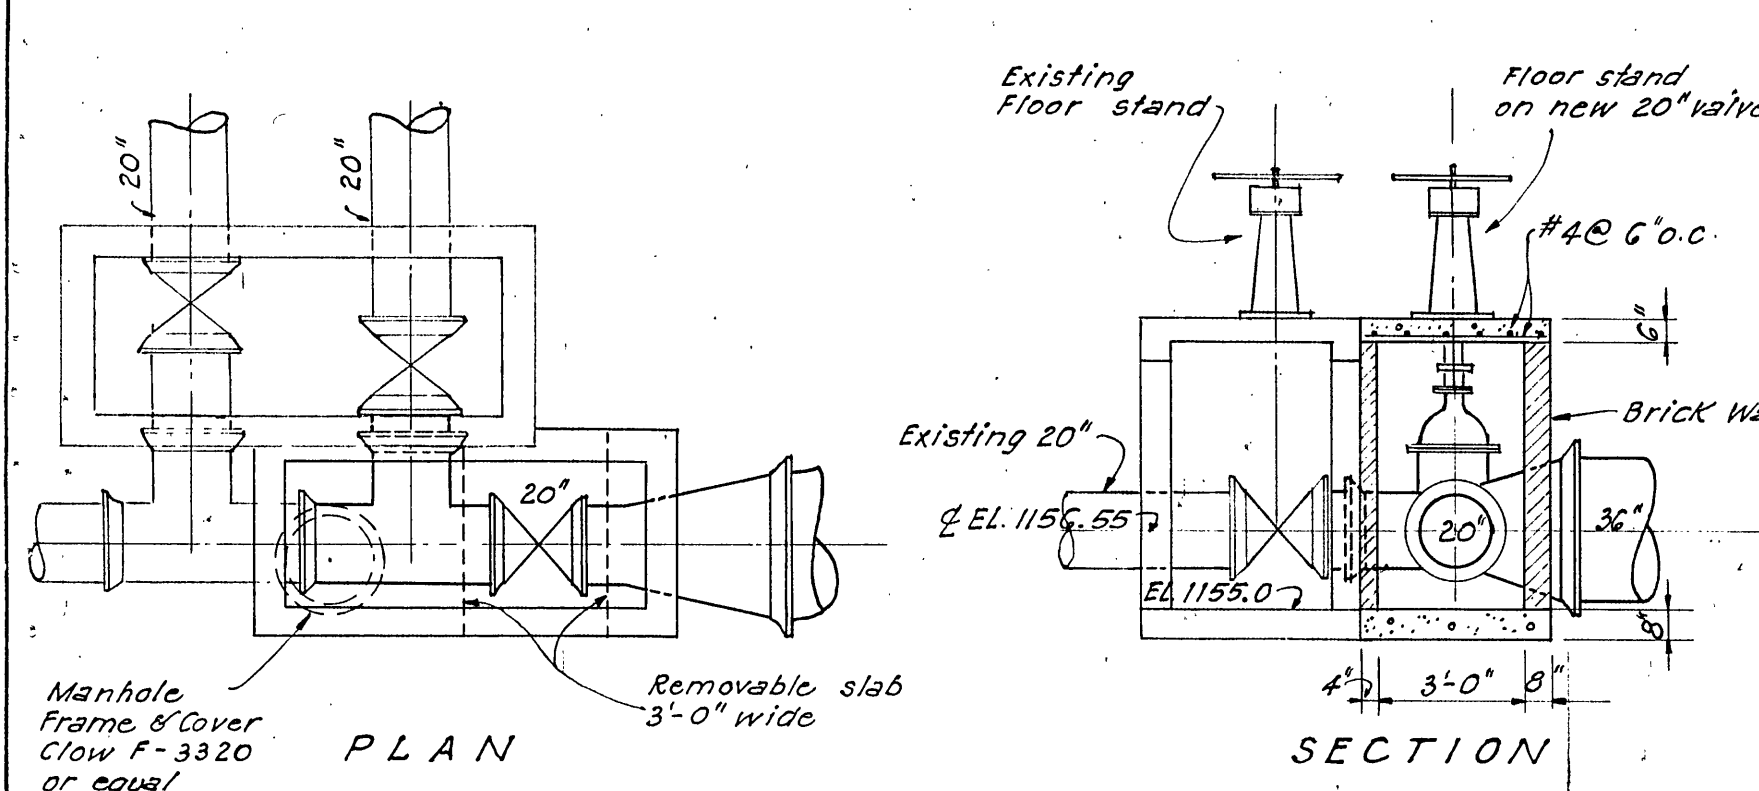

NOTE: Contractor shall make careful measurements in the field before replacing existing 20" 90° elbow with new 20" tee. The 20" valve, tee and any pipe necessary to make the closure shall be assembled before attempting to make the change or removing the existing elbow. The entire filter plant will be out of service while this alteration is being made. Therefore it is important this change-over be made as quickly as possible.

PLAN OF MIXING & SETTLING BASINS
SCALE: $\frac{1}{8}" = 1'-0"$

Note: See Dry #10 & 11 for Sections.

CARVIN'S COVE WATER SUPPLY
FILTER PLANT ADDITION
MIXING & SETTLING
BASINS CONCRETE DETAILS
ROANOKE WATER DEPT.
ROANOKE, VIRGINIA
ALVORD, BURDICK & HOWSON
ENGINEERS
1954 CHICAGO