

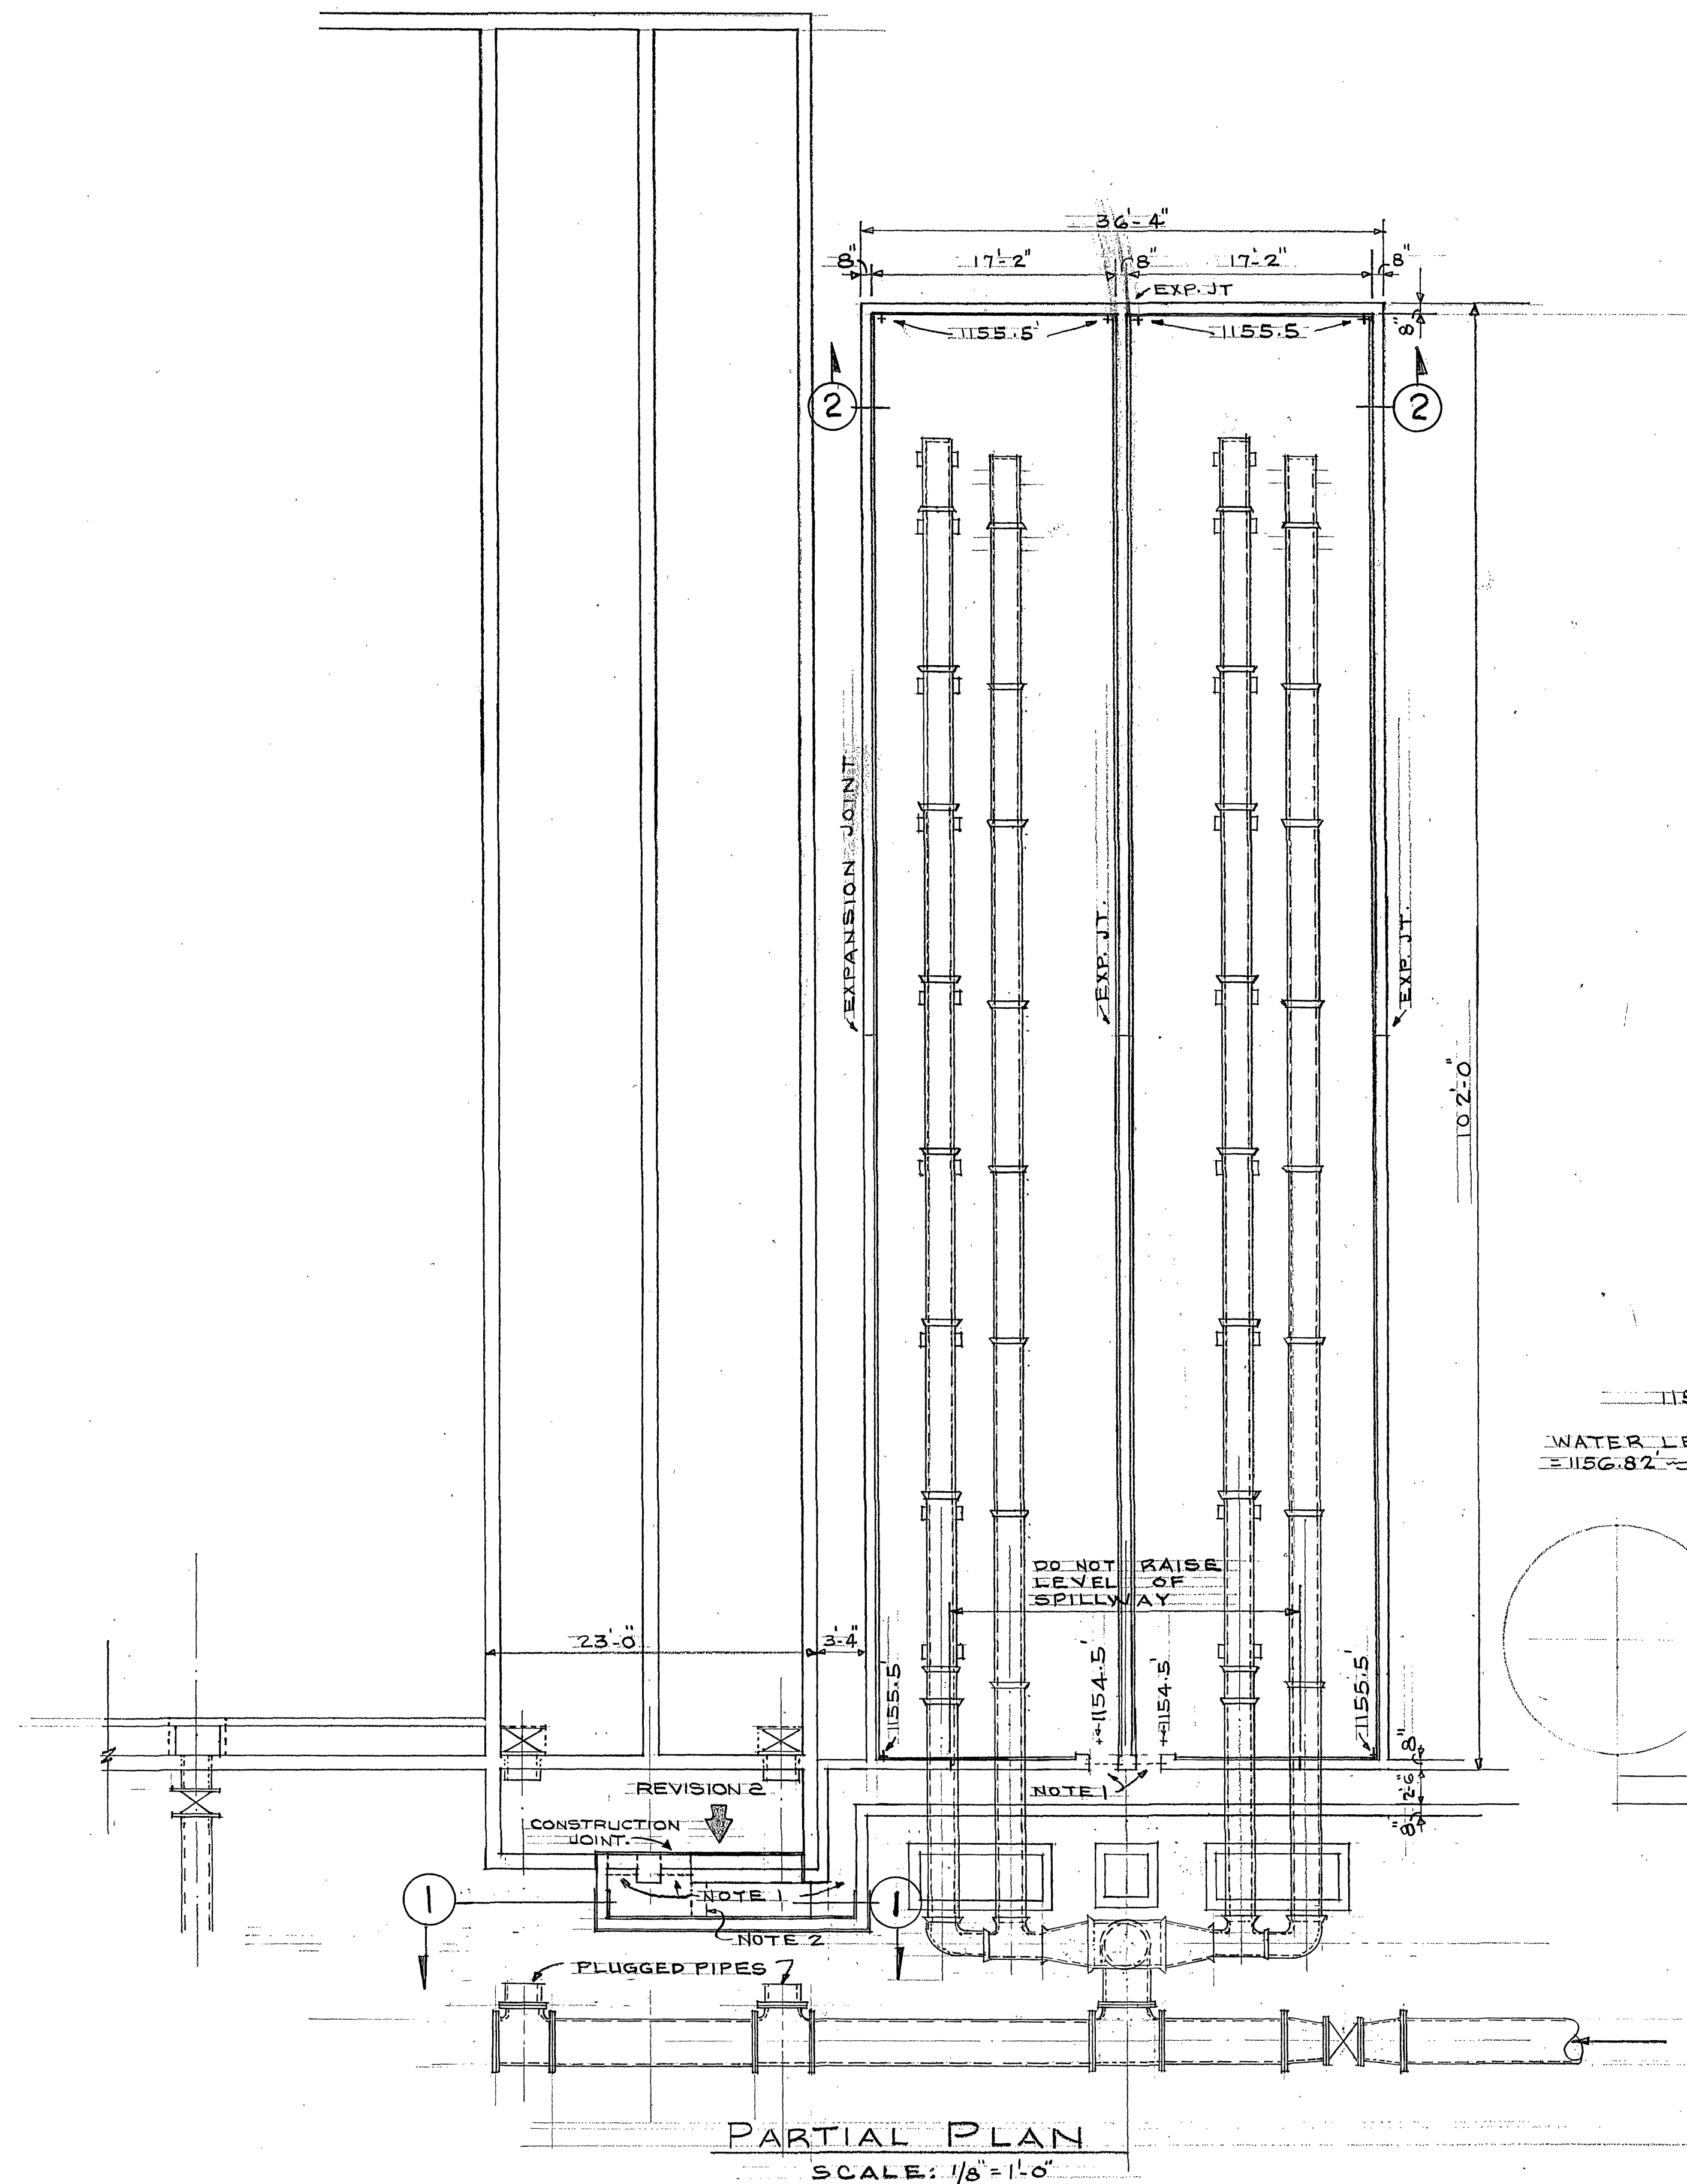


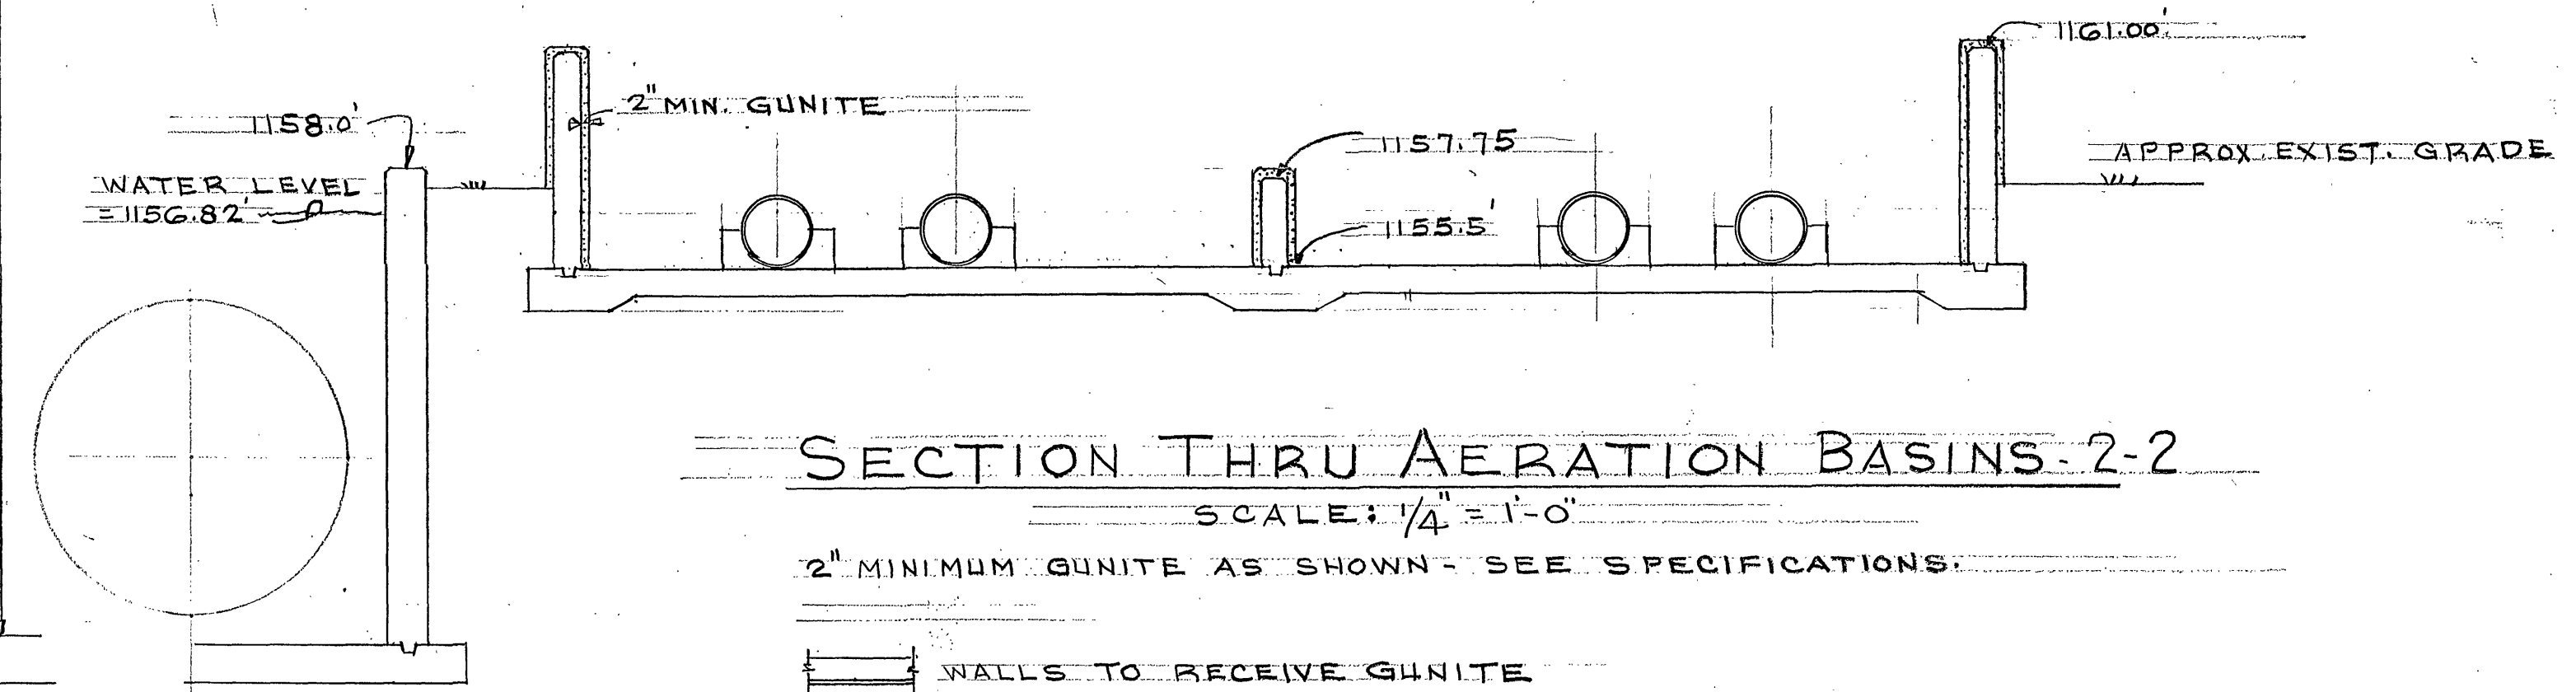

NOTE 1.
CONCRETE IN PASSAGEWAYS HAS
SPALLED BADLY AND IS IN DIRE
NEED OF REPAIR. RETAIN AS MUCH
OF ORIGINAL PASSAGE OPENING WIDTH
AS POSSIBLE.

NOTE 2.
BEAM OVER IS 12 1/2" W x 8" D. RETAIN REINF.
& REBUILD CONCRETE PORTION OF
BEAM.

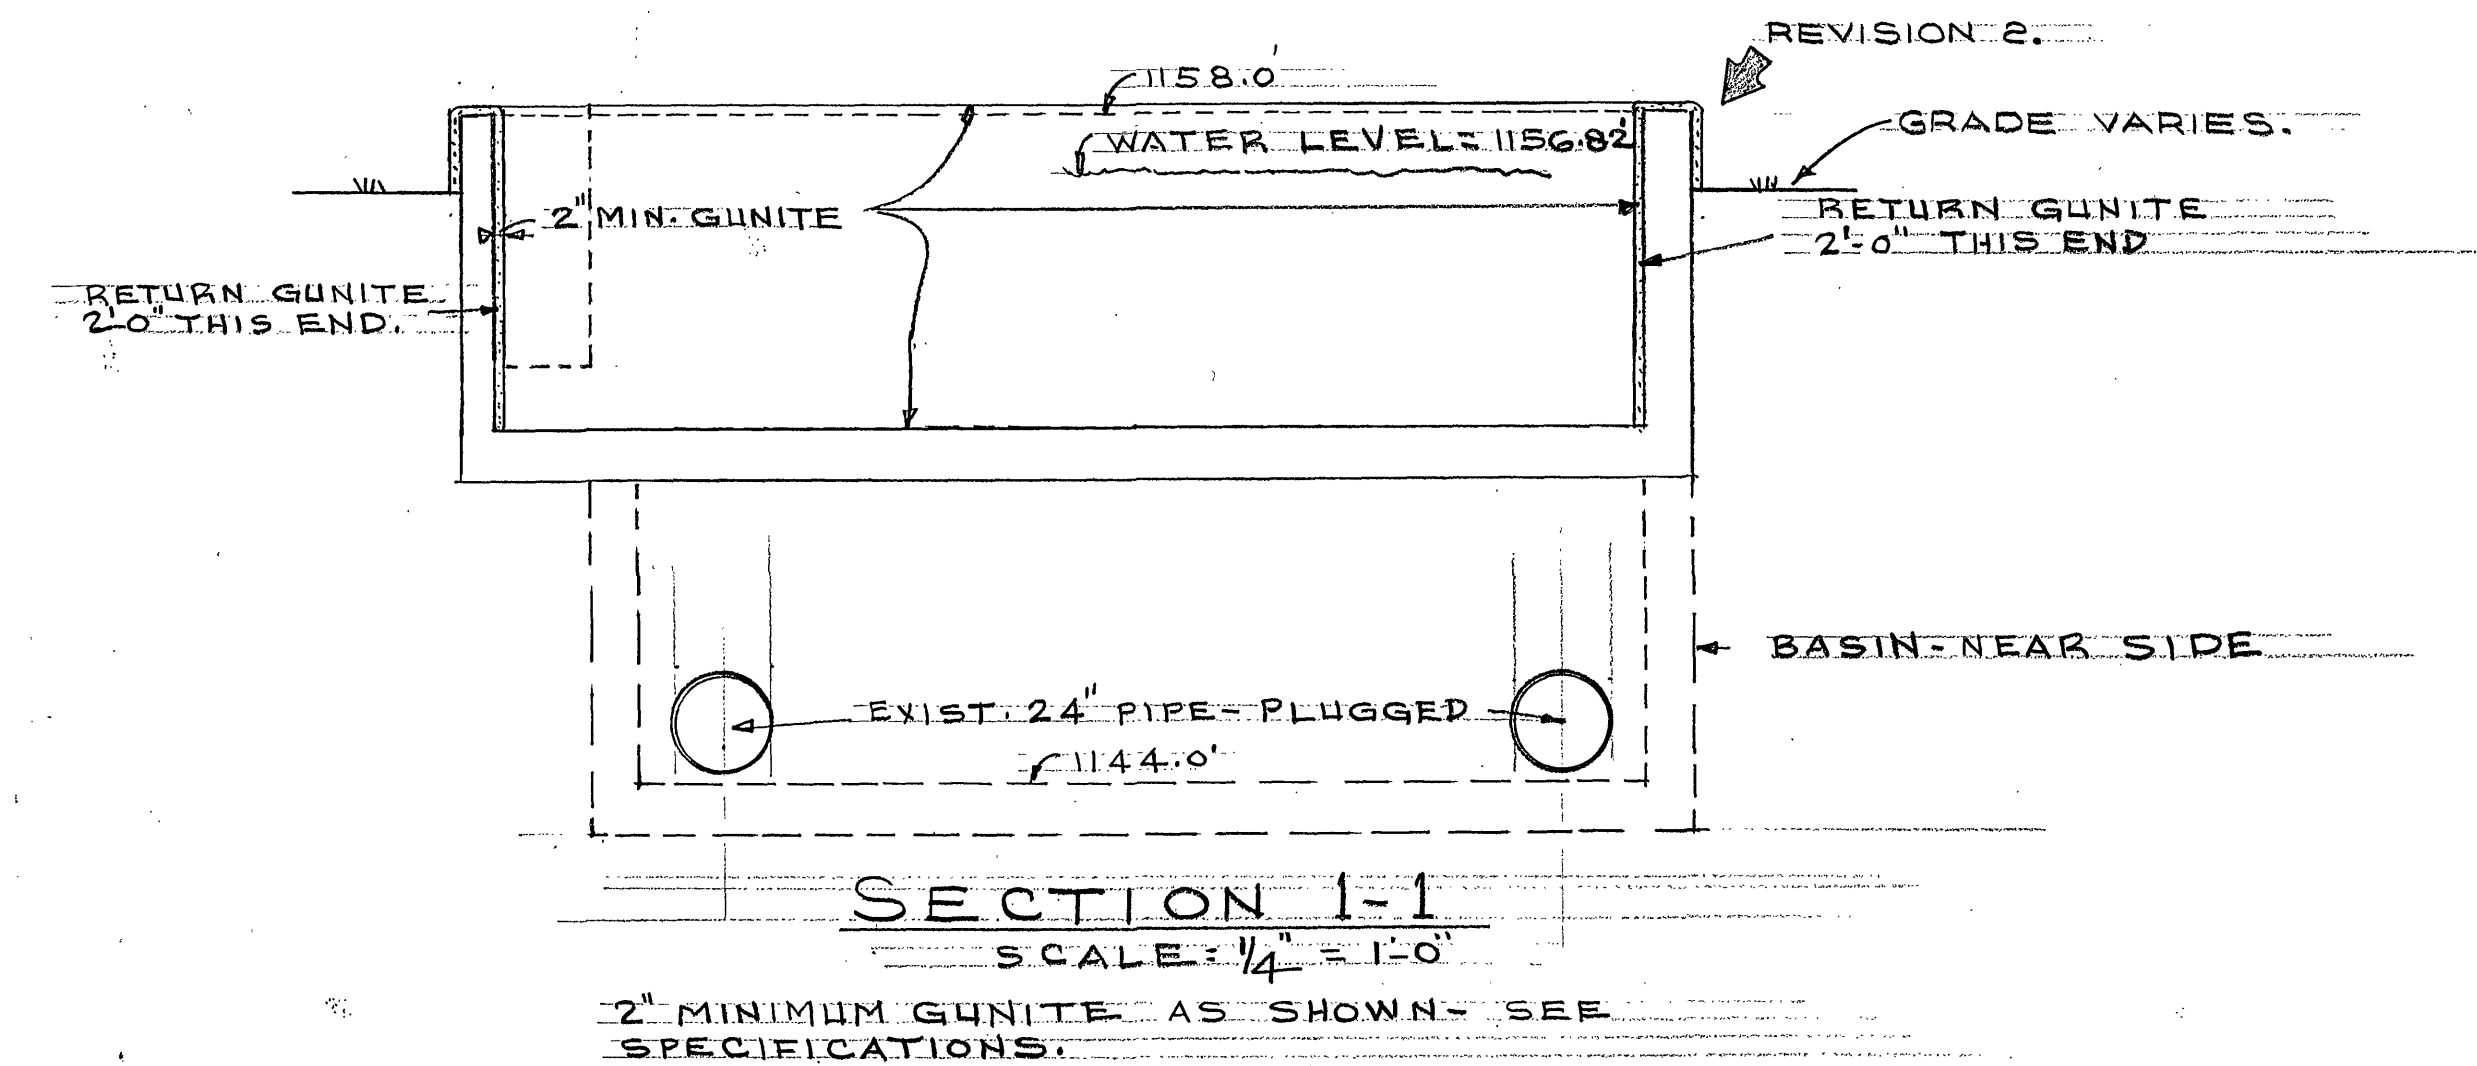

0-3-79	2	ADDENDUM II	LBV
8-24-79	1	GUNITE ON WALLS ONLY	LBG
DATE	REV.	DESCRIPTION	BY
08/23/79	1	GUNITE REPAIR AS SHOWN	LBG
08/23/79	1	CARVINS COVE FILTER	LBG
08/23/79	1	PLANT - I-81 NORTH	LBG
08/23/79	1	ROANOKE, VIRGINIA	LBG
08/23/79	1	CITY OF ROANOKE	LBG
08/23/79	1	STATE OF VIRGINIA	LBG
08/23/79	1	CONTRACTOR MUST VERIFY ALL DIMENSIONS AT PROJECT BEFORE PROCEEDING WITH WORK	LBG