

TEL (540) 342-4002
FAX (540) 342-2060
www.HughesArchitects.com

**ALTERATIONS TO
WESTERN VIRGINIA
WATER AUTHORITY**
Jefferson Street at Franklin Road
Roanoke, Virginia

SECOND
FLOOR
PLAN -
DEMOLITION

MANN & ASSOCIATES, INC.
306 Market Street
Roanoke, VA 24011
540-344-5513 Fax 343-0235

COMMISSION No


T00505

SHEET

M-1

No. _____ of _____

© COPYRIGHT 2001
HUGHES ASSOCIATES ARCHITECT
A PROFESSIONAL CORPORATION

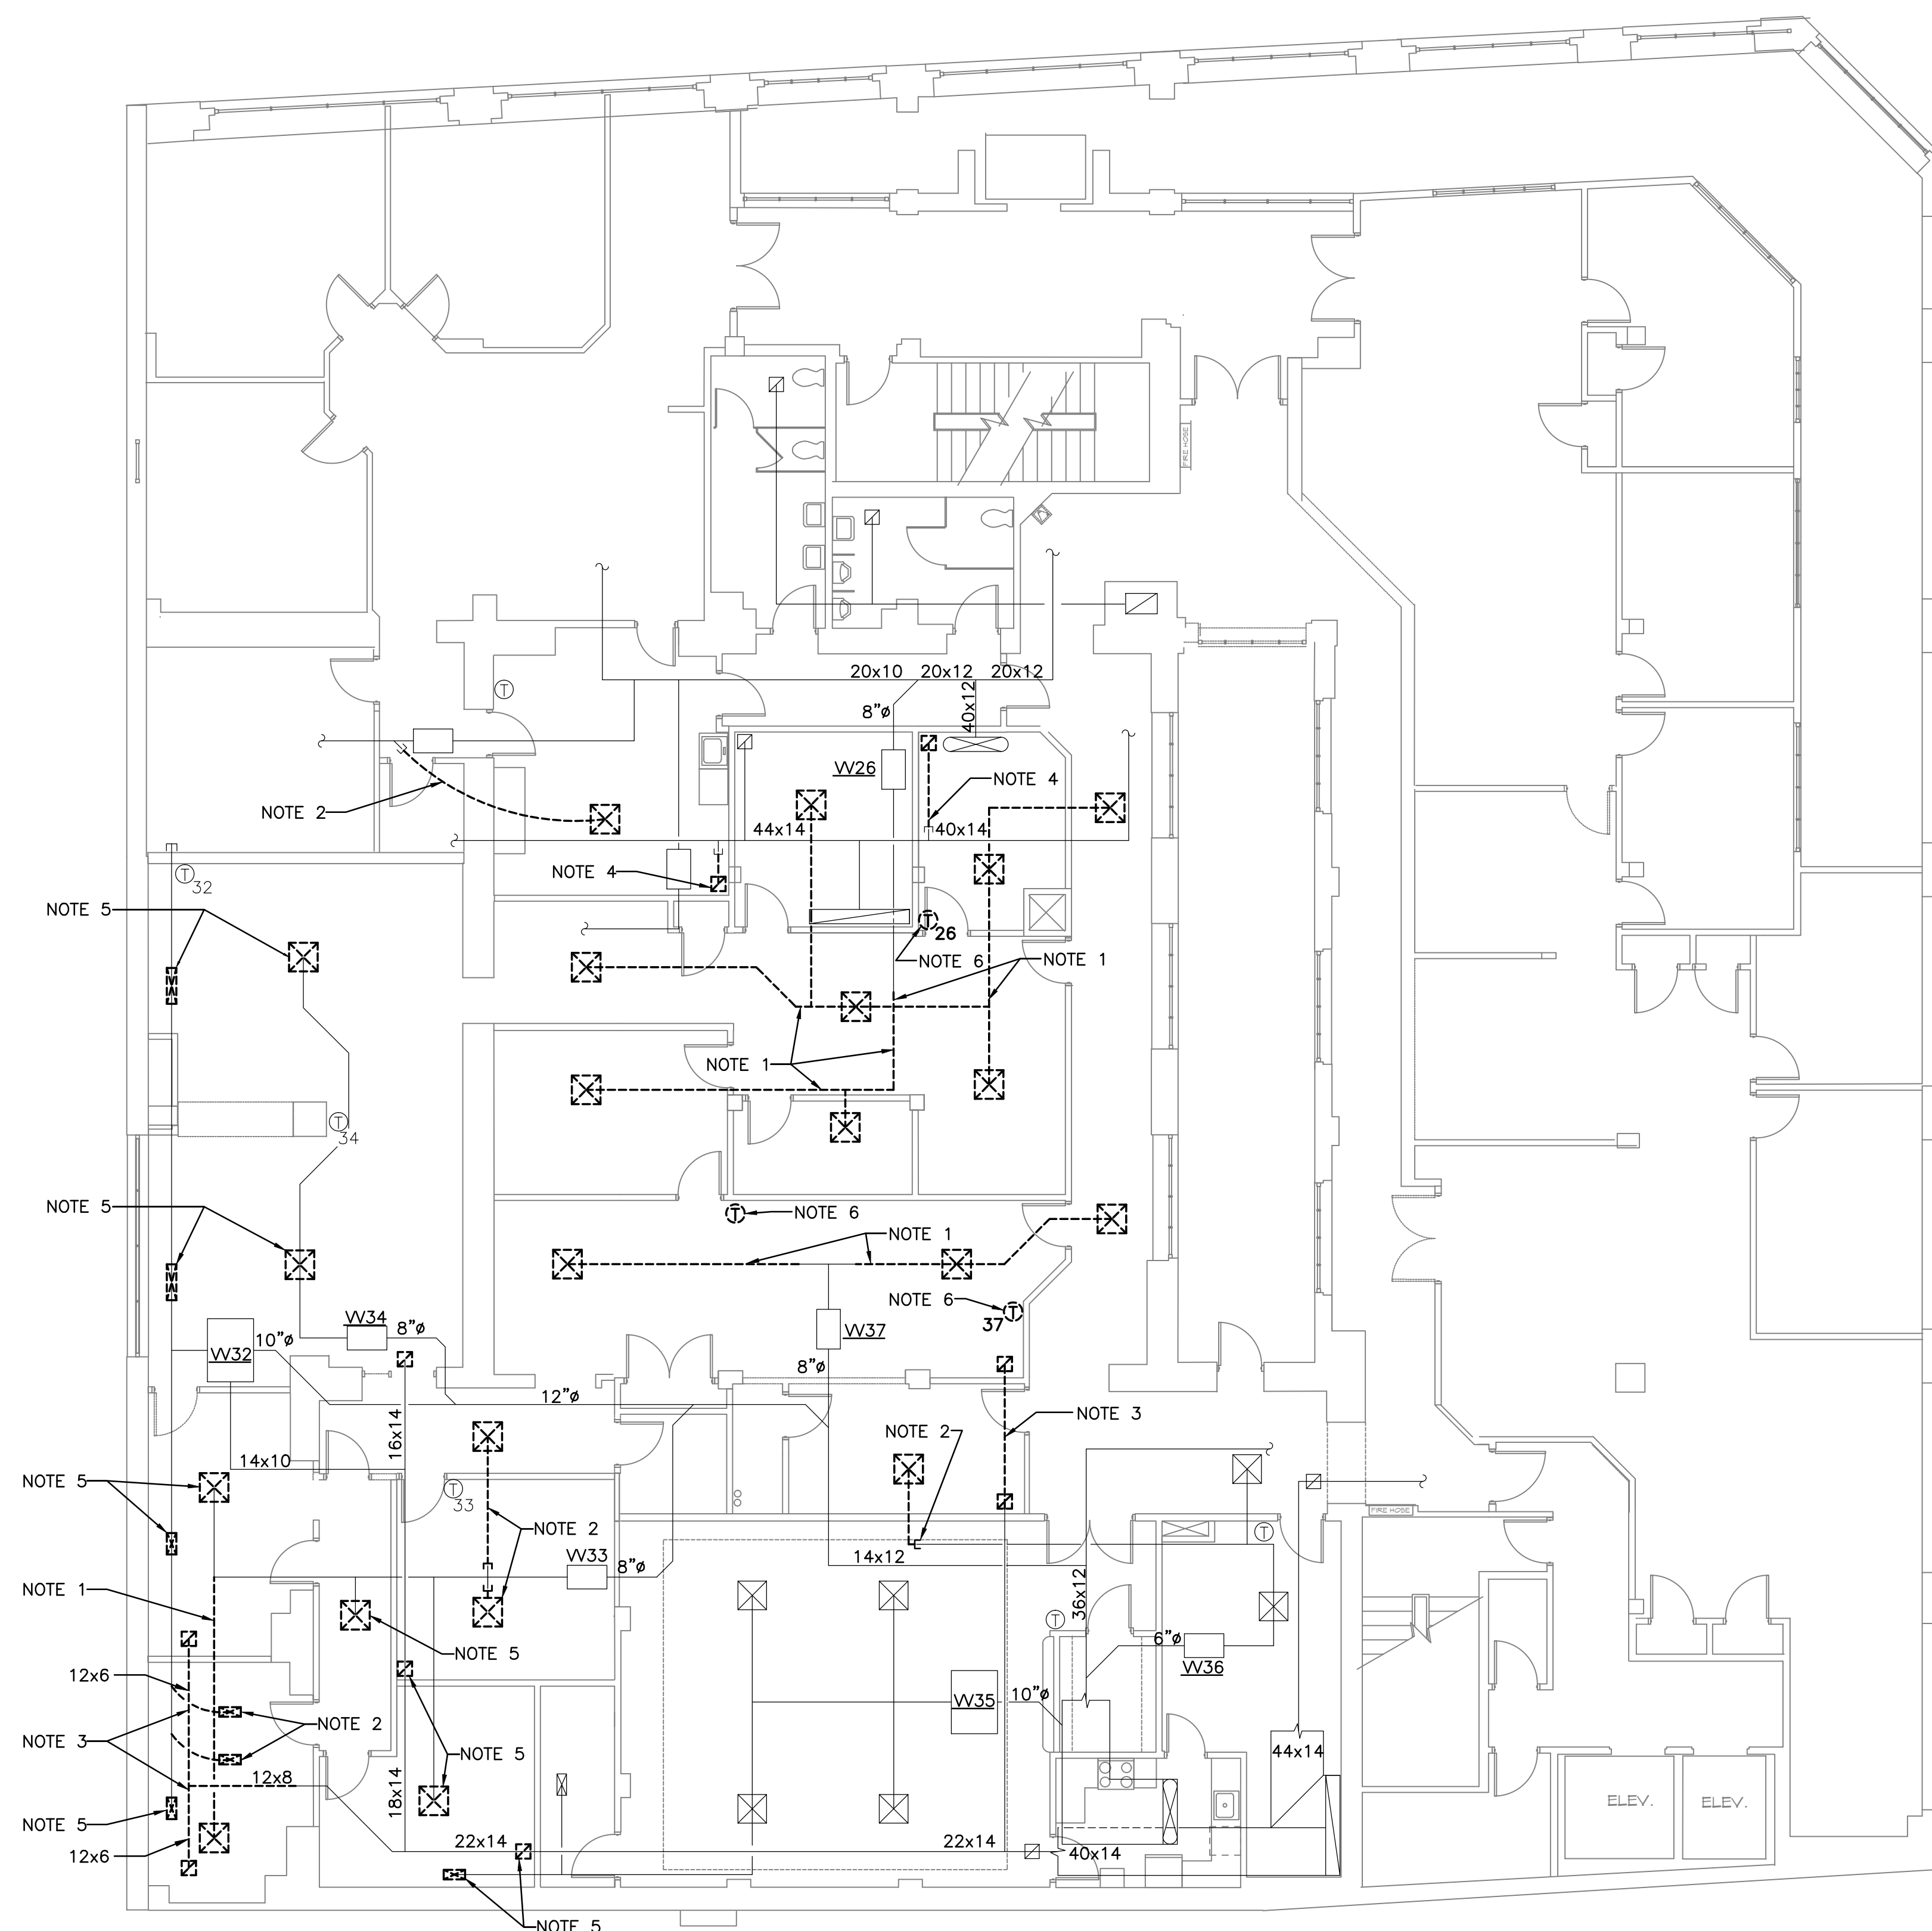

SECOND FLOOR PLAN - DEMOLITION

MECHANICAL LEGEND	
SYMBOL	DESCRIPTION
----	ITEM TO BE REMOVED
—	EXIST. DUCTWORK
—	NEW DUCTWORK
 CD9 200 CFM	9" CEILING DIFFUSER SUPPLYING 200 CFM
	RETURN OR EXHAUST REGISTER OR GRILLE
(T)	THERMOSTAT OR SENSOR, MOUNT 5'-4" ABOVE FLOOR, UNLESS NOTED OTHERWISE
	MANUAL VOLUME DAMPER
CD	CEILING DIFFUSER
RR	CEILING RETURN REGISTER
AH-201	AIR HANDLER #201
 <u>VV32</u>	EXIST. VAV BOX 32
	CONNECT TO EXISTING

NOTES THIS SHEET

1. REMOVE SUPPLY DUCT AND CEILING DIFFUSERS. PREPARE REMAINING DUCT FOR NEW CONNECTION.
2. REMOVE CEILING DIFFUSER & SUPPLY DUCT AND CAP DUCT.
3. REMOVE RETURN DUCT AND CEILING GRILLE. PREPARE REMAINING DUCT FOR NEW CONNECTION.
4. REMOVE CEILING GRILLE AND RETURN DUCT AND CAP DUCT.
5. REMOVE CEILING DIFFUSERS OR REGISTERS AND ASSOCIATED DUCT CONNECTION. PREPARE DUCT FOR CONNECTION TO NEW DIFFUSER.
6. RELOCATE THERMOSTAT. SEE SHEET M-2 FOR NEW LOCATION.