




Plotting File: P:\Projects\2004\04102 - Western Virginia Water Authority Coulter Building.dwg Mar 18, 2005 - 10:35am

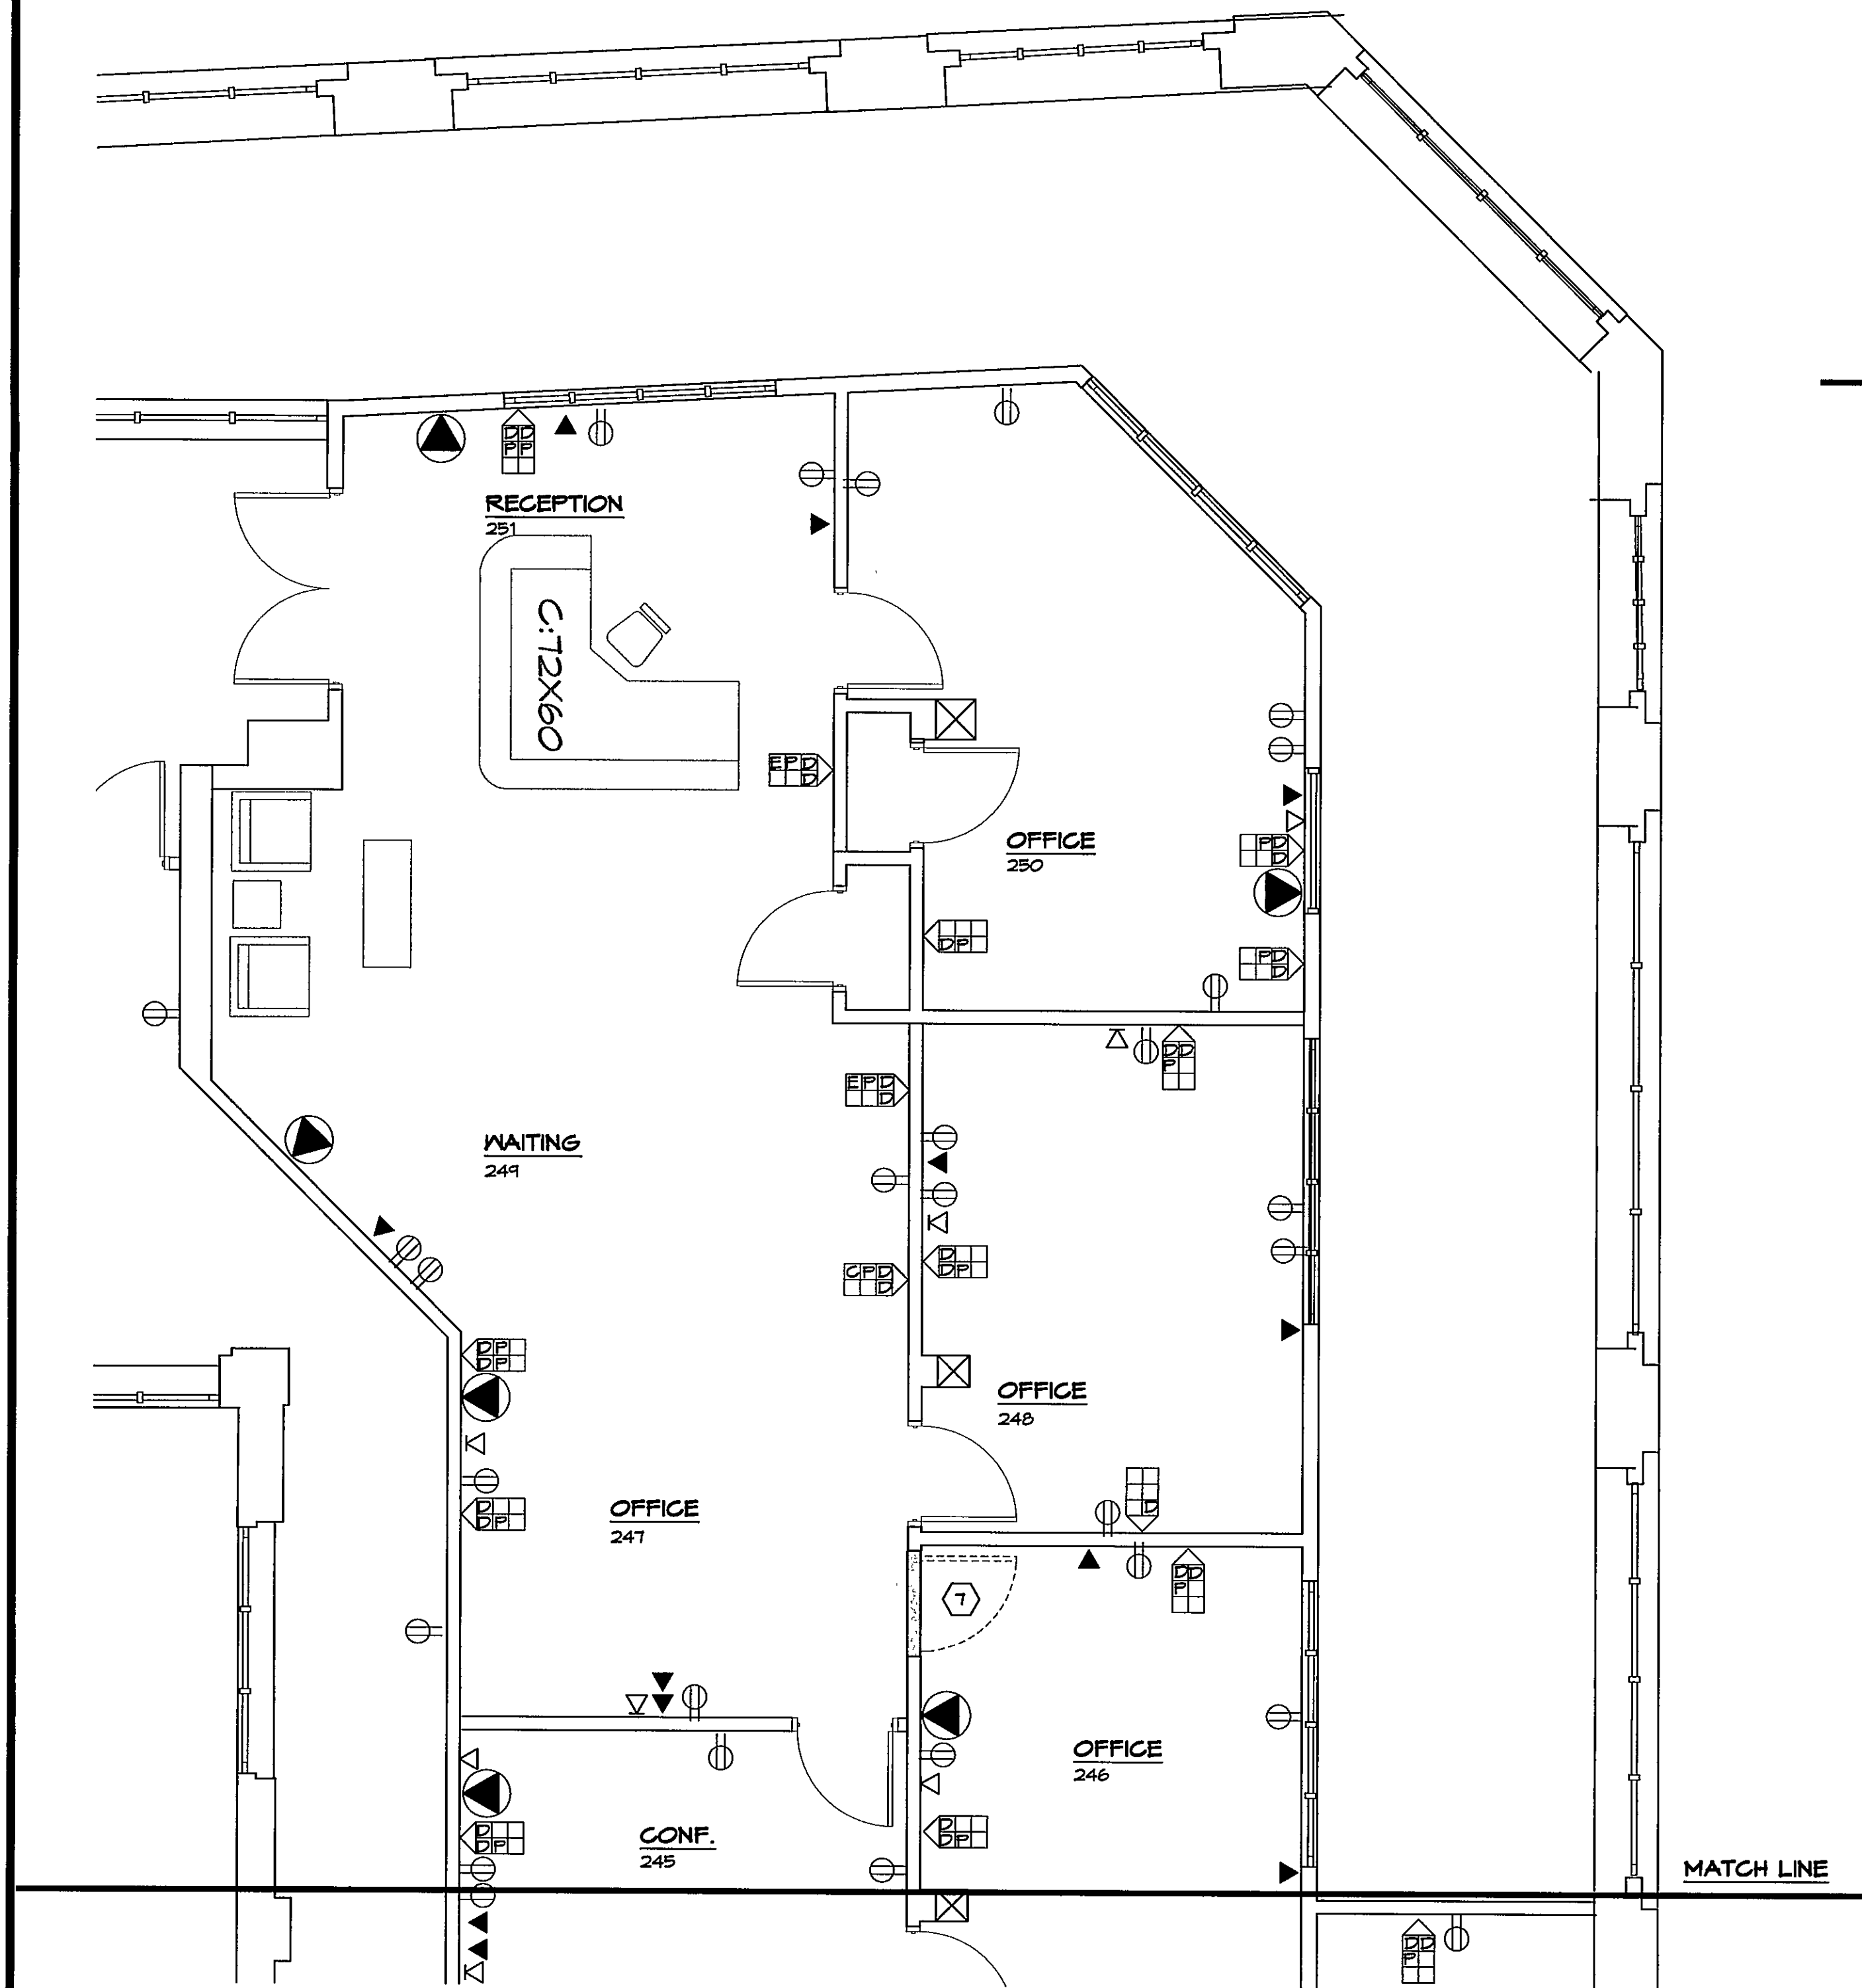

E1-5.1
E1-3
SECOND FLOOR (EAST)
SCALE: 1/4" = 1'-0"

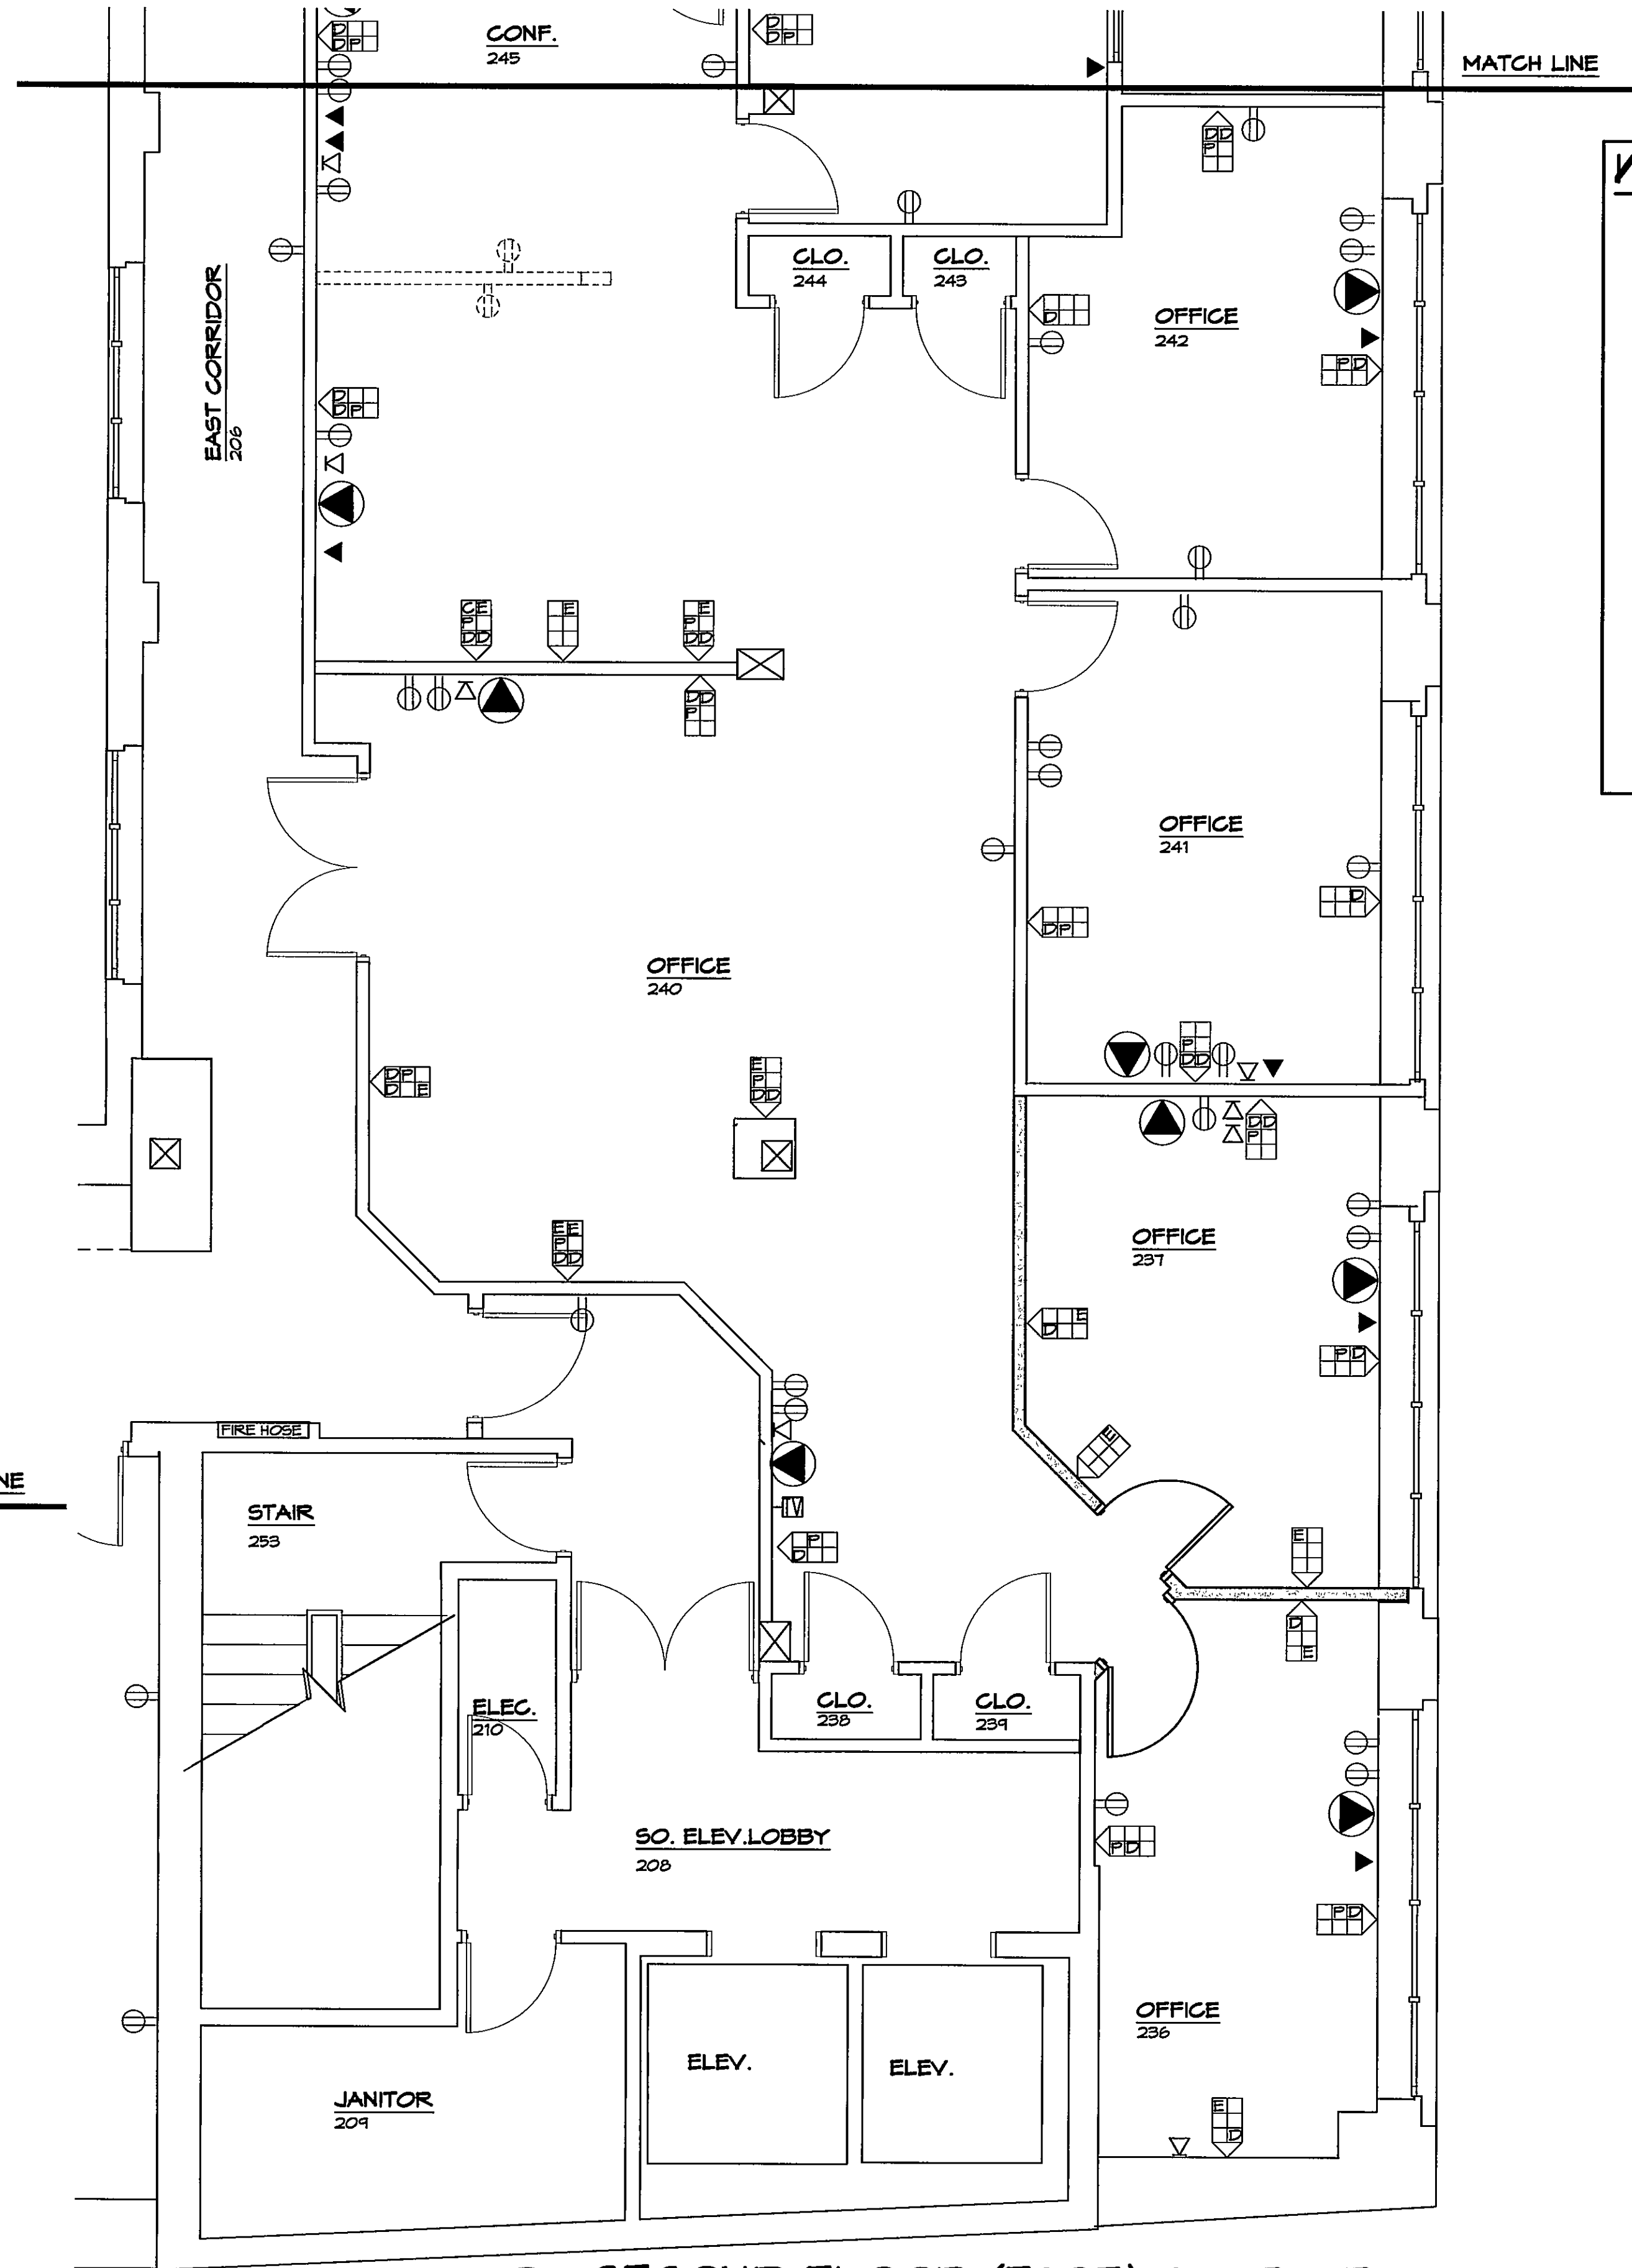

E1-5.1
E1-3
SECOND FLOOR (EAST) CONTINUED
SCALE: 1/4" = 1'-0"

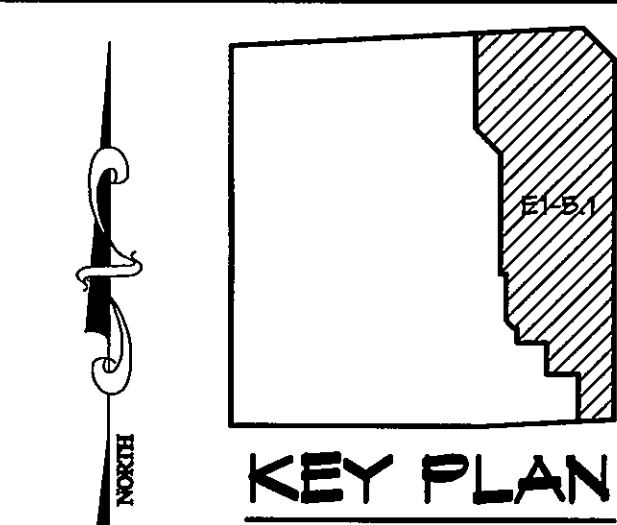

WIRING LEGEND

- | | |
|-----------|------------|
| DATA | WALL |
| TELEPHONE | DATA |
| COAXIAL | TELEPHONE |
| CABLE | ELECTRICAL |
| | REC. |
- ON NEW WALLS, PROVIDE 1 BOX FOR EACH OUTLET NOTED. EXTEND A 3/4" CONDUIT FROM THE BOX 6" INTO CEILING WITH A SWEEP 90, TERMINATED IN A BUSHING. WIRING TO BE PROVIDED BY OWNER
- PROPOSED KMC/COX CONDUITS
 - ⊖ EXISTING RECEPTACLE TO REMAIN
 - ⋈ EXISTING PHONE JACK
 - ⦿ EXISTING DATA PORT
 - Ⓛ EXISTING TOKEN RING PORT

DATE:	March 18, 2005
REVISIONS	

HUGHES ASSOCIATES ARCHITECTS
Architecture • Planning • Consulting

656 ELM AVENUE, S.W.
P.O. BOX 1034
ROANOKE, VIRGINIA 24005-1034

TEL (540) 342-4002
FAX (540) 342-2060
www.HughesArchitects.com

ALTERATIONS TO
**WESTERN VIRGINIA
WATER AUTHORITY
COULTER BUILDING**
601 South Jefferson Street Roanoke, Virginia

ENLARGED
FLOOR
PLAN
(TELEPHONE,
DATA,
POWER &
ELECTRICAL)

PHASE I

COMMISSION No.
04102
SHEET
E1-5

No. 12 OF 19
COPYRIGHT 2005
HUGHES ASSOCIATES ARCHITECTS
A PROFESSIONAL CORPORATION