
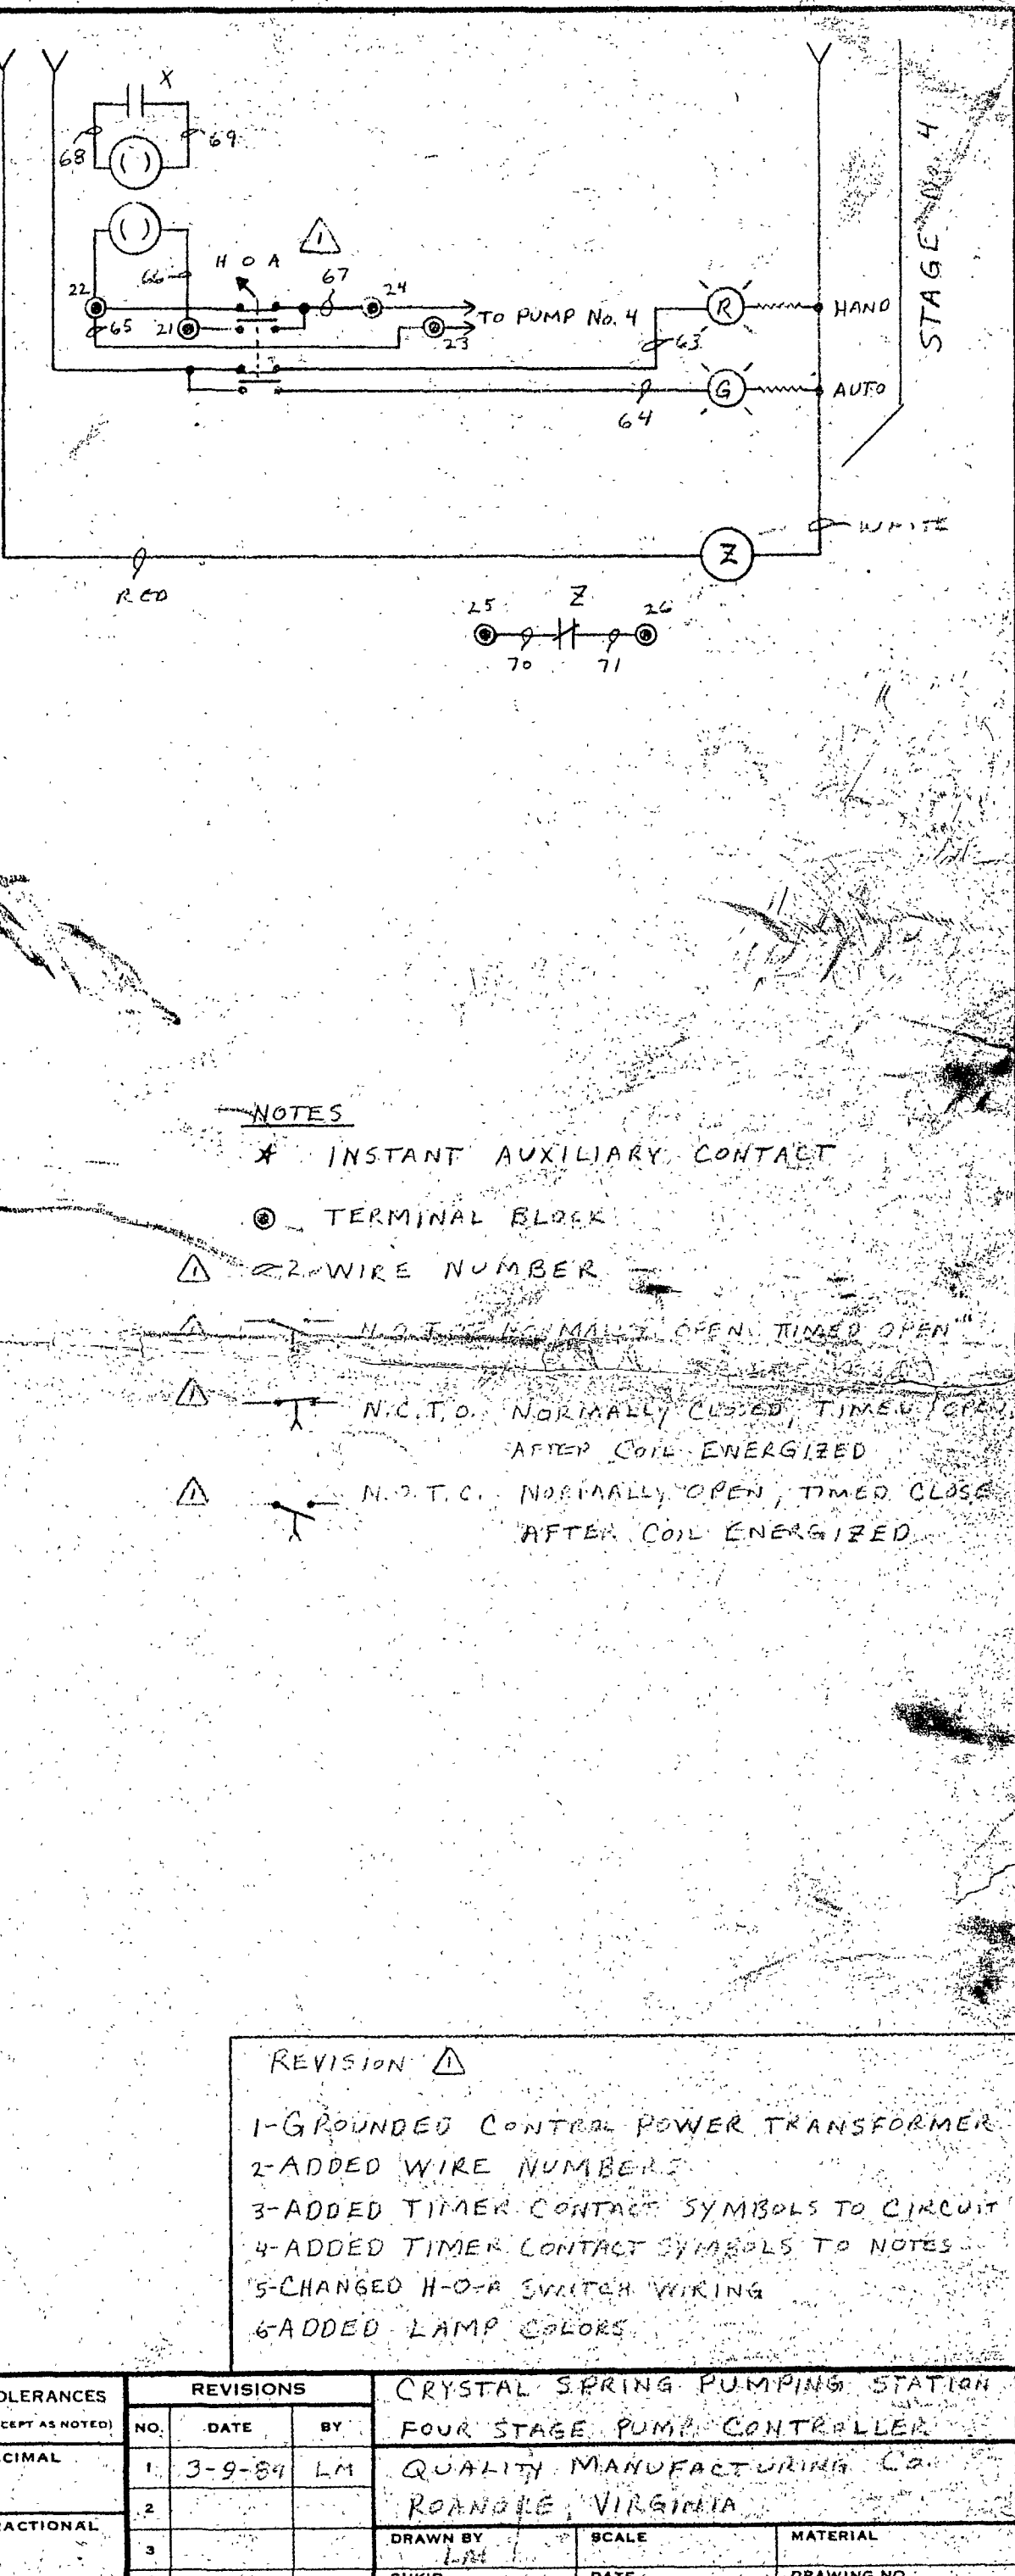
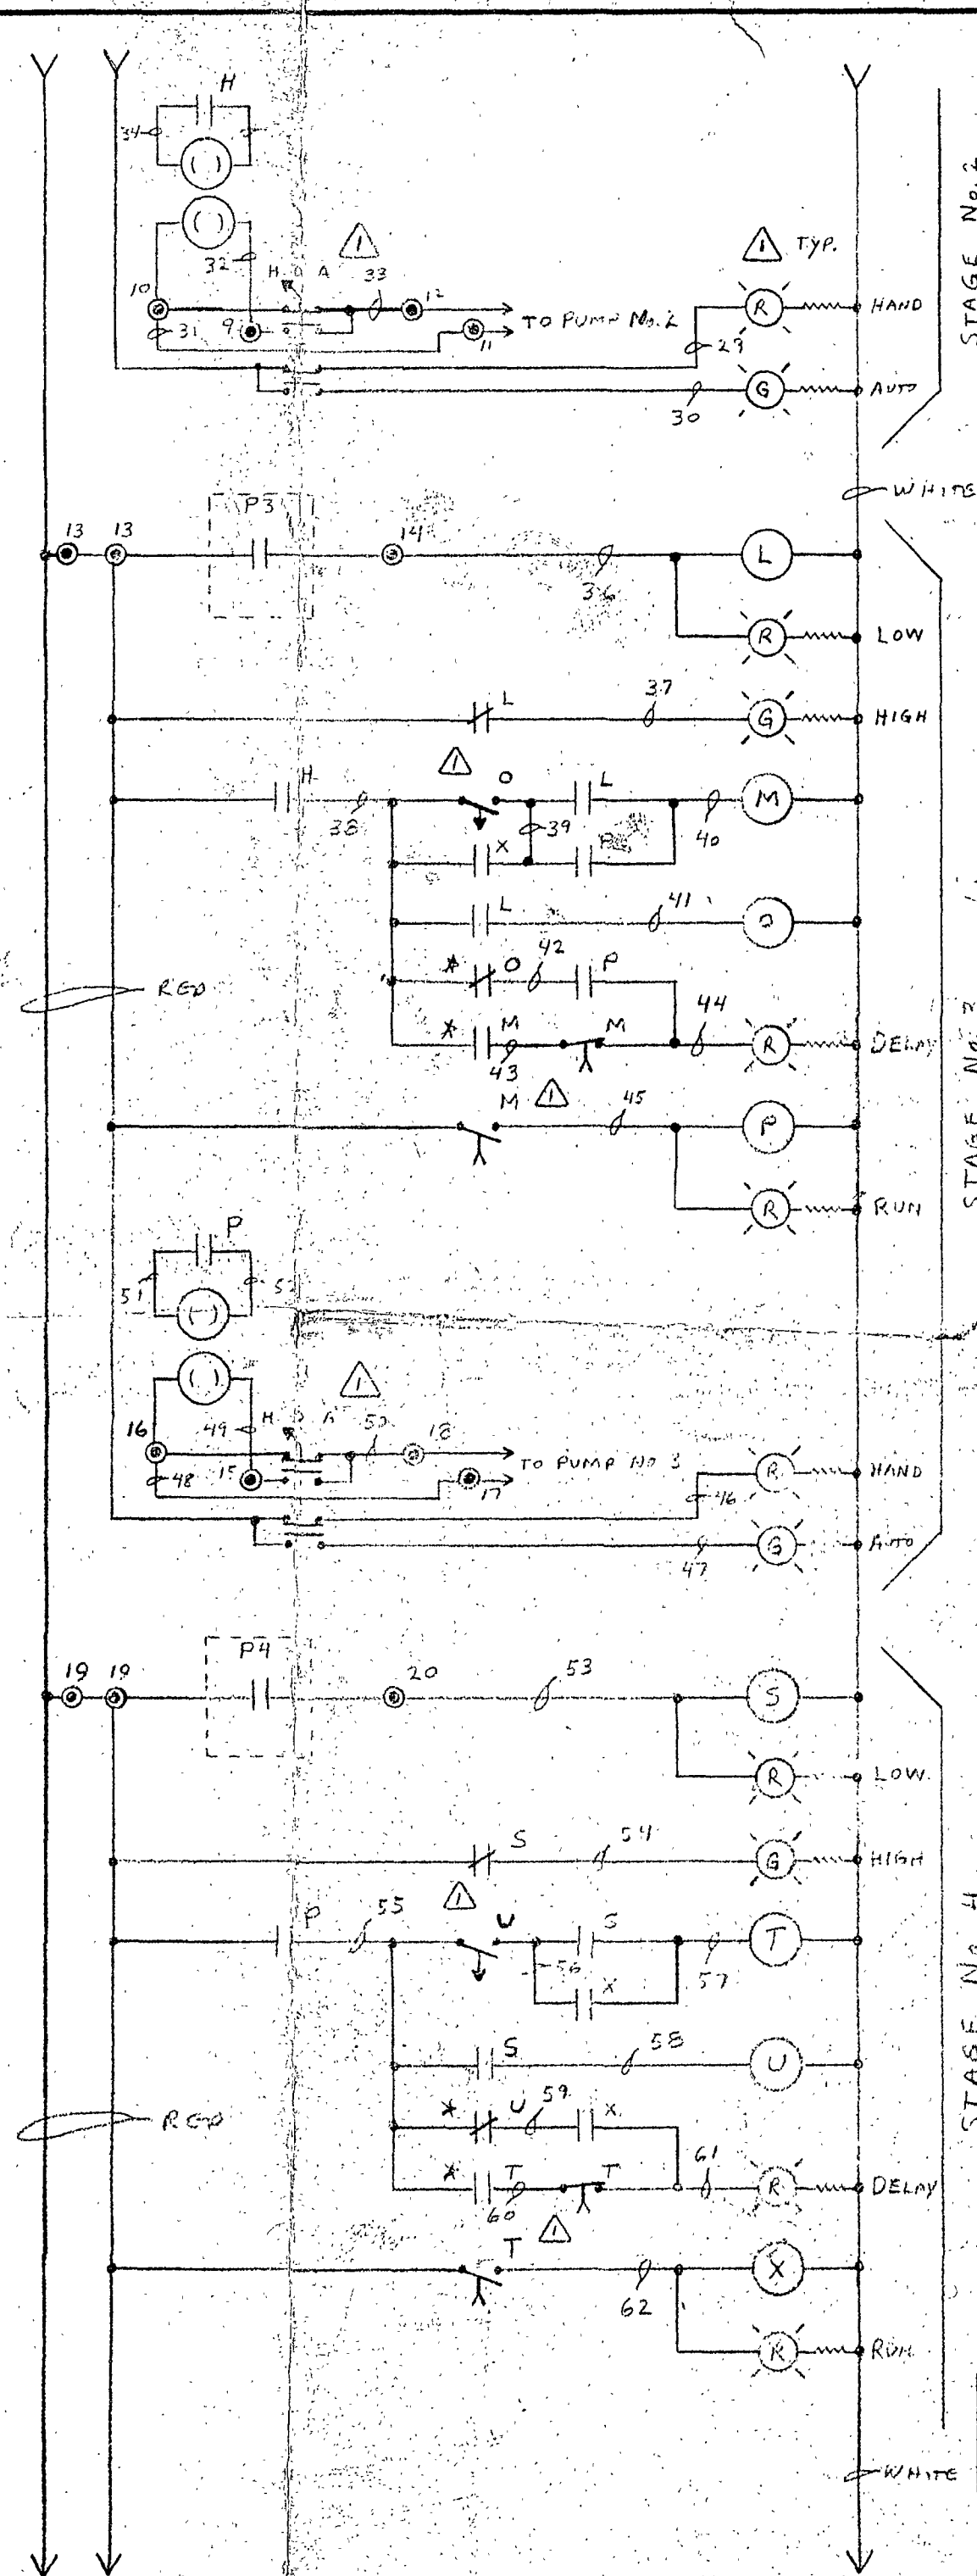


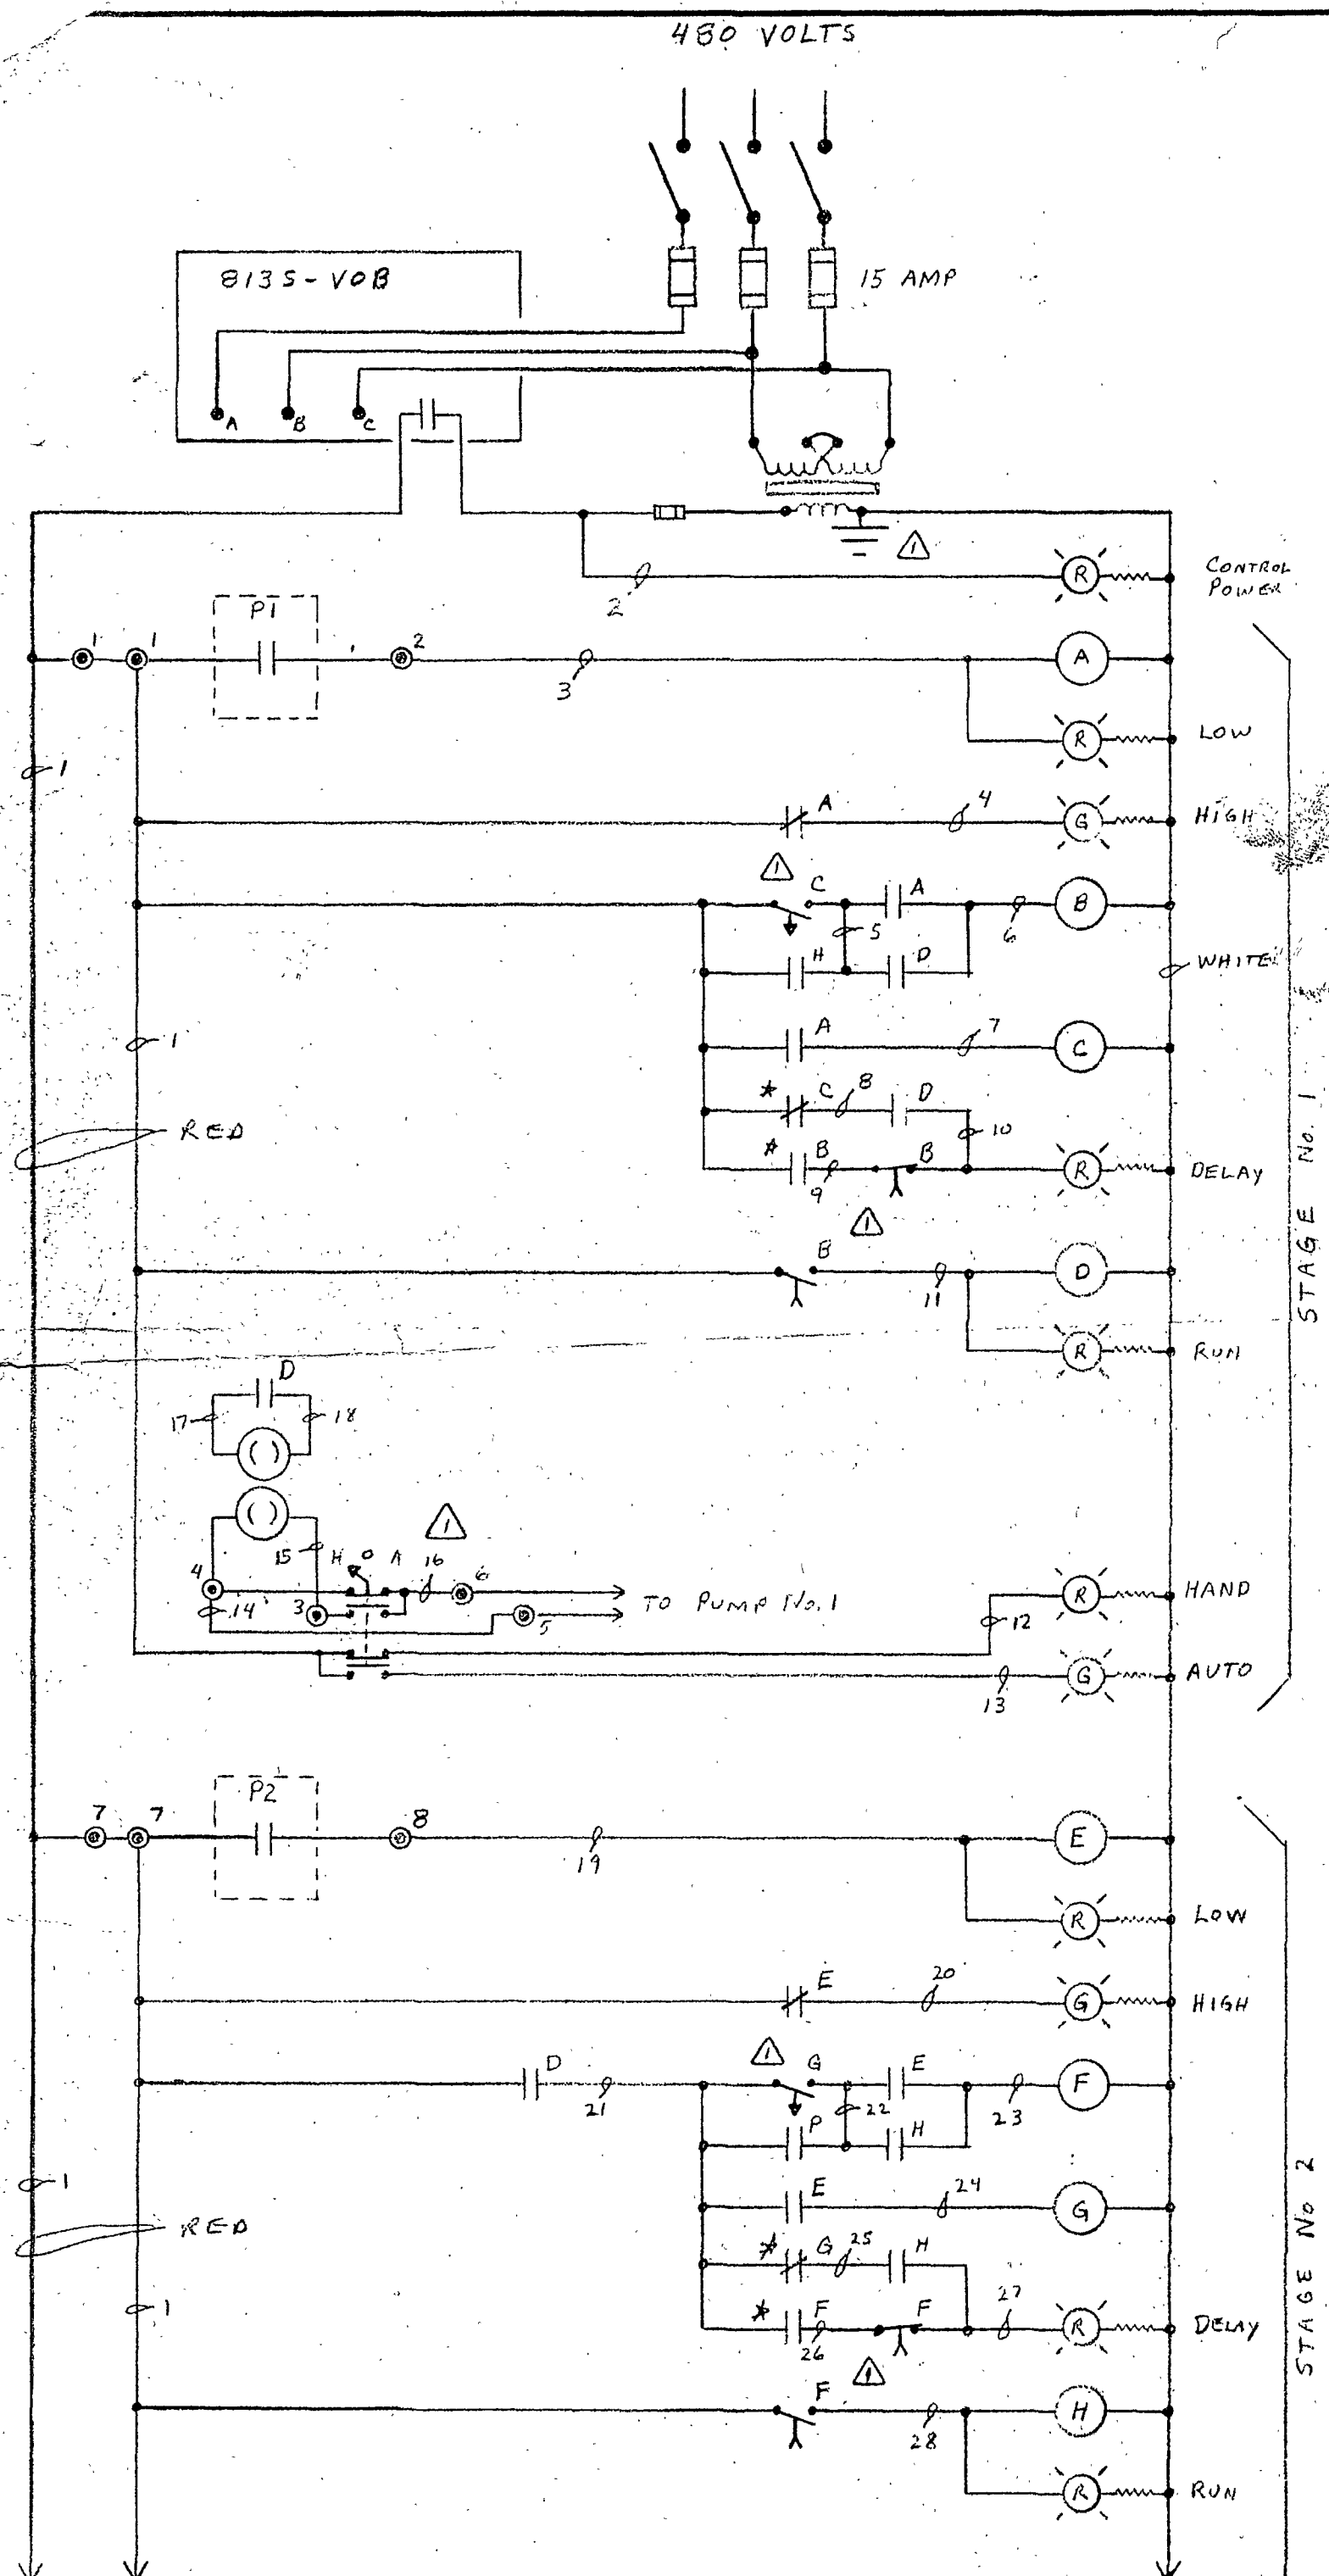

- NOTES
- * INSTANT AUXILIARY CONTACT
 - TERMINAL BLOCK
 - △ WIRE NUMBER
 - N.C.T.O. NORMALLY CLOSED, TIMED OPEN AFTER COIL ENERGIZED
 - N.O.T.C. NORMALLY OPEN, TIMED CLOSE AFTER COIL ENERGIZED

REVISION △

- 1-GROUNDED CONTROL POWER TRANSFORMER
- 2-ADDED WIRE NUMBERS
- 3-ADDED TIMER CONTACT SYMBOLS TO CIRCUIT
- 4-ADDED TIMER CONTACT SYMBOLS TO NOTES
- 5-CHANGED H-O-A SWITCH WIRING
- 6-ADDED LAMP COLORS

TOLERANCES (EXCEPT AS NOTED)			REVISIONS			CRYSTAL SPRING PUMPING STATION		
DECIMAL	FRACTIONAL	ANGULAR	NO.	DATE	BY	FOUR STAGE PUMP CONTROLLER		
±	±	±	1	3-9-84	LM	QUALITY MANUFACTURING CO.		
±	±	±	2			ROANOKE, VIRGINIA		
±	±	±	3			DRAWN BY	SCALE	MATERIAL
±	±	±	4			CHK'D	DATE	DRAWING NO.
±	±	±	5			TRACED	APP'D	