

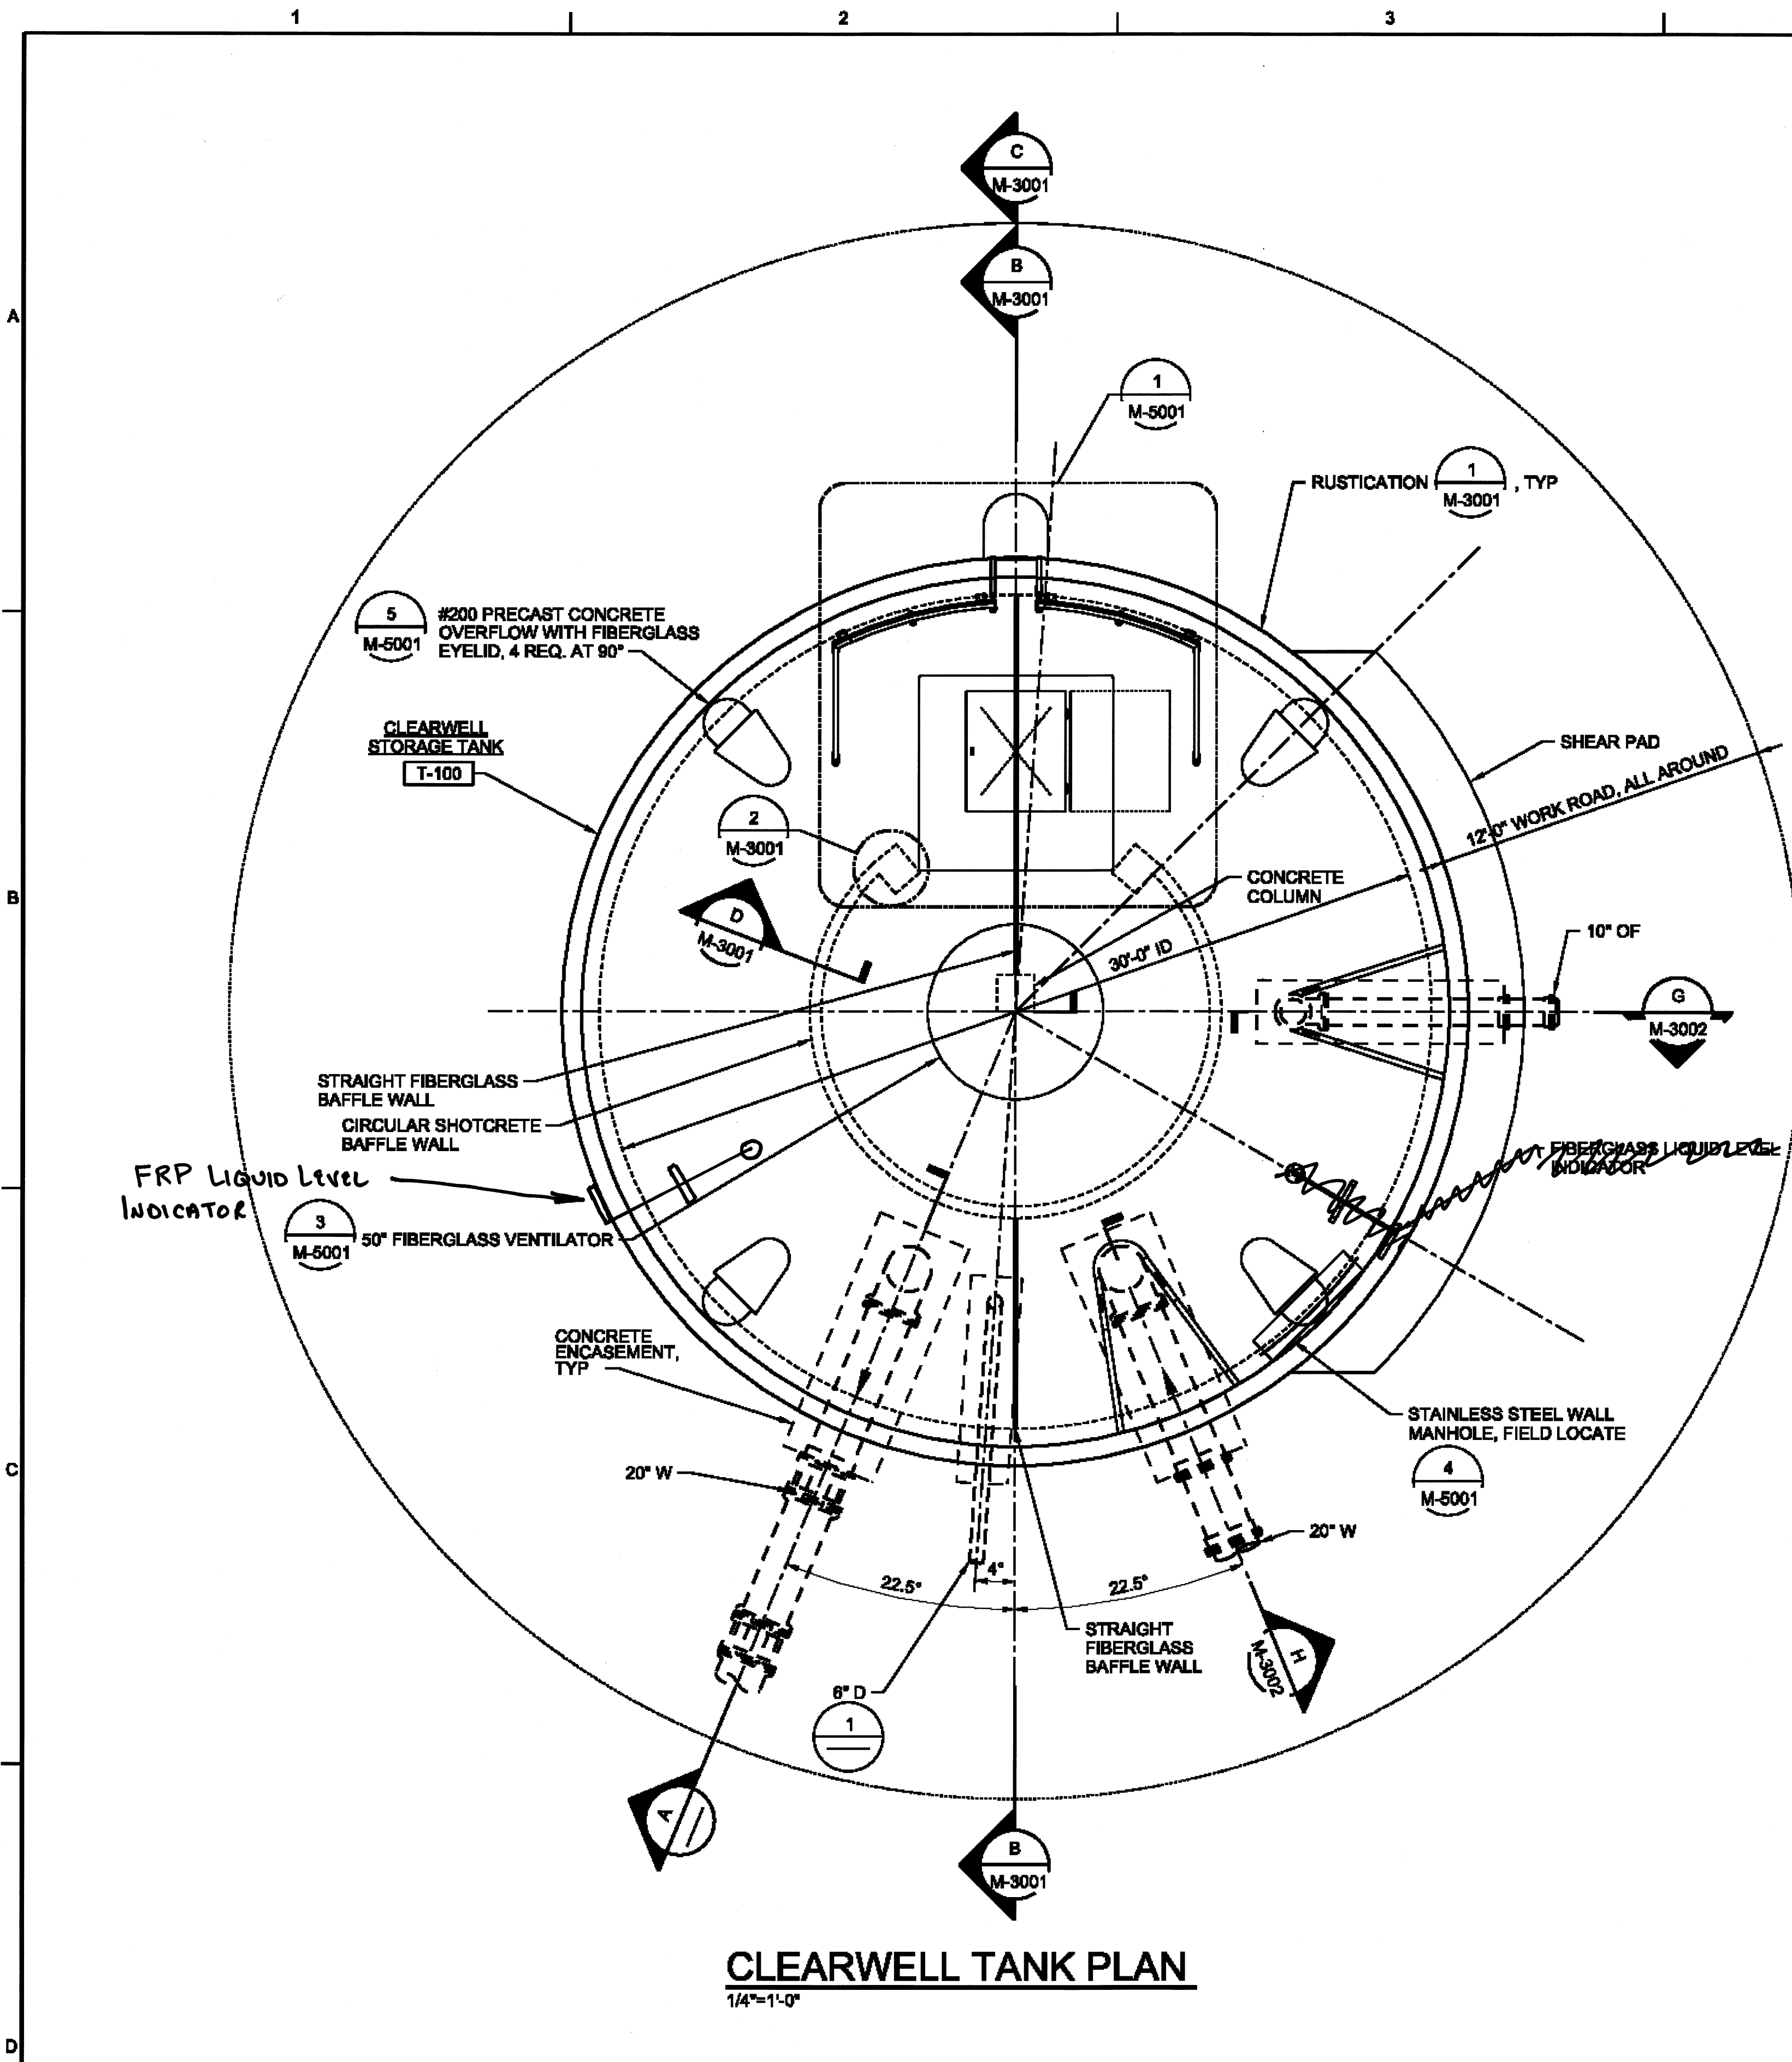


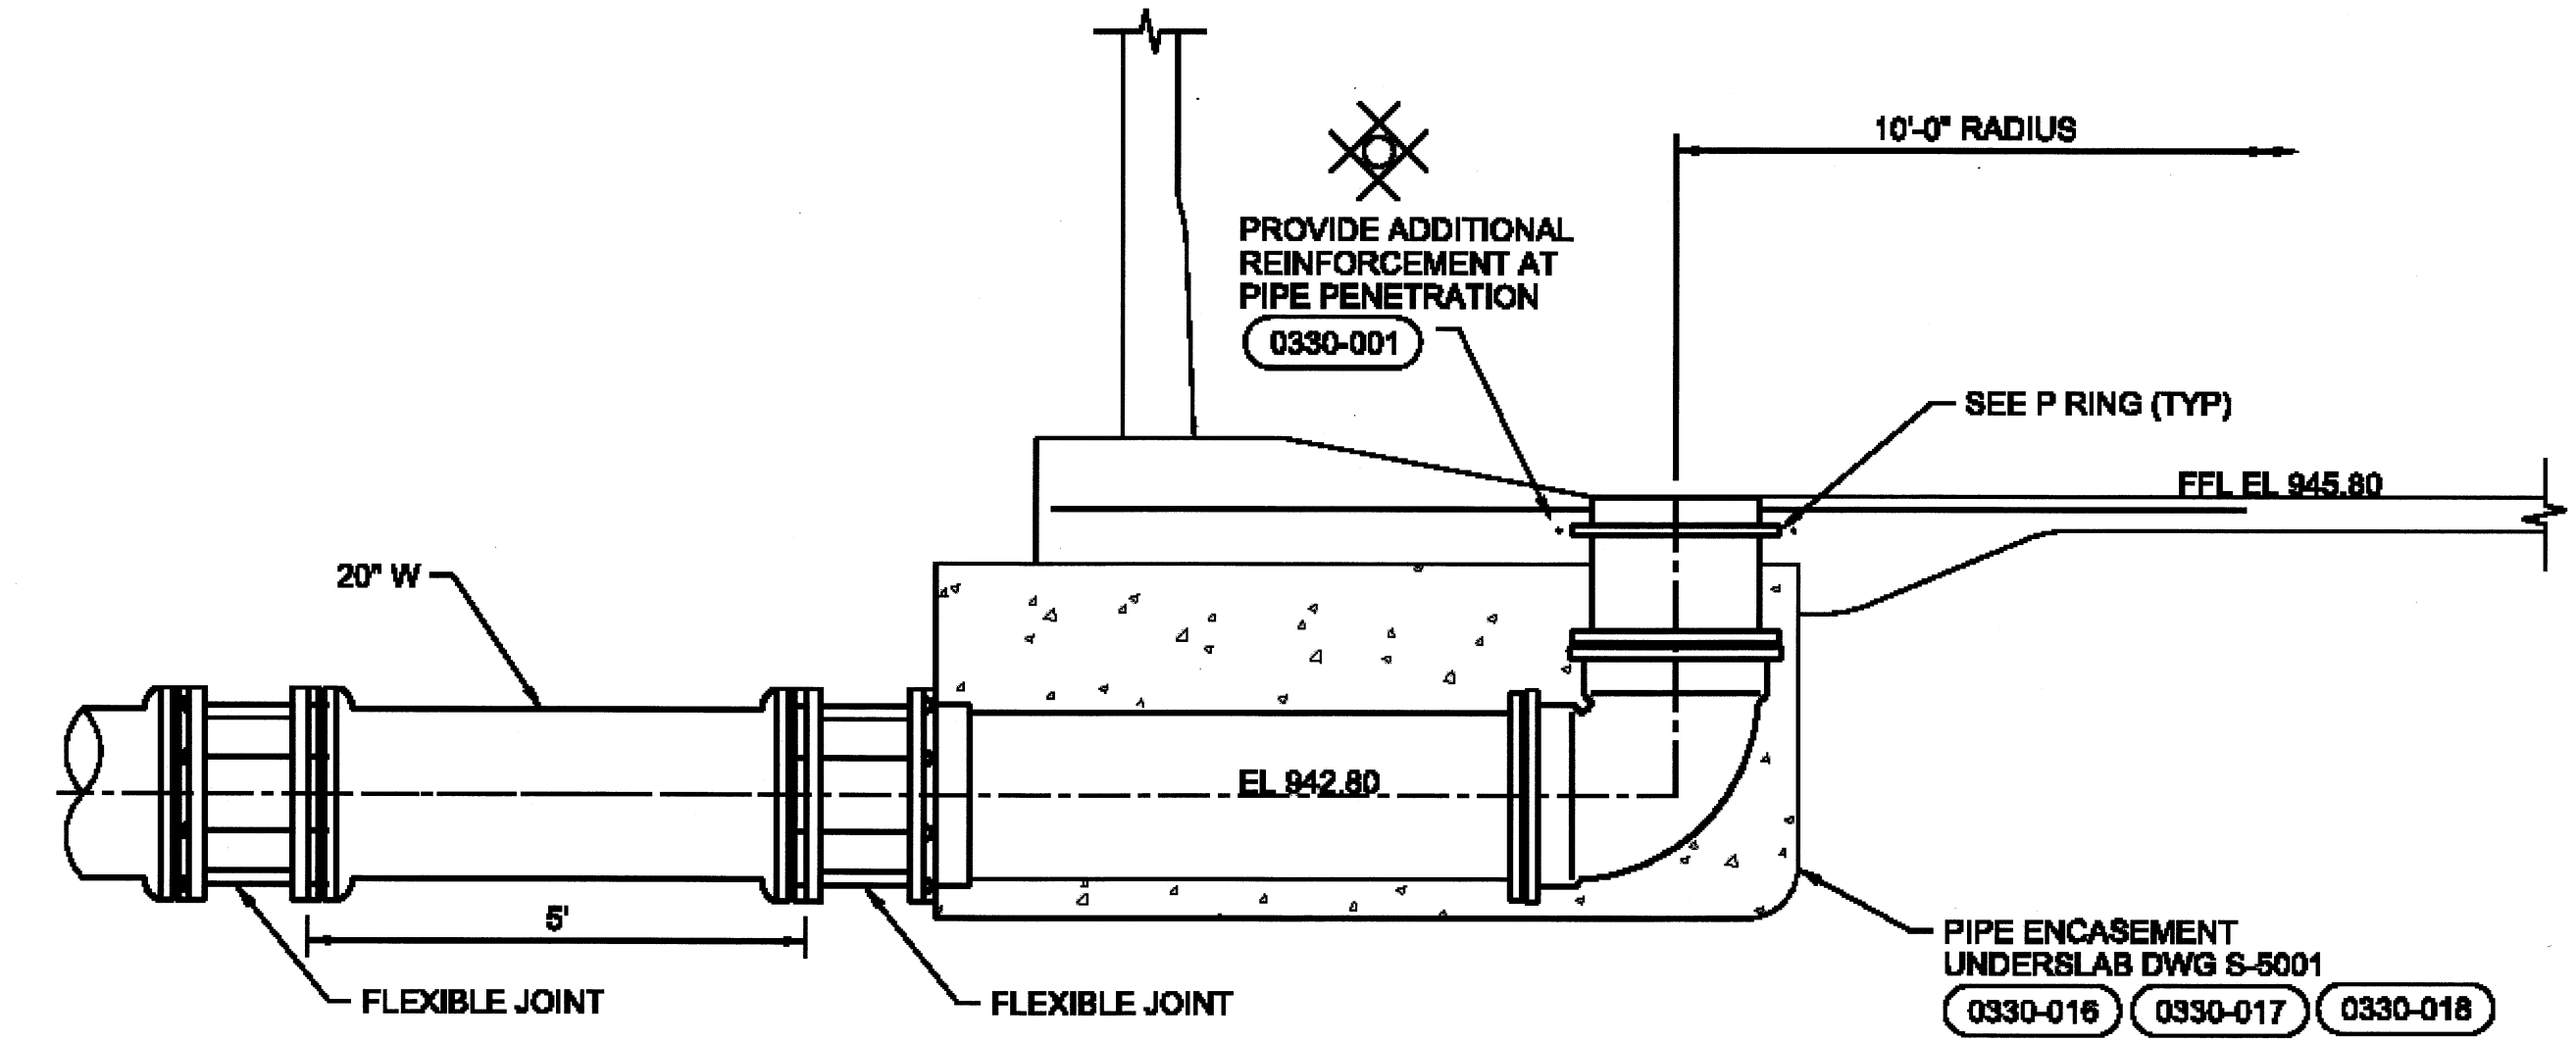

CLEARWELL TANK PLAN
1/4"=1'-0"

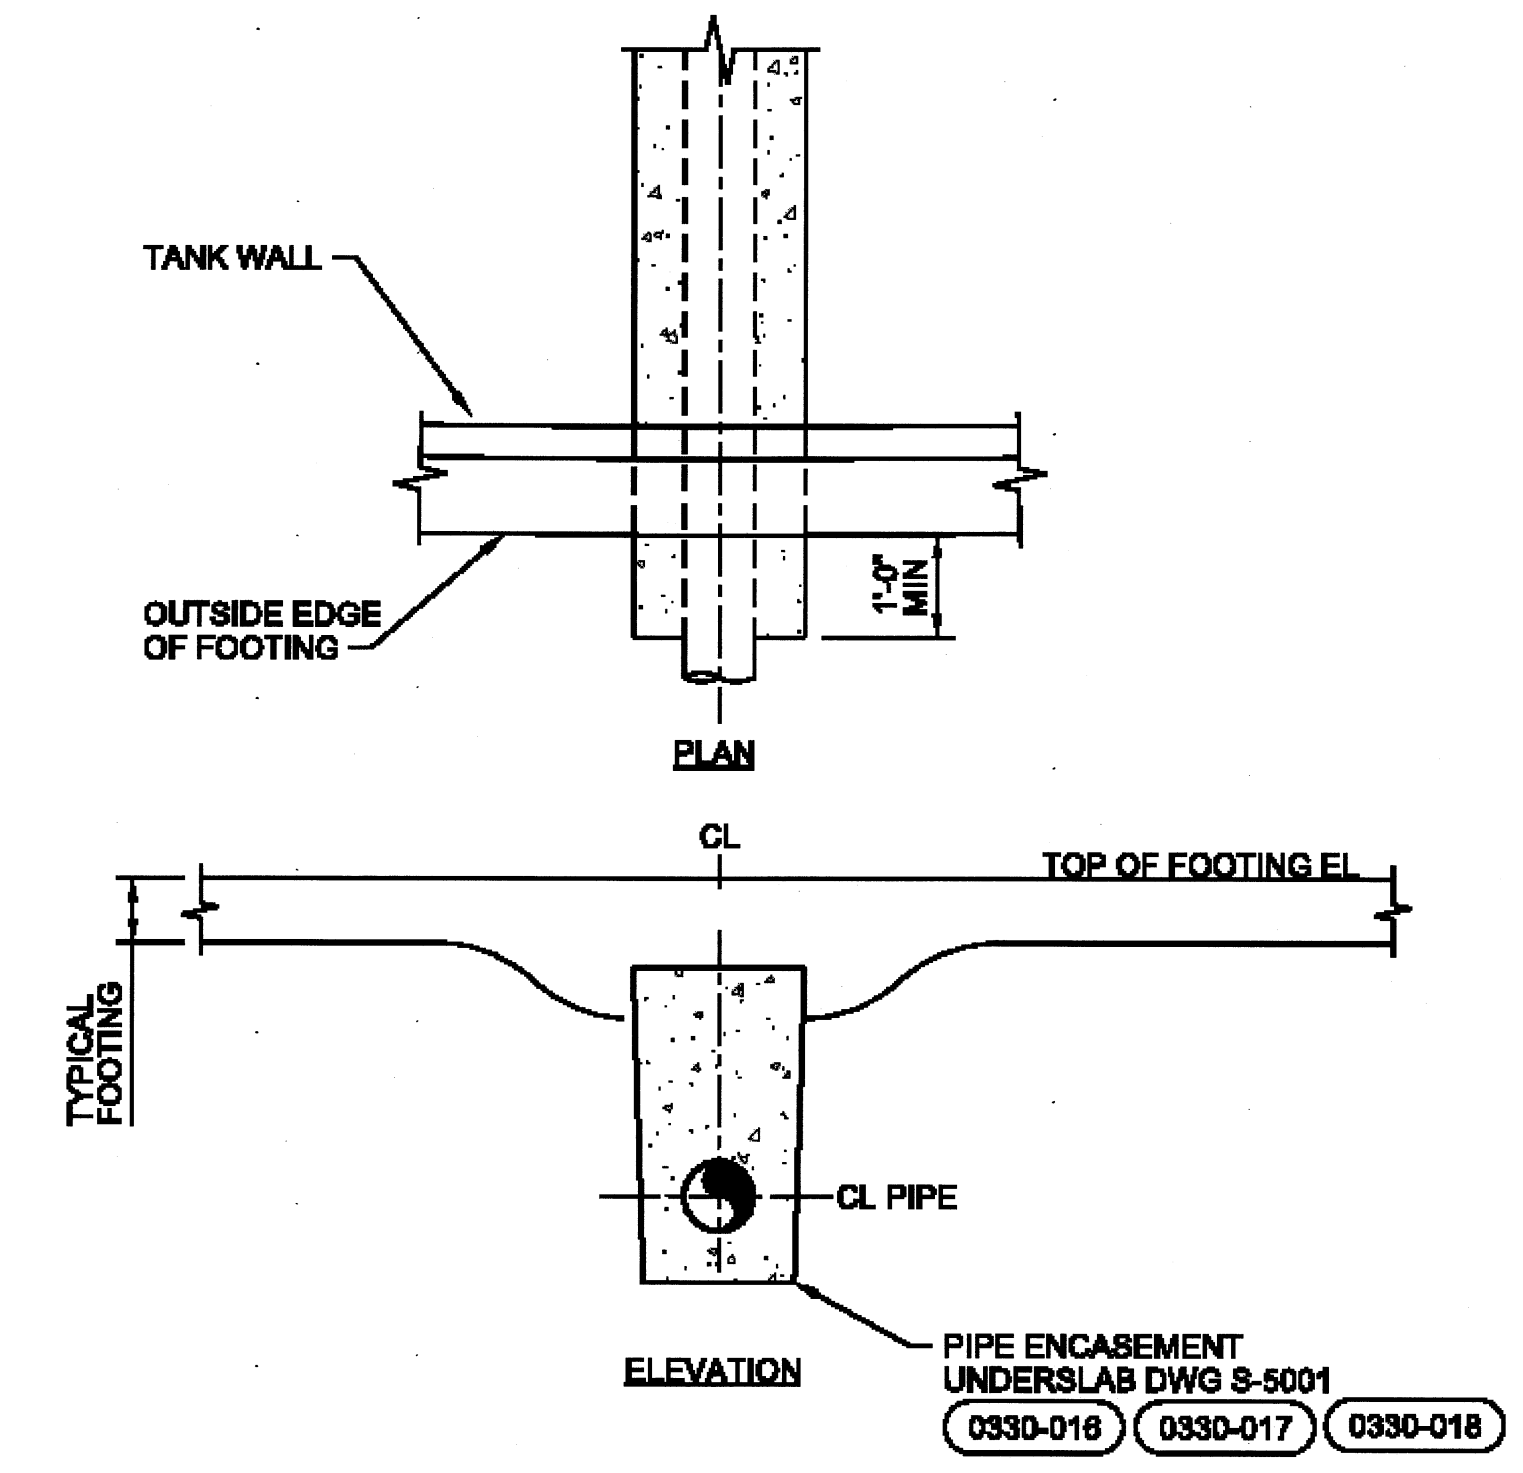

A PIPE ENCASEMENT
1/2"=1'-0"

GENERAL CLEARWELL TANK NOTES

- SEE DWG S-0001, S-0002, S-0003 FOR GENERAL NOTES, BASIS OF DESIGN AND SPECIAL INSPECTION REQUIREMENT.
- SEE SPECIFICATION FOR SCOPE OF WORK FOR TANK MANUFACTURER.
- COORDINATE SIZE AND LOCATION OF ALL PIPE PENETRATIONS AND OPENINGS WITH PROCESS AND ELECTRICAL.

CH2MHILL

PROCESS MECHANICAL
CLEARWELL STORAGE TANK
PLAN AND DETAILS

CRYSTAL SPRING WATER TREATMENT PLANT
CLEARWELL REPLACEMENT
WESTERN VIRGINIA WATER AUTHORITY
CITY OF ROANOKE, VIRGINIA

NO.	DATE	DR	REVISION	BY	APVD	JALLEN

VERIFY SCALE

BAR IS ONE INCH ON ORIGINAL DRAWING.

0 1'

DATE: JUNE 2014

PROJ: 475481

DWG: M-2001

SHEET: 17 of 37

RELEASE OF DOCUMENTS: THIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF CH2M HILL AND IS NOT TO BE USED, IN WHOLE OR IN PART, FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF CH2M HILL. ©CH2M HILL 2013. ALL RIGHTS RESERVED.