




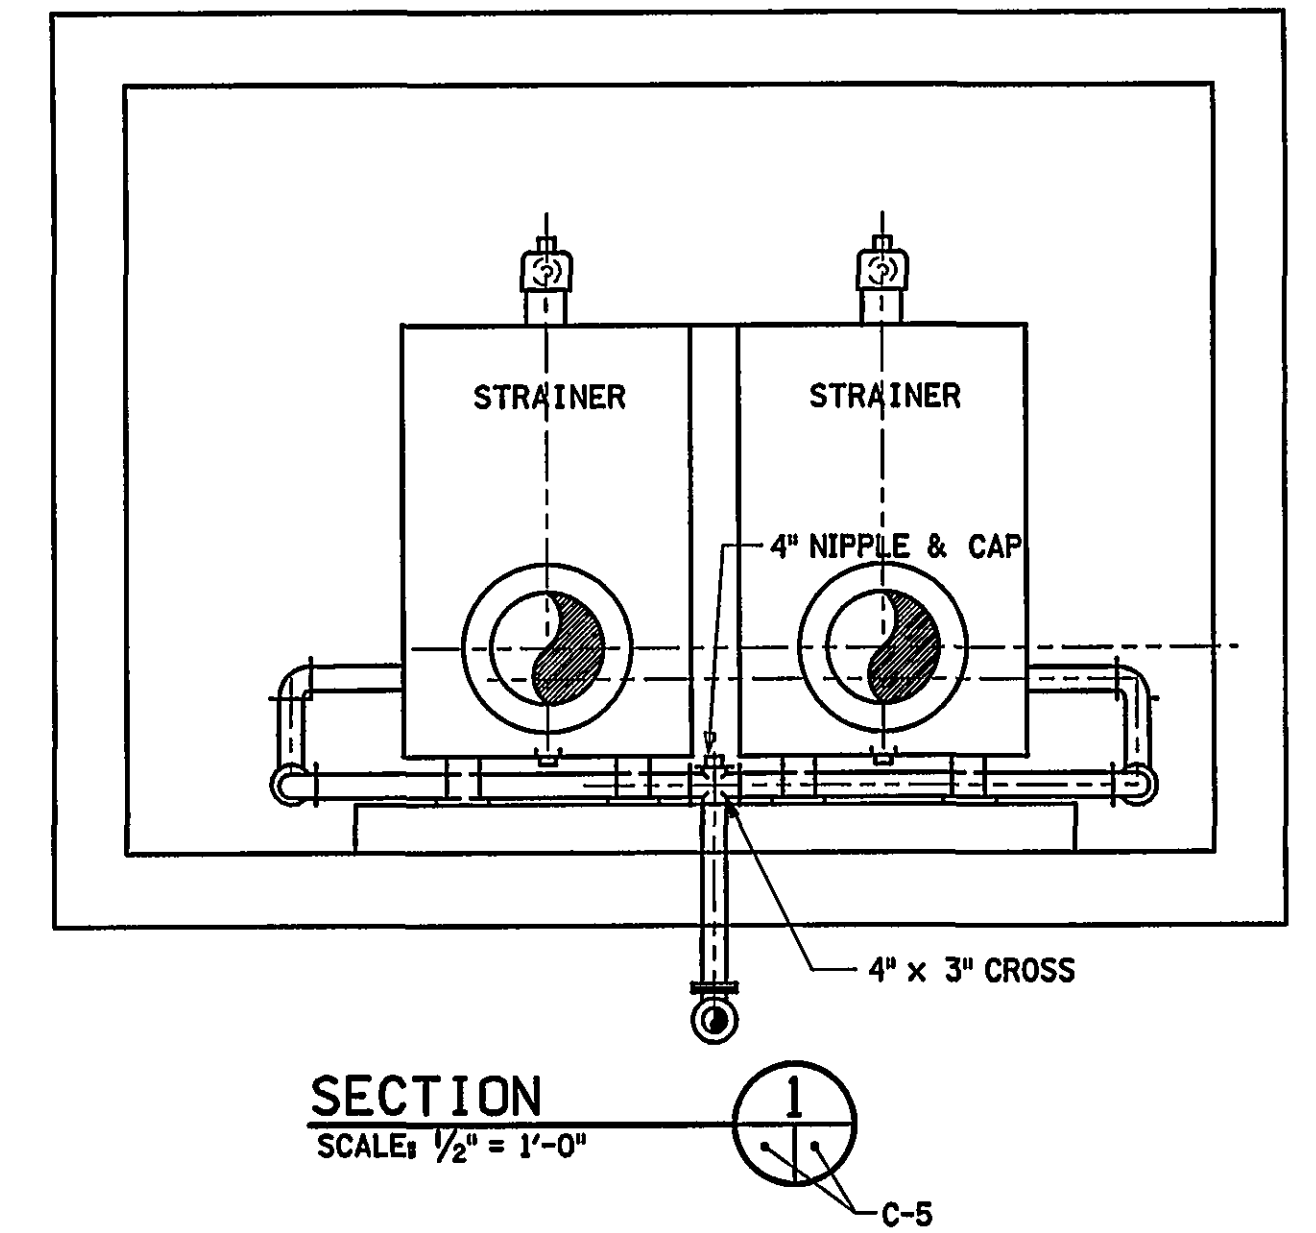


SECTION
SCALE: 1/2" = 1'-

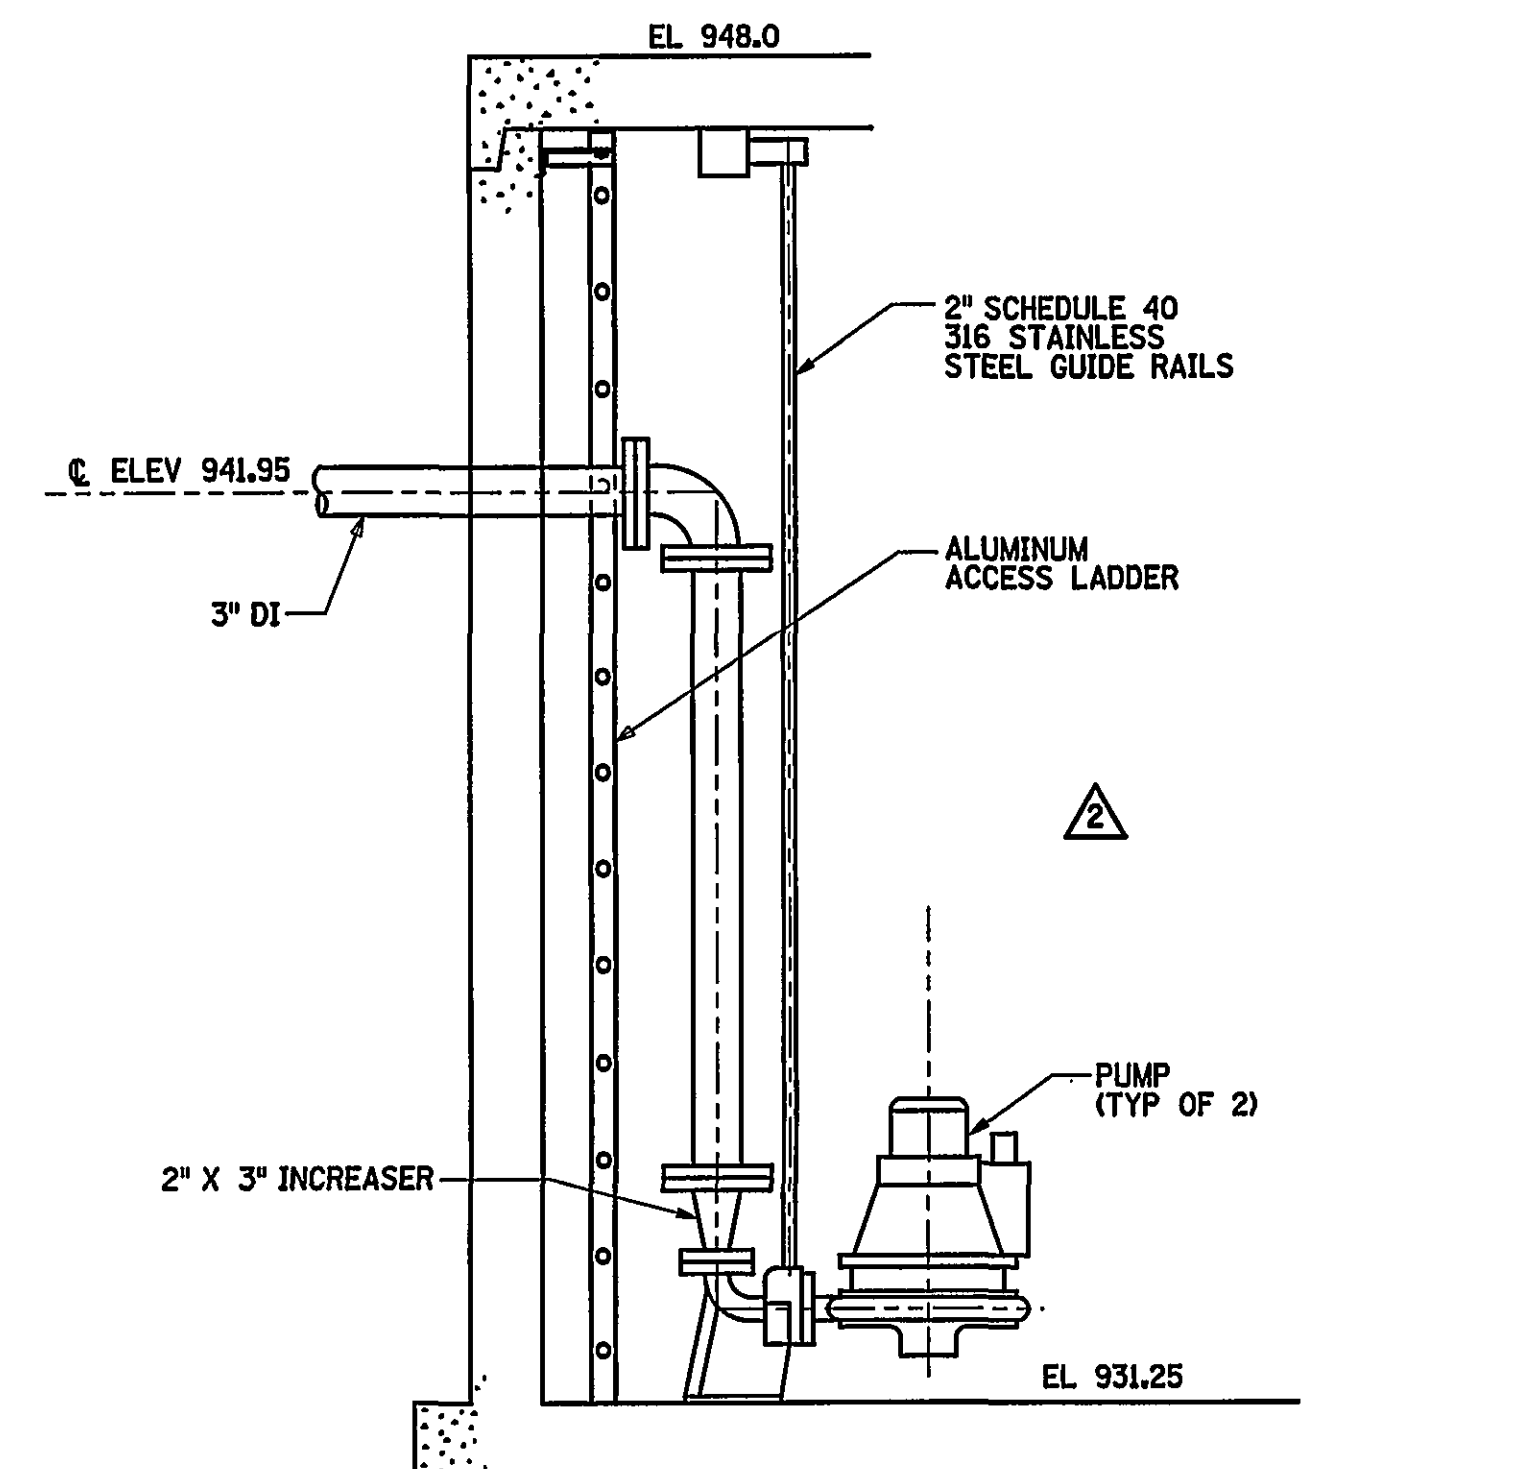


ELEVATION-HEAT EXCHANGER PUMPS
NOT TO SCALE

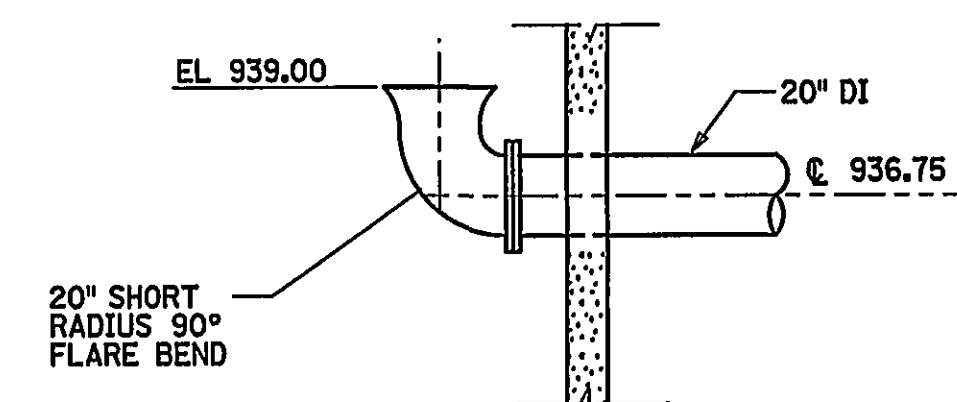

OVERFLOW DETAIL
SCALE: 1/4"=1'-0"

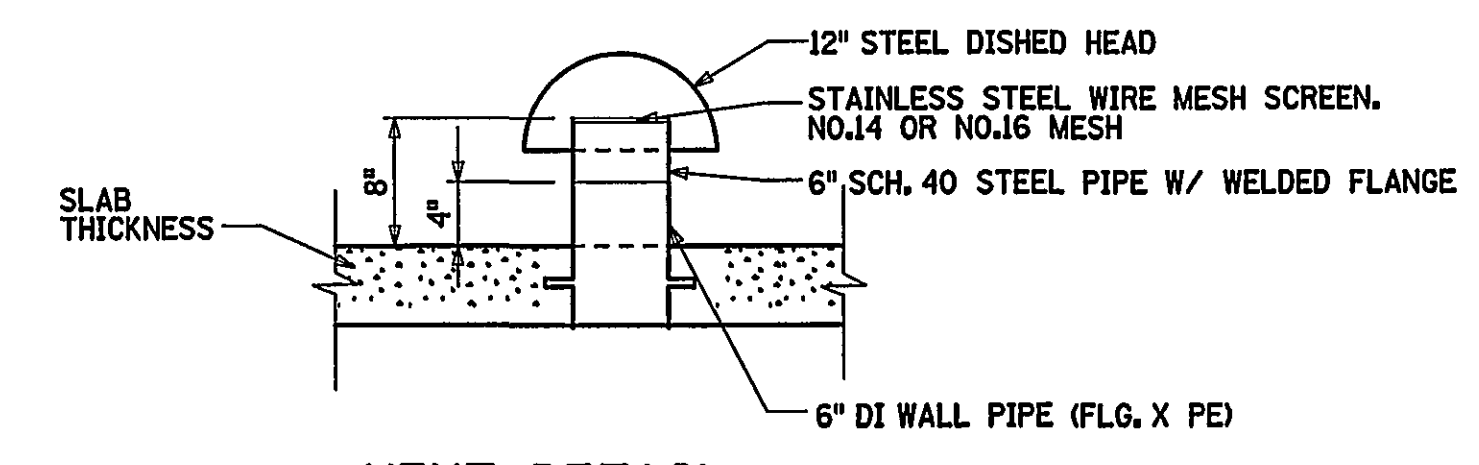

VENT DETAIL
SCALE: 1"=1'-0"

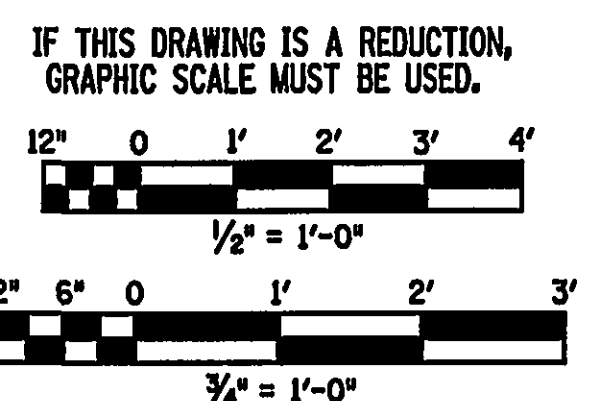

DESIGNED JLW	DRAWN JLW	PROJECT CRYSTAL SPRING WATER TREATMENT PLANT FOR THE CITY OF ROANOKE, VIRGINIA		
CHECKED MKJ	REVIEWED			
COMM. NO. 200171.01		REFERENCE CIVIL		
CADD NO. 20017IC04.DGN		TITLE PLAN AND SECTION PUMP STATION & STRAINER VAULT		
DATE AUG 26, 2001	DWG. NO. C-5	SHEET NO. 7 OF 72	REV.	