


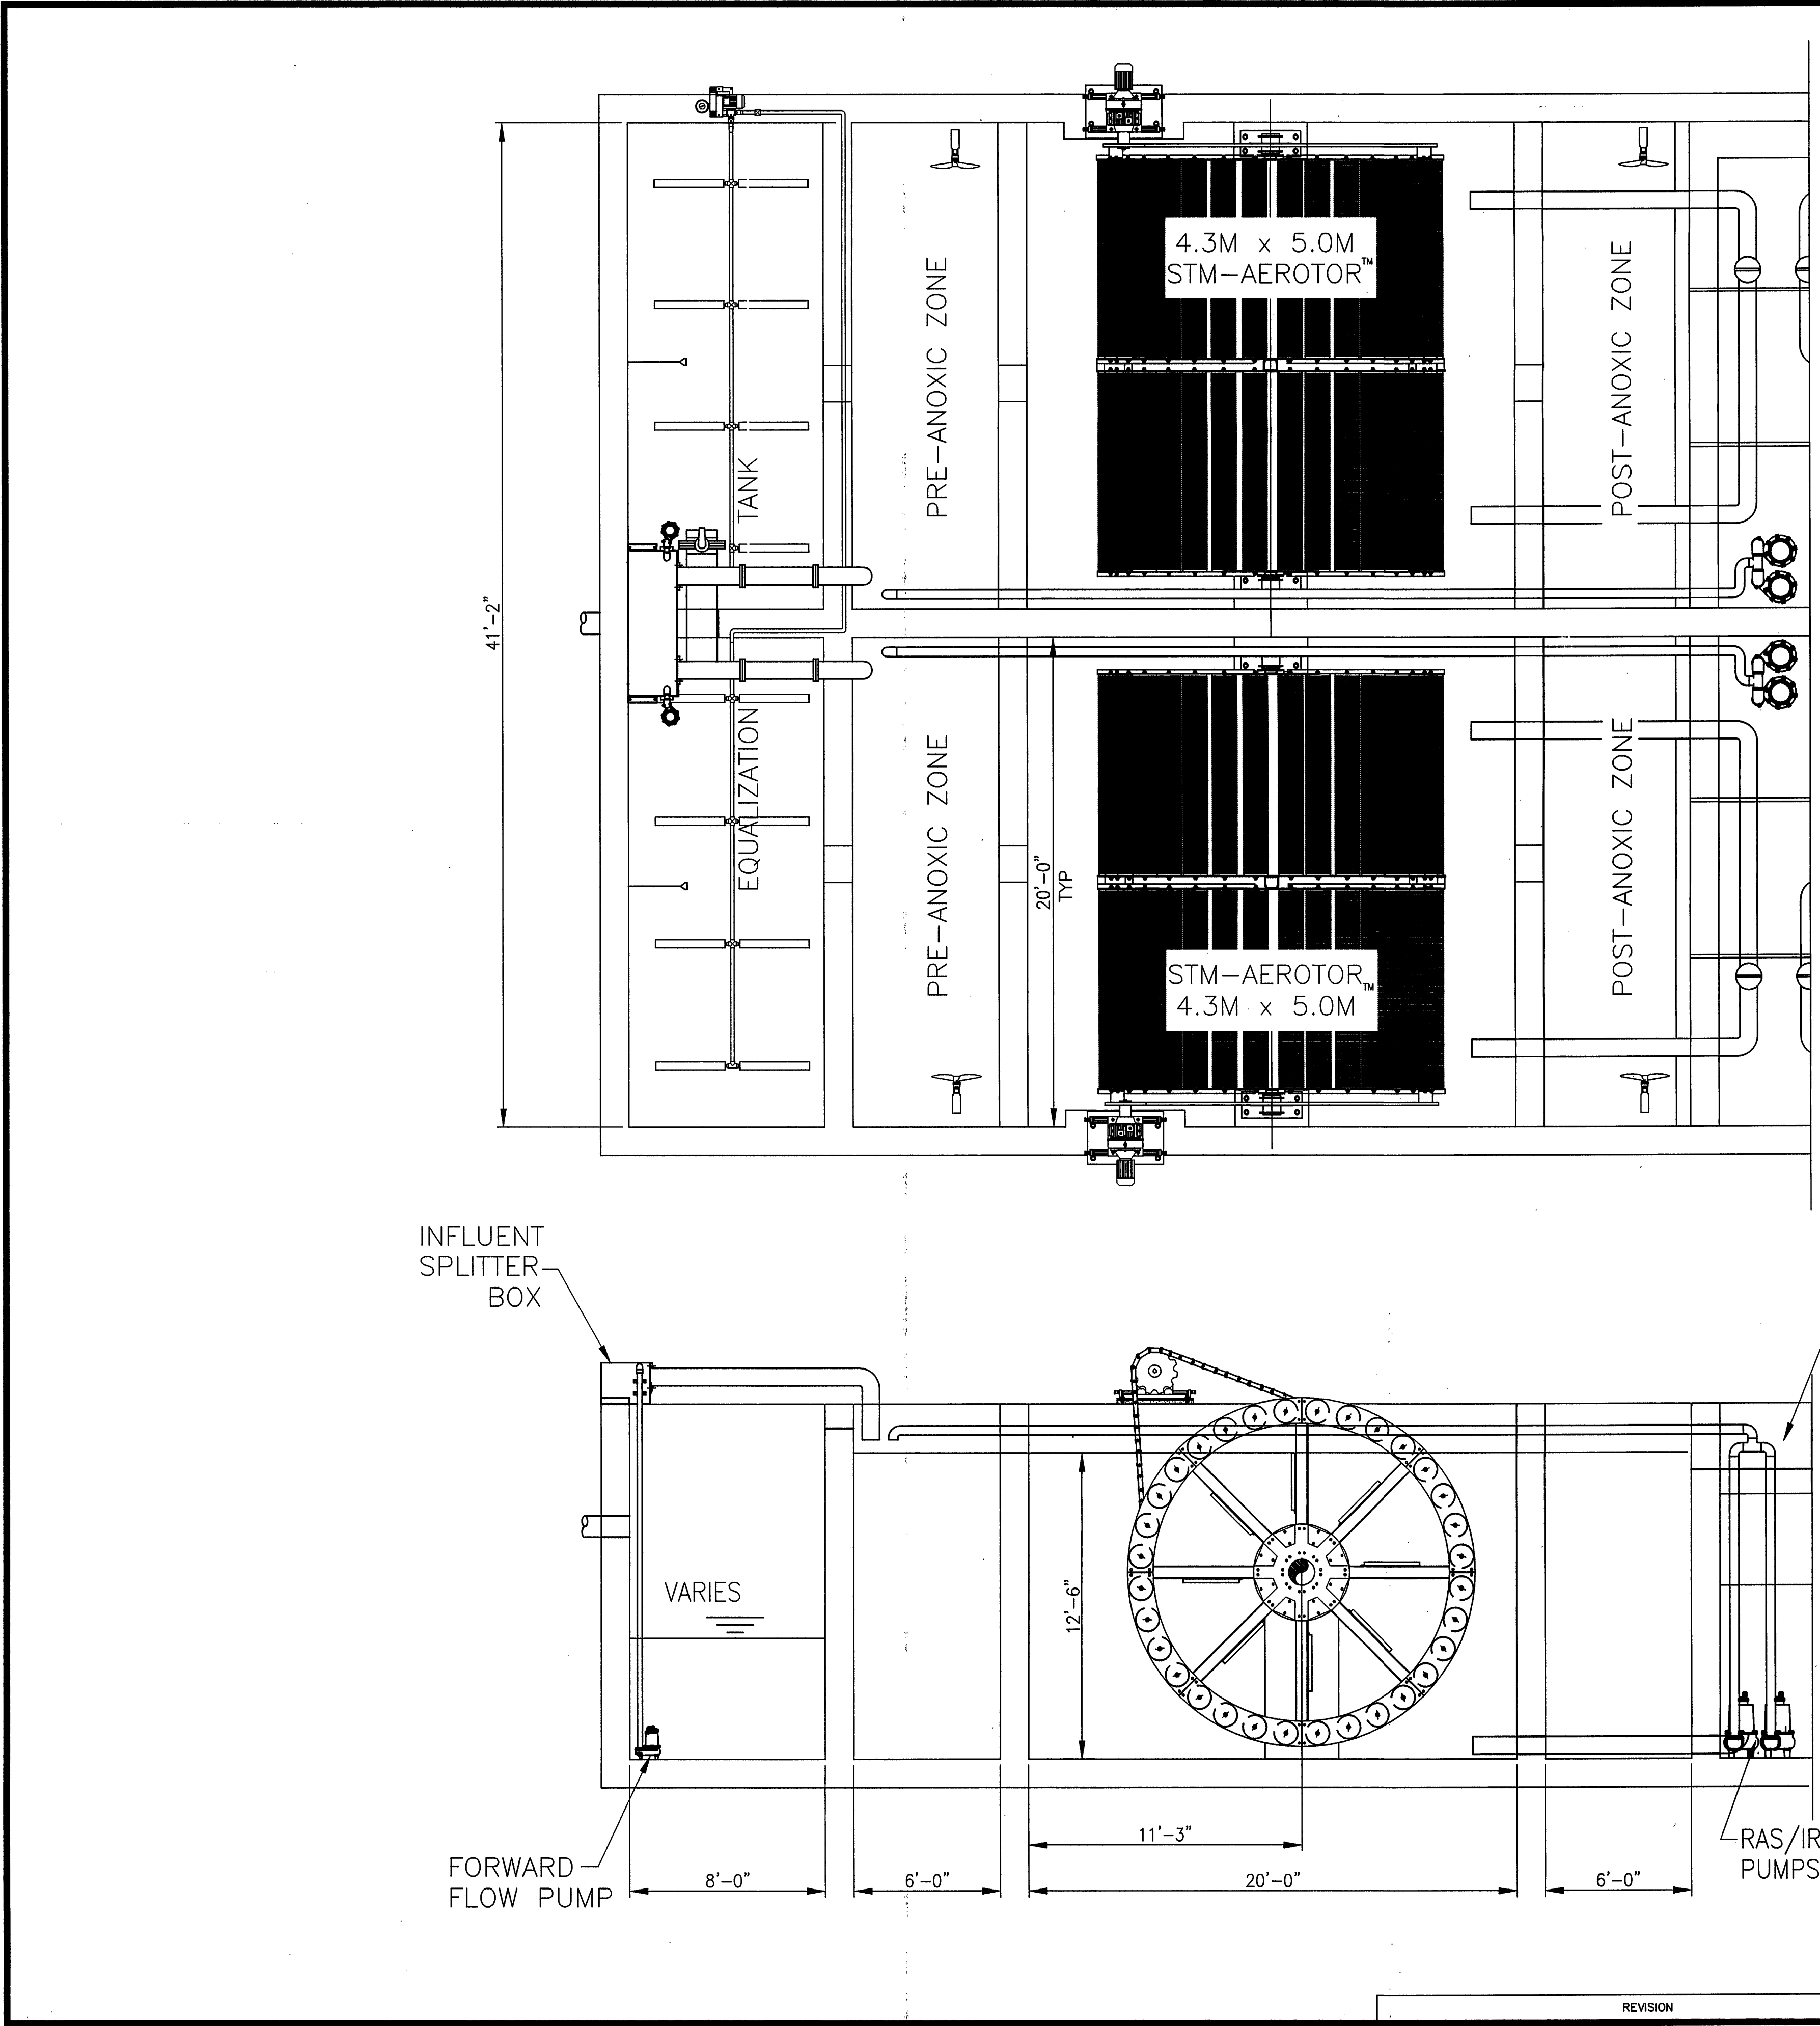

NOTE: FOR ALTERNATIVE "A" WORK, CONTRACTOR SHALL BE REQUIRED TO ALTER TANKAGE DESIGN(S), PIPING, ELECTRICAL WORK, SITE WORK, CHEMICAL FEEDS, AND ANY OTHER WORK TO ACCOMMODATE WESTECH CONFIGURATION AND EQUIPMENT FROM SPEC SECTION 11250A ALTERNATIVE "A". ALL DESIGNS SHALL BE SEALED BY A PROFESSIONAL ENGINEER LICENSED IN THE STATE OF VIRGINIA.

PREPARED FOR: FIN CASTLE, VA									
GENERAL ARRANGEMENT - PACKAGE PLANT									
DESCRIPTION									
MODEL					SIZE				
					NONE 9-04 CH				
DATE	STD. BY	STD. CHKD.	STD. APPVD.	SCALE	DATE	PROJ. BY	PROJ. CHKD.	PROJ. APPVD.	
This drawing is property of WESTECH ENGINEERING, INC. and is transmitted in confidence. Neither receipt nor possession confers or transfers any rights to reproduce, use, or disclose, in whole or in part, data contained herein for any purpose, without the written permission of WESTECH ENGINEERING, INC., Salt Lake City, Utah									
DRAWING NUMBER					PROJECT NUMBER				
D201					046621				
REV.									
Westech									

FINCASTLE WASTEWATER TREATMENT PLANT

WESTECH STM AEROTOR

ALTERNATIVE CONFIGURATION

BOTETOURT COUNTY, VIRGINIA

Issue Date:	Revisions	Date
APRIL, 2005		
Drawn By: CLZ		
Designed By: HAY		
Checked By: SWH		
Date:		

Vertical Scale:
N/A

Horizontal Scale:
N/A

Commission Number:

Sheet No.:
17