




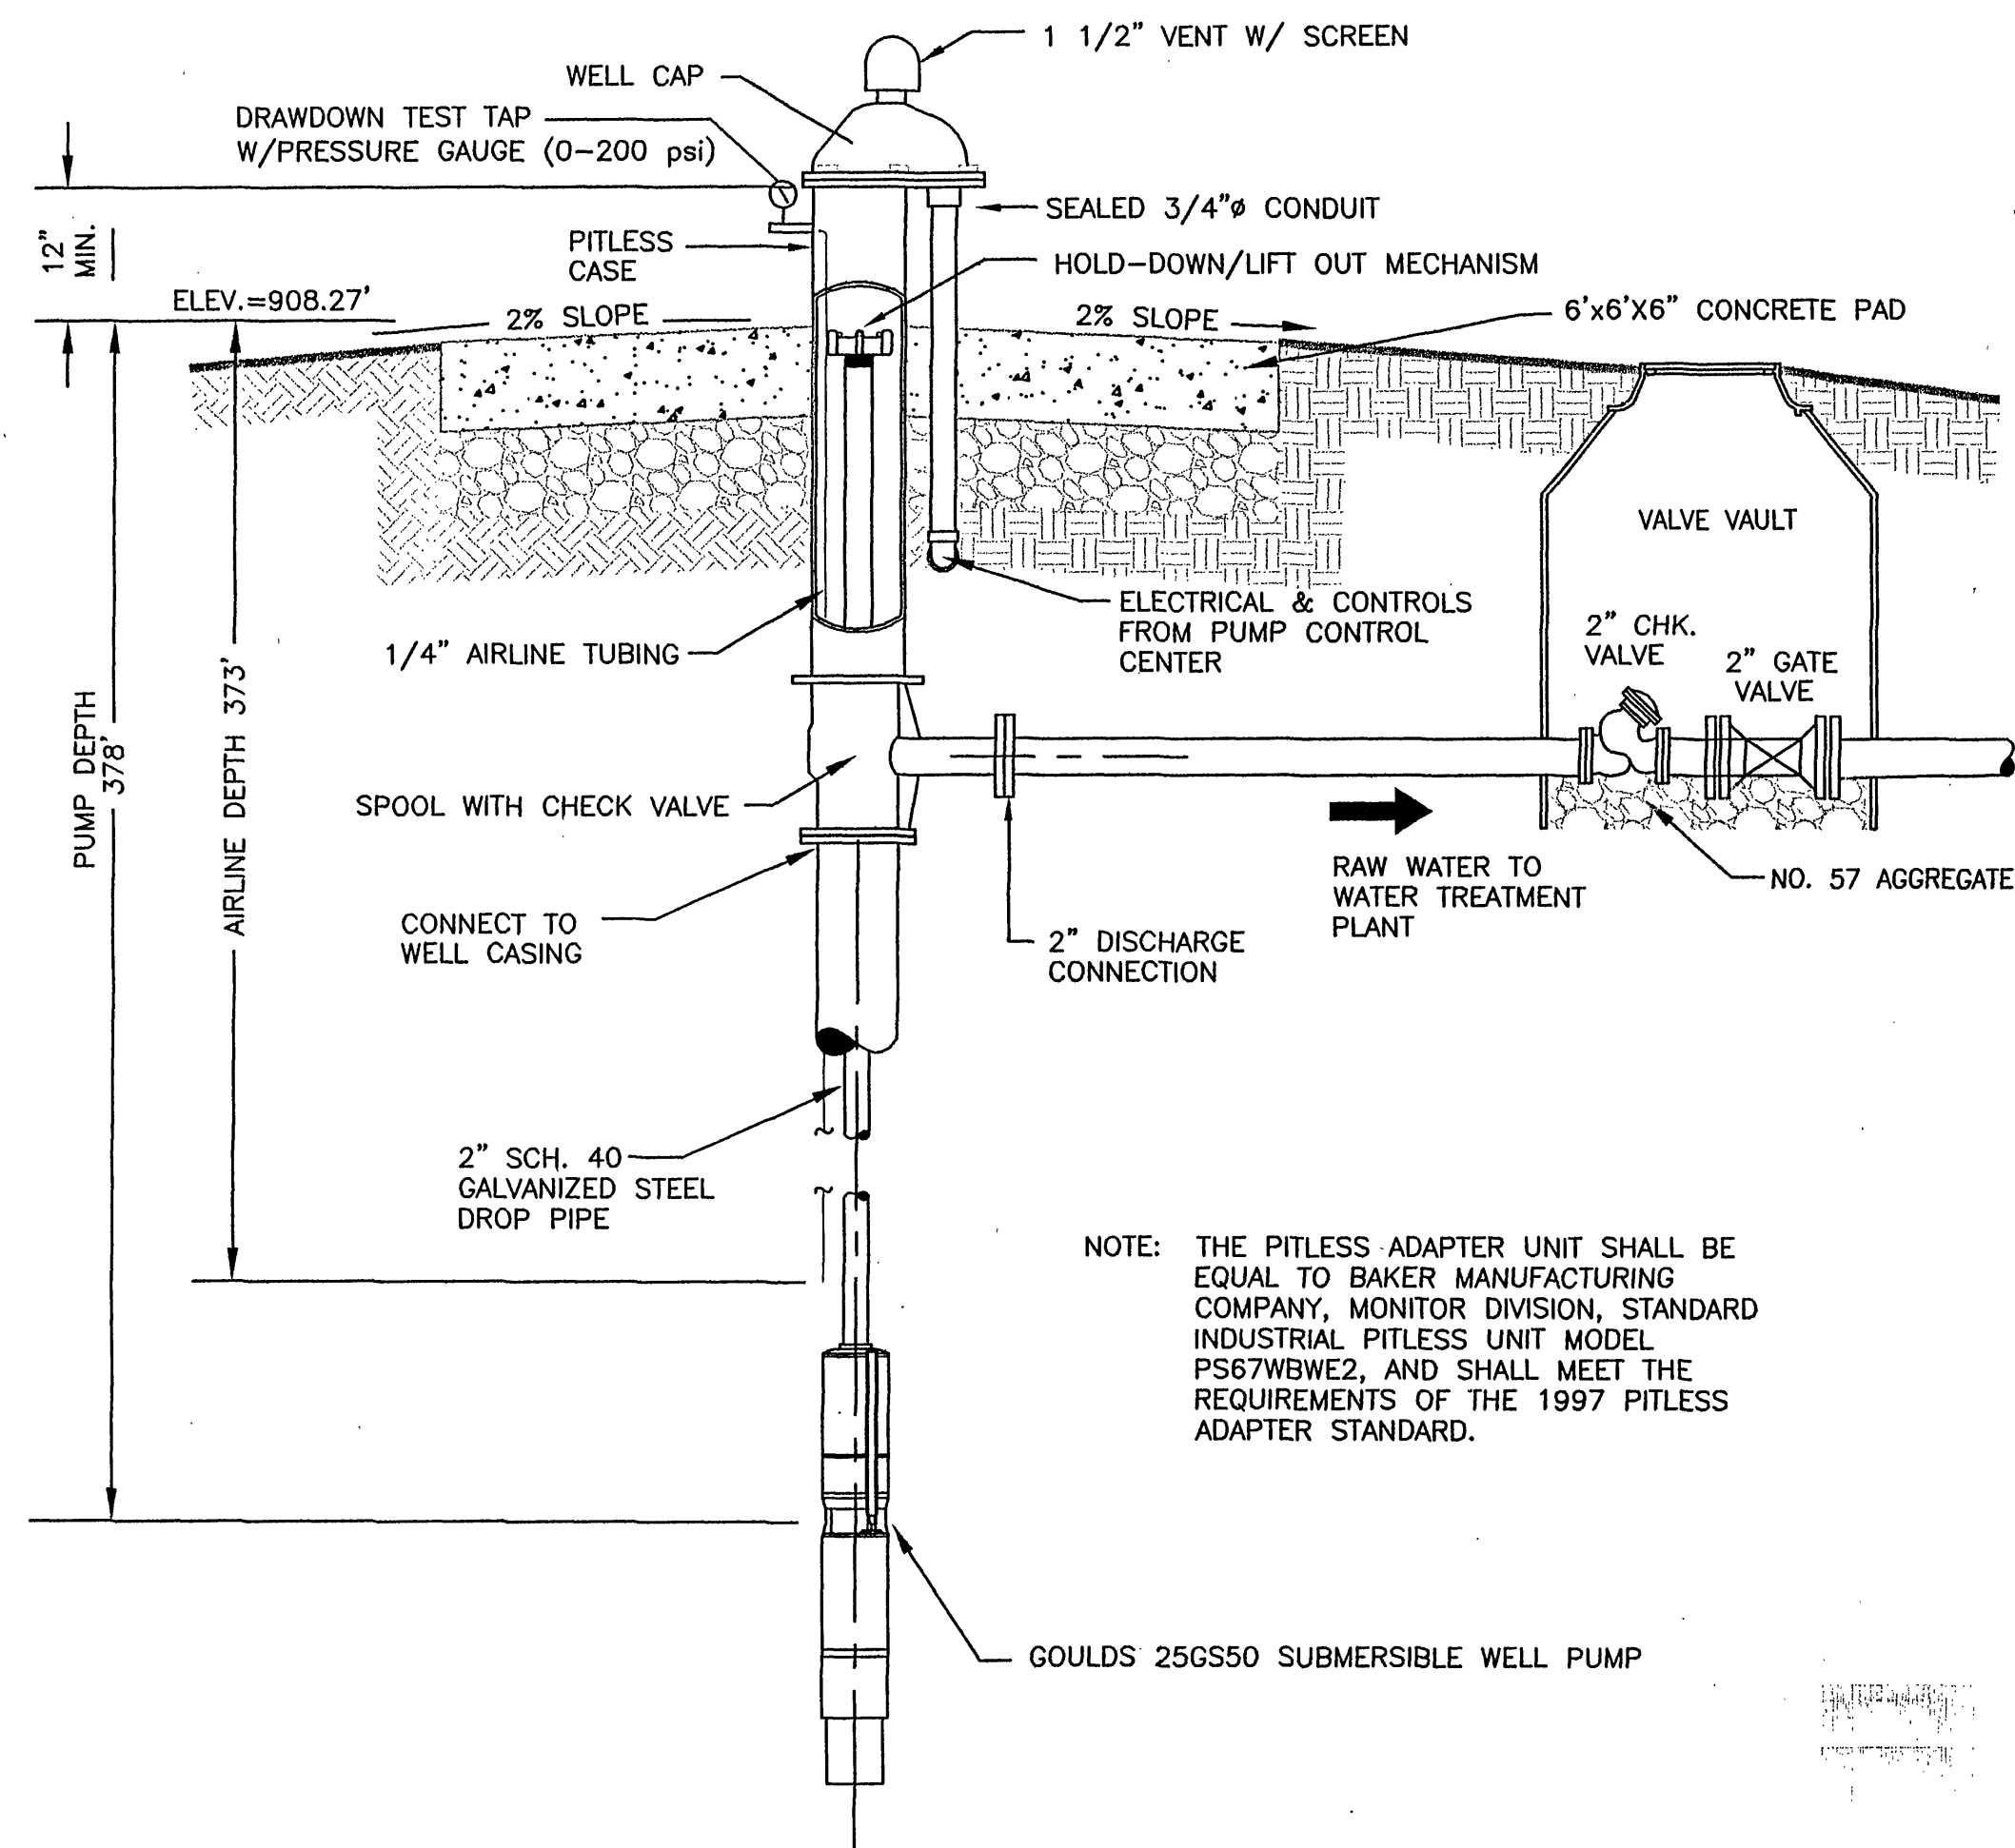

WELL #4
NOT TO SCALE

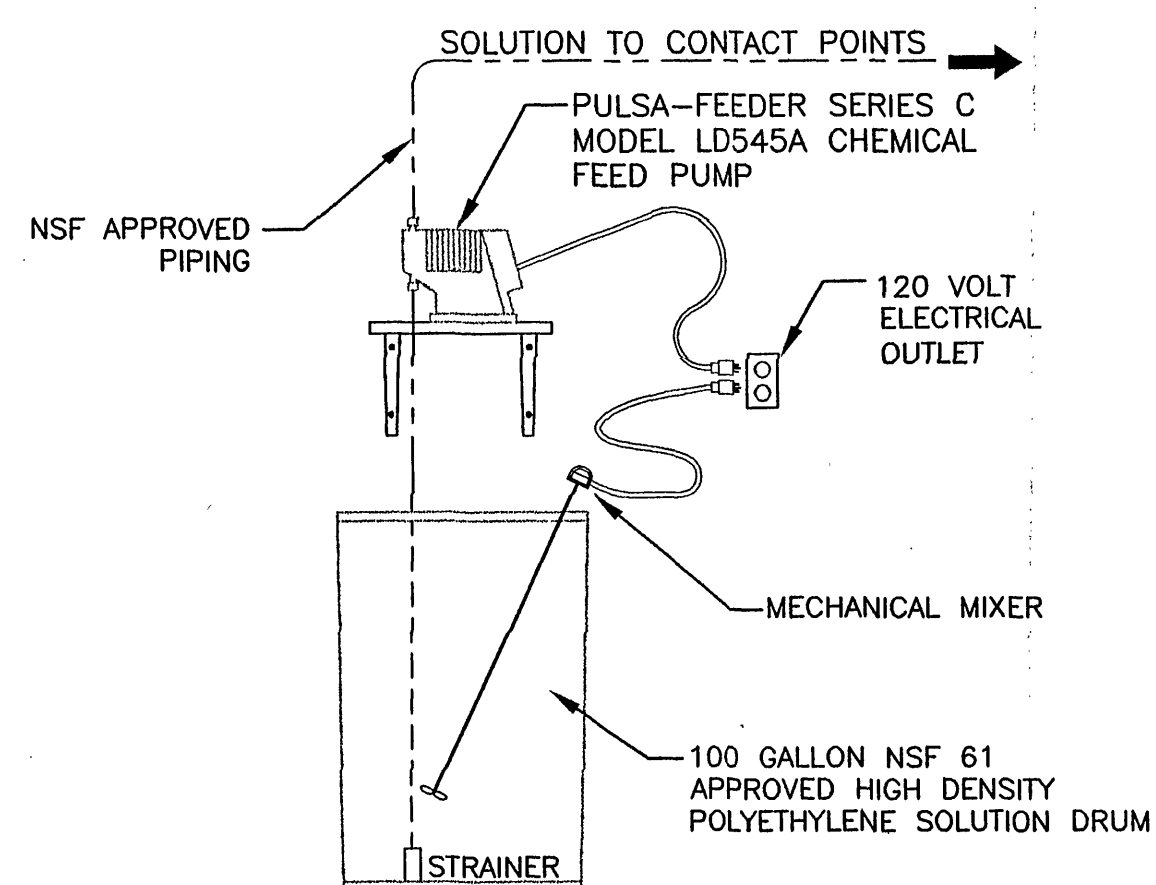


CHLORINE CHEMICAL FEED SYSTEM
NOT TO SCALE

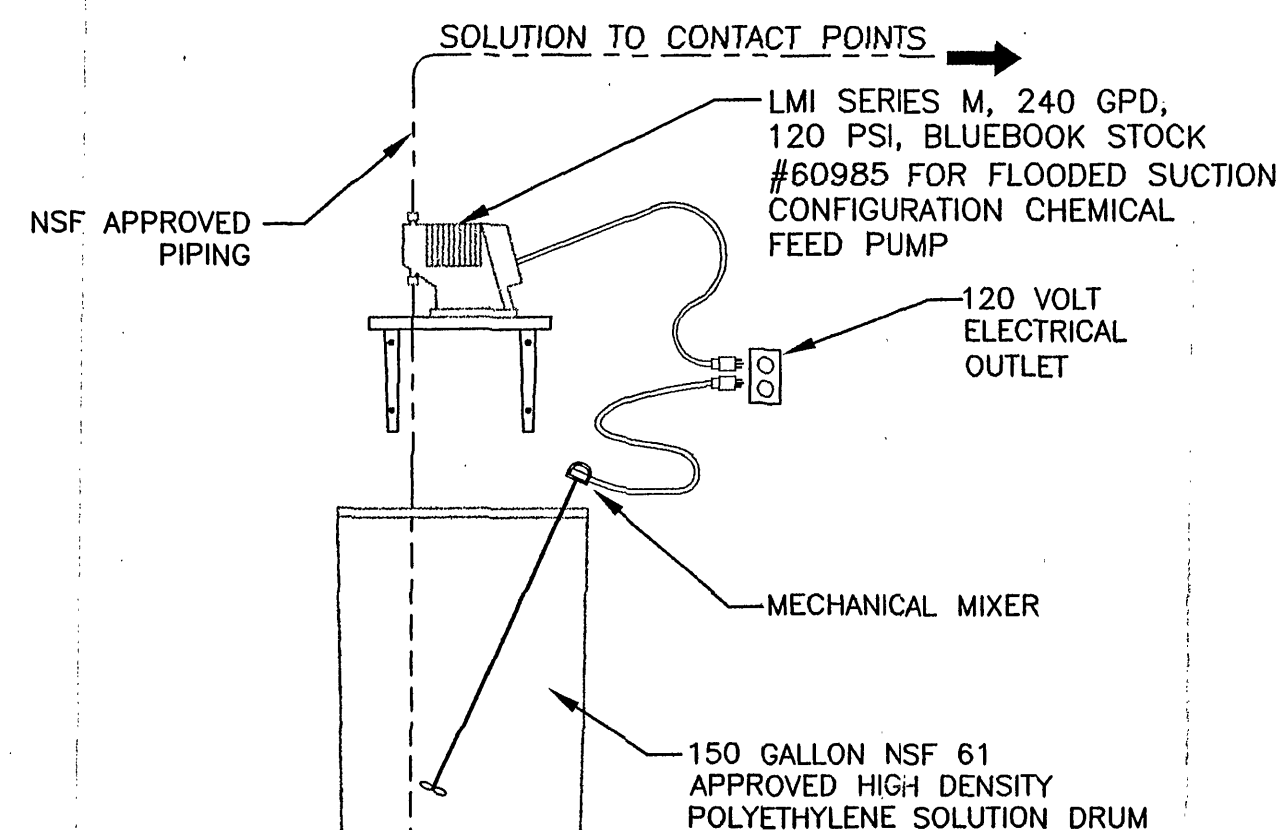

SODIUM CARBONATE CHEMICAL FEED SYSTEM
NOT TO SCALE

Model 25GS



GOULDS PUMPS

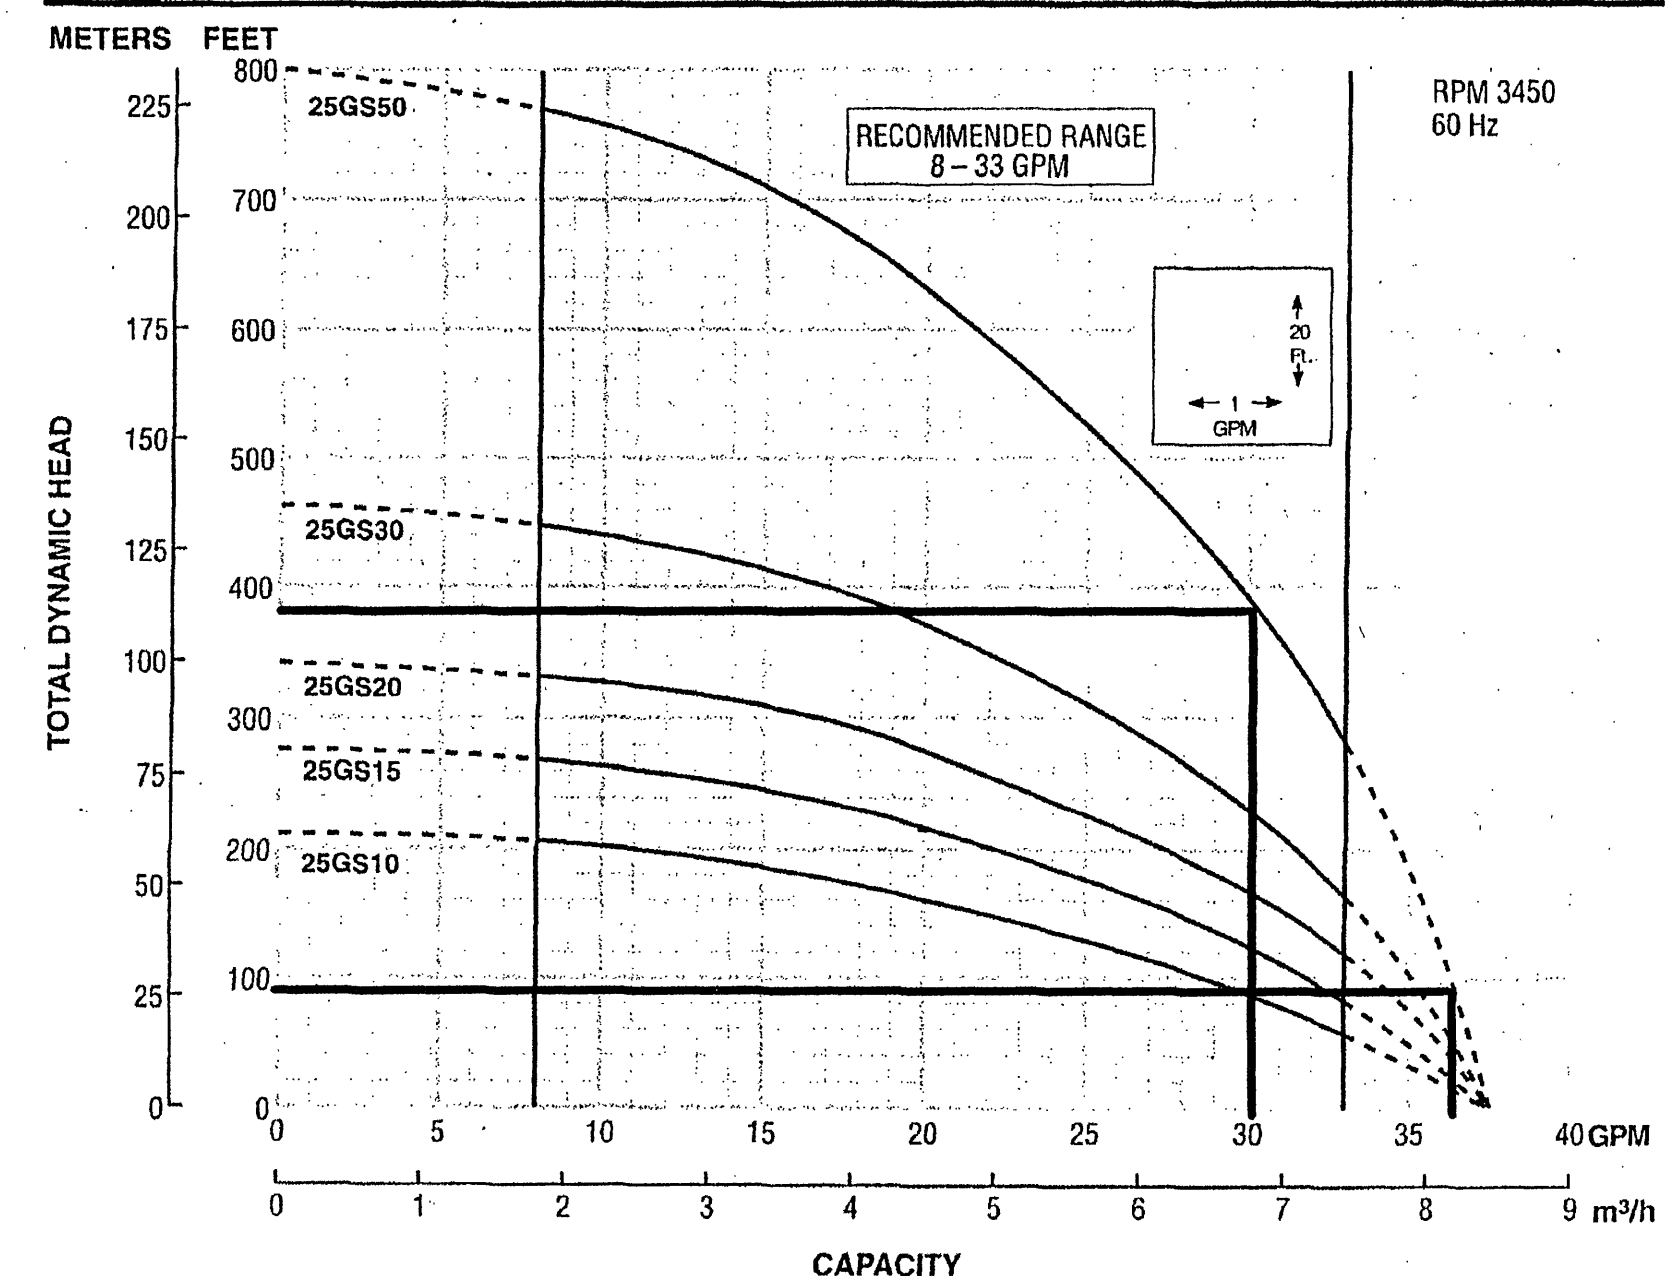


DIMENSIONS AND WEIGHTS

Model	HP	Phase	Stages	Length (inches)			Weight (lbs.)		
				W.E.Ⓢ	Motor	L.O.A.Ⓢ	W.E.	Motor	Total
25GS10412.22	1	1	7	12.7	11.8	24.5	7	23	30
25GS15412	1 1/2	1	9	14.6	13.6	28.2	8	28	36
25GS15422	1 1/2	1	9	14.6	15.1	29.7	8	31	39
25GS15432.34	1 1/2	3	9	14.6	11.8	26.4	8	23	31
25GS20412	2	1	11	16.5	15.1	31.6	9	30	39
25GS20432.34	2	3	11	16.5	13.6	30.1	9	28	37
25GS30412	3	1	15	20.2	23.5	43.7	11	52	63
25GS30432.34	3	3	15	20.2	20.6	40.8	11	43	54
25GS50412	5	1	25	30.9	29.5	60.4	17	69	86
25GS50432.34	5	3	25	30.9	23.6	54.5	17	53	70

Ⓢ W.E. = water end or pump without motor.
Ⓢ L.O.A. = length of assembly - complete pump - water end and motor.

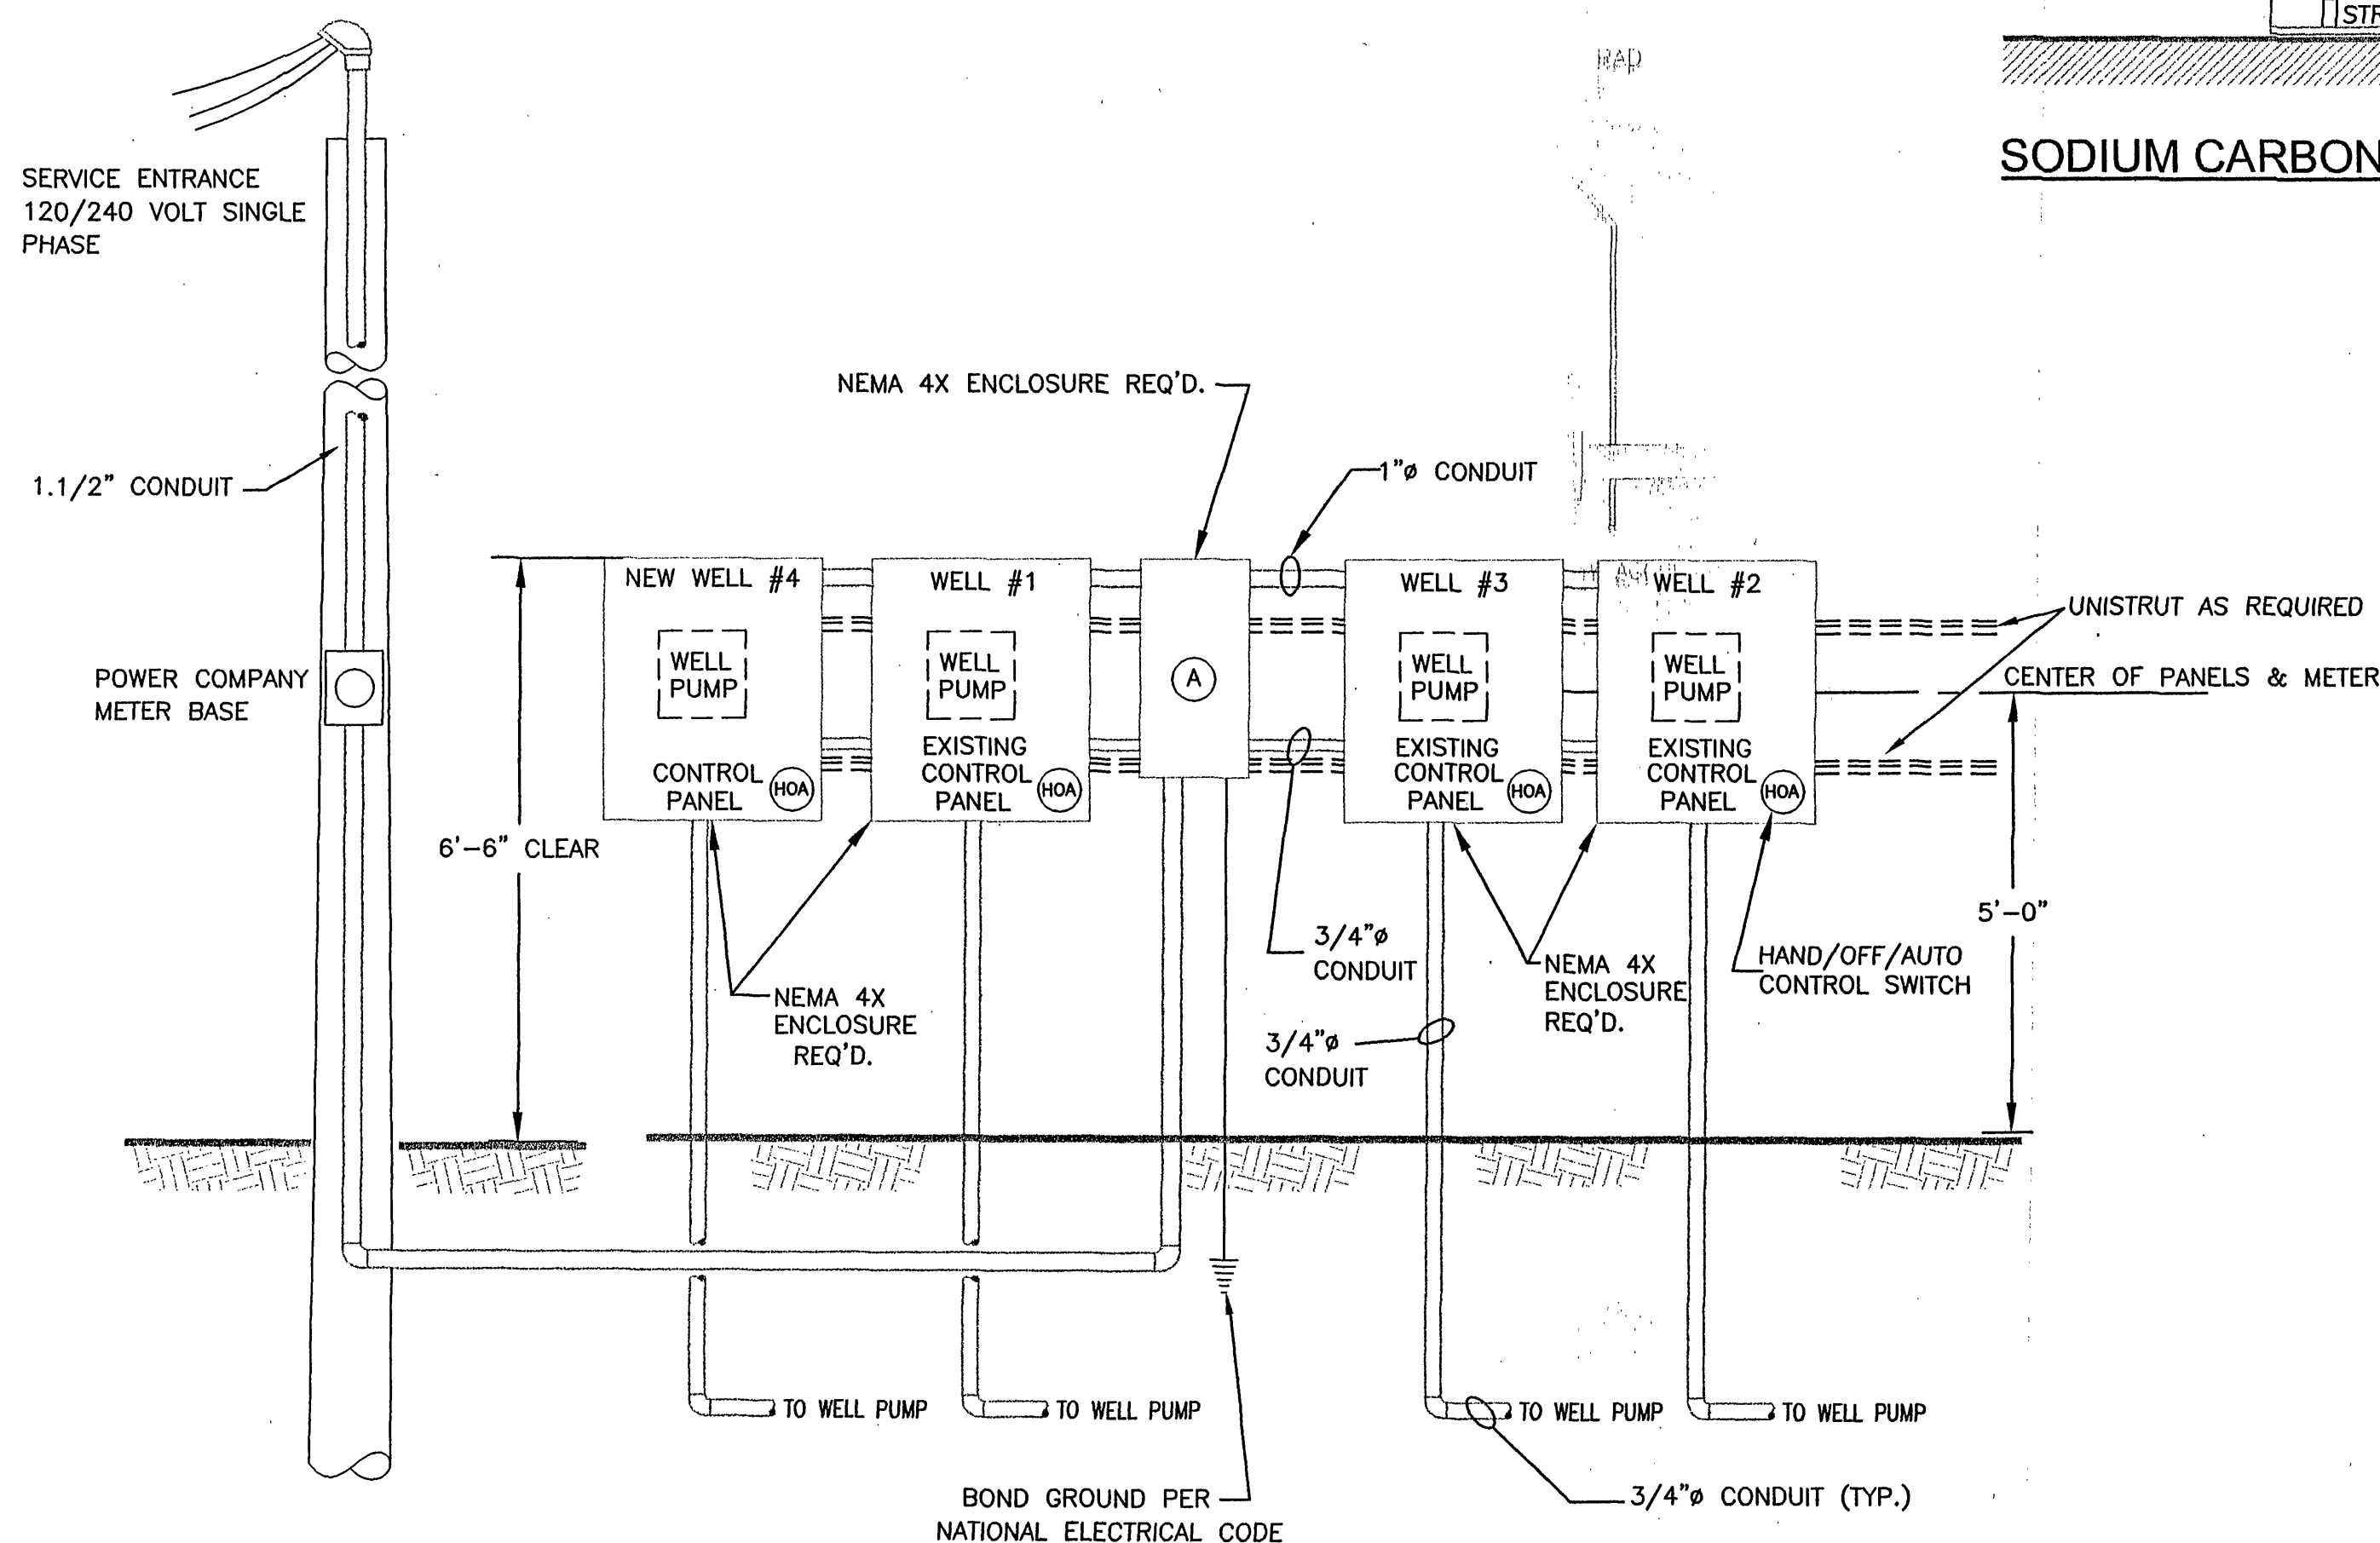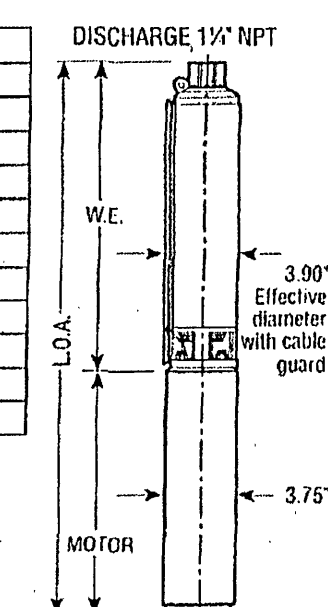

ELECTRICAL / STRUCTURAL - PUMP CONTROL CENTER
NOT TO SCALE

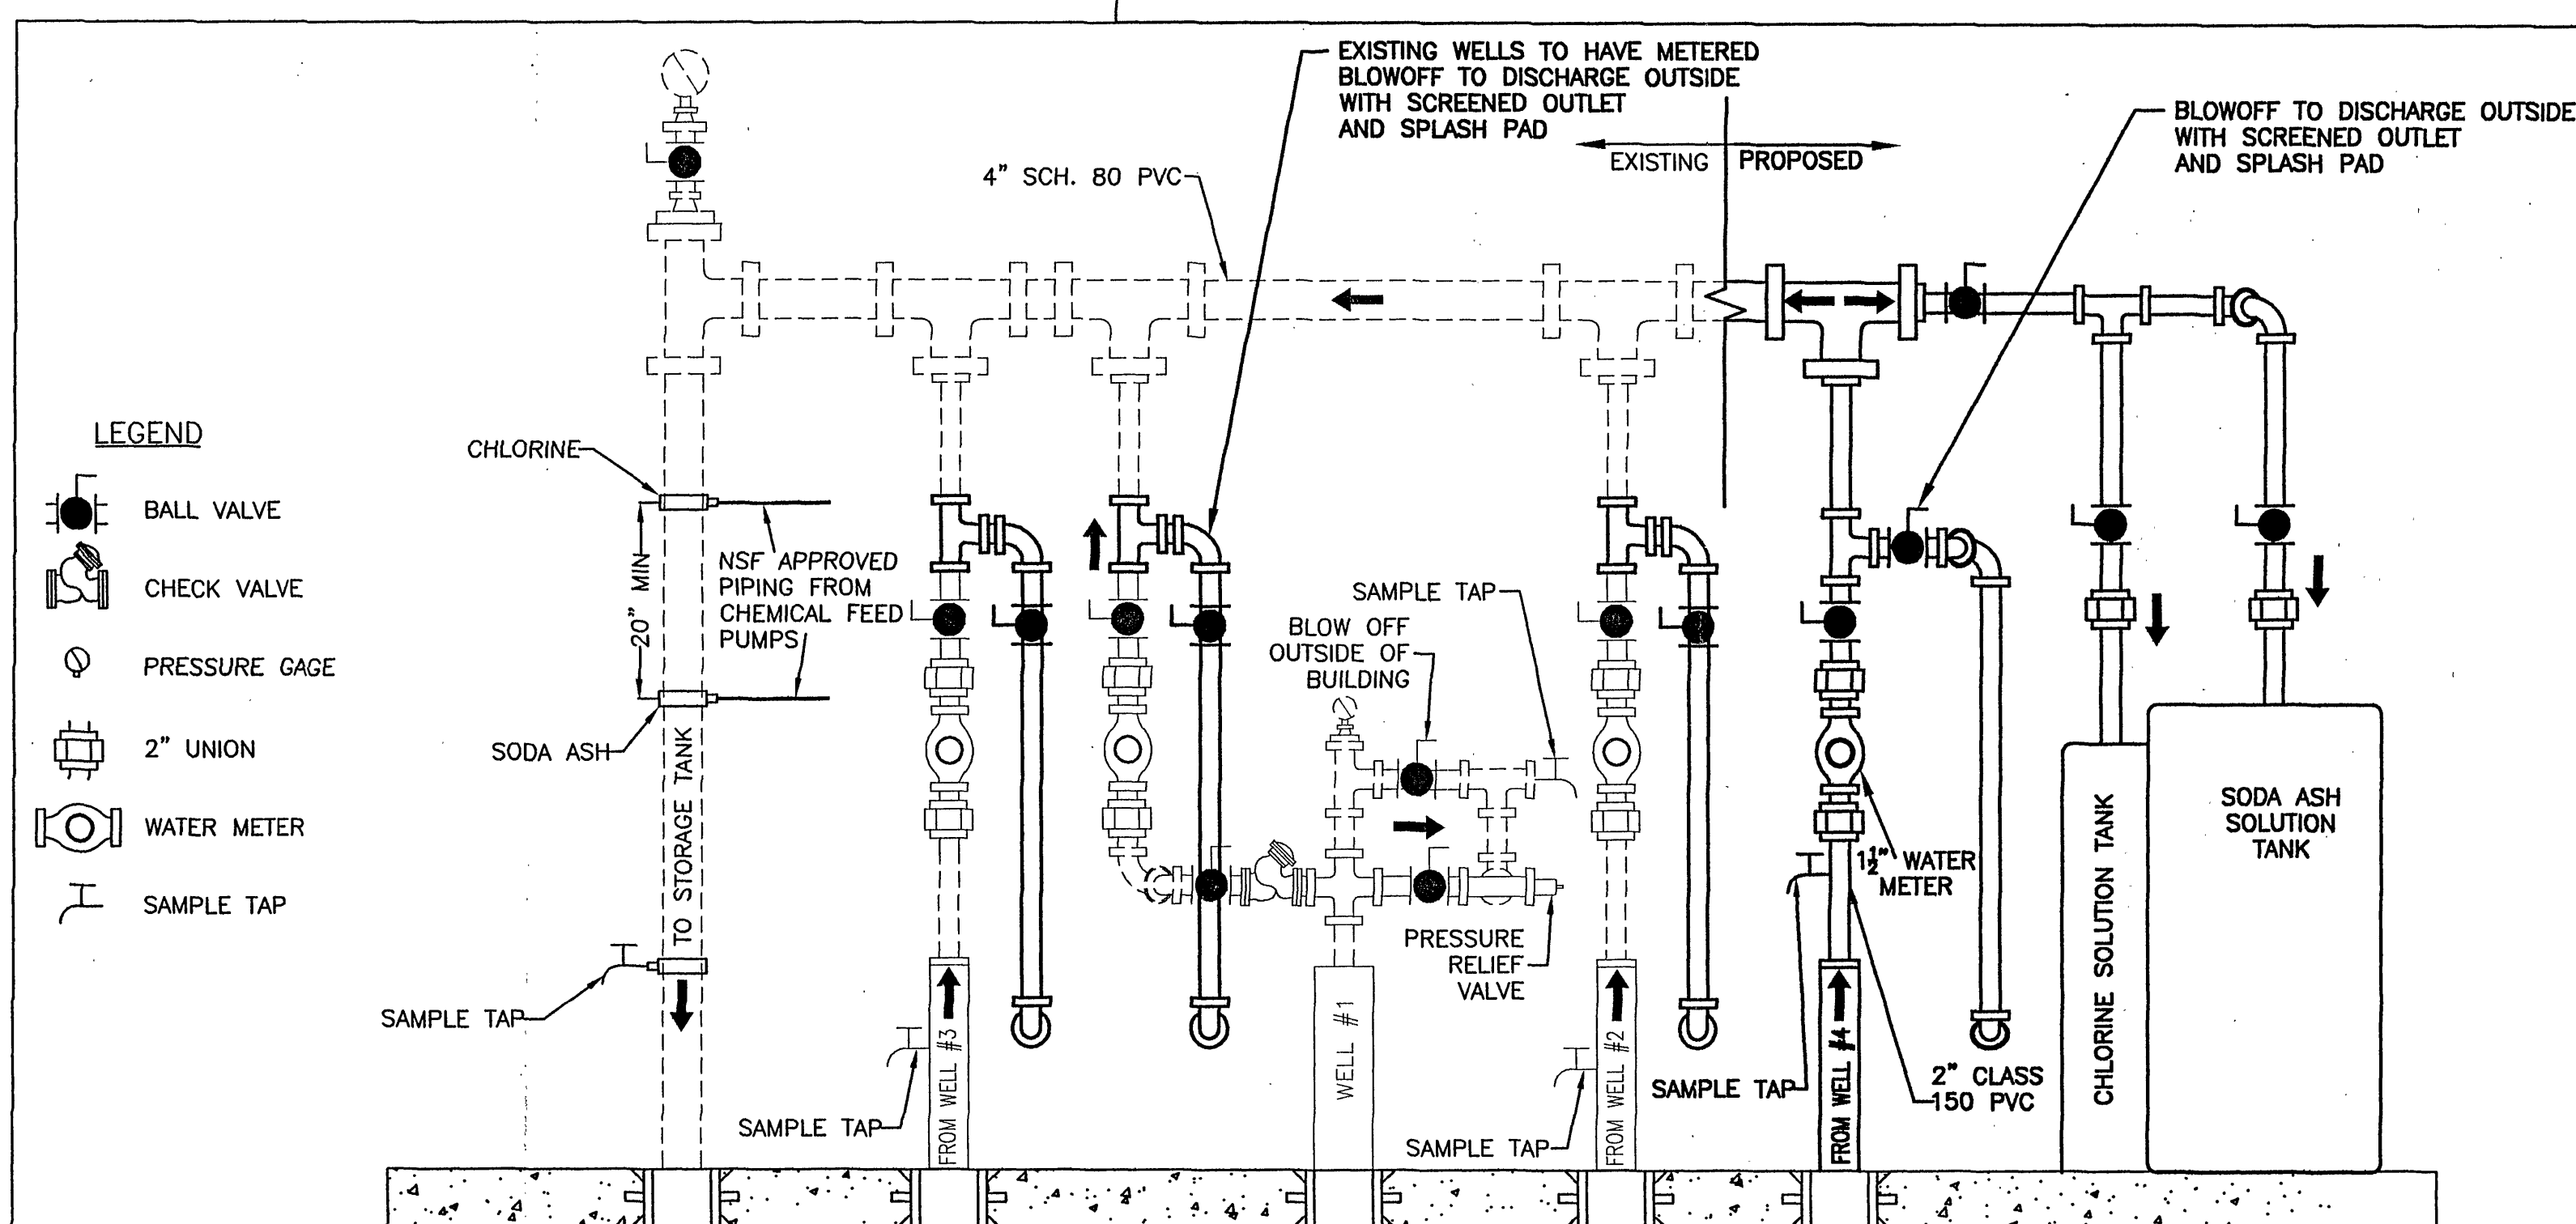

MECHANICAL ROOM PROFILE
N.T.S.

9/2/05

VDH COMMENTS

9/2/05

DATE

APPROVAL

REVISIONS

DESCRIPTION

DESIGN: MEP

DRAFT: MEP

CHECK: RDS

DETAIL SHEET

FOR CONTENTMENT ISLAND WELL #4

LOCATED ON STATE ROUTE 957

UNION HALL MAGISTERIAL DISTRICT

FRANKLIN COUNTY, VIRGINIA

DATE: 1-25-05

SCALE: N.T.S.

SHEET 3 OF 3

PROJECT NO. 04010

Stone Engineering
250 S. Main Street
Rocky Mount, Virginia 24151
(540) 483-0078

