




Note: All column footings should have a total of 20 bars in each direction in bottom of slab. 8 bars bent down from each end + 4 straight bars 12'-0" long (same as roof but inverted)

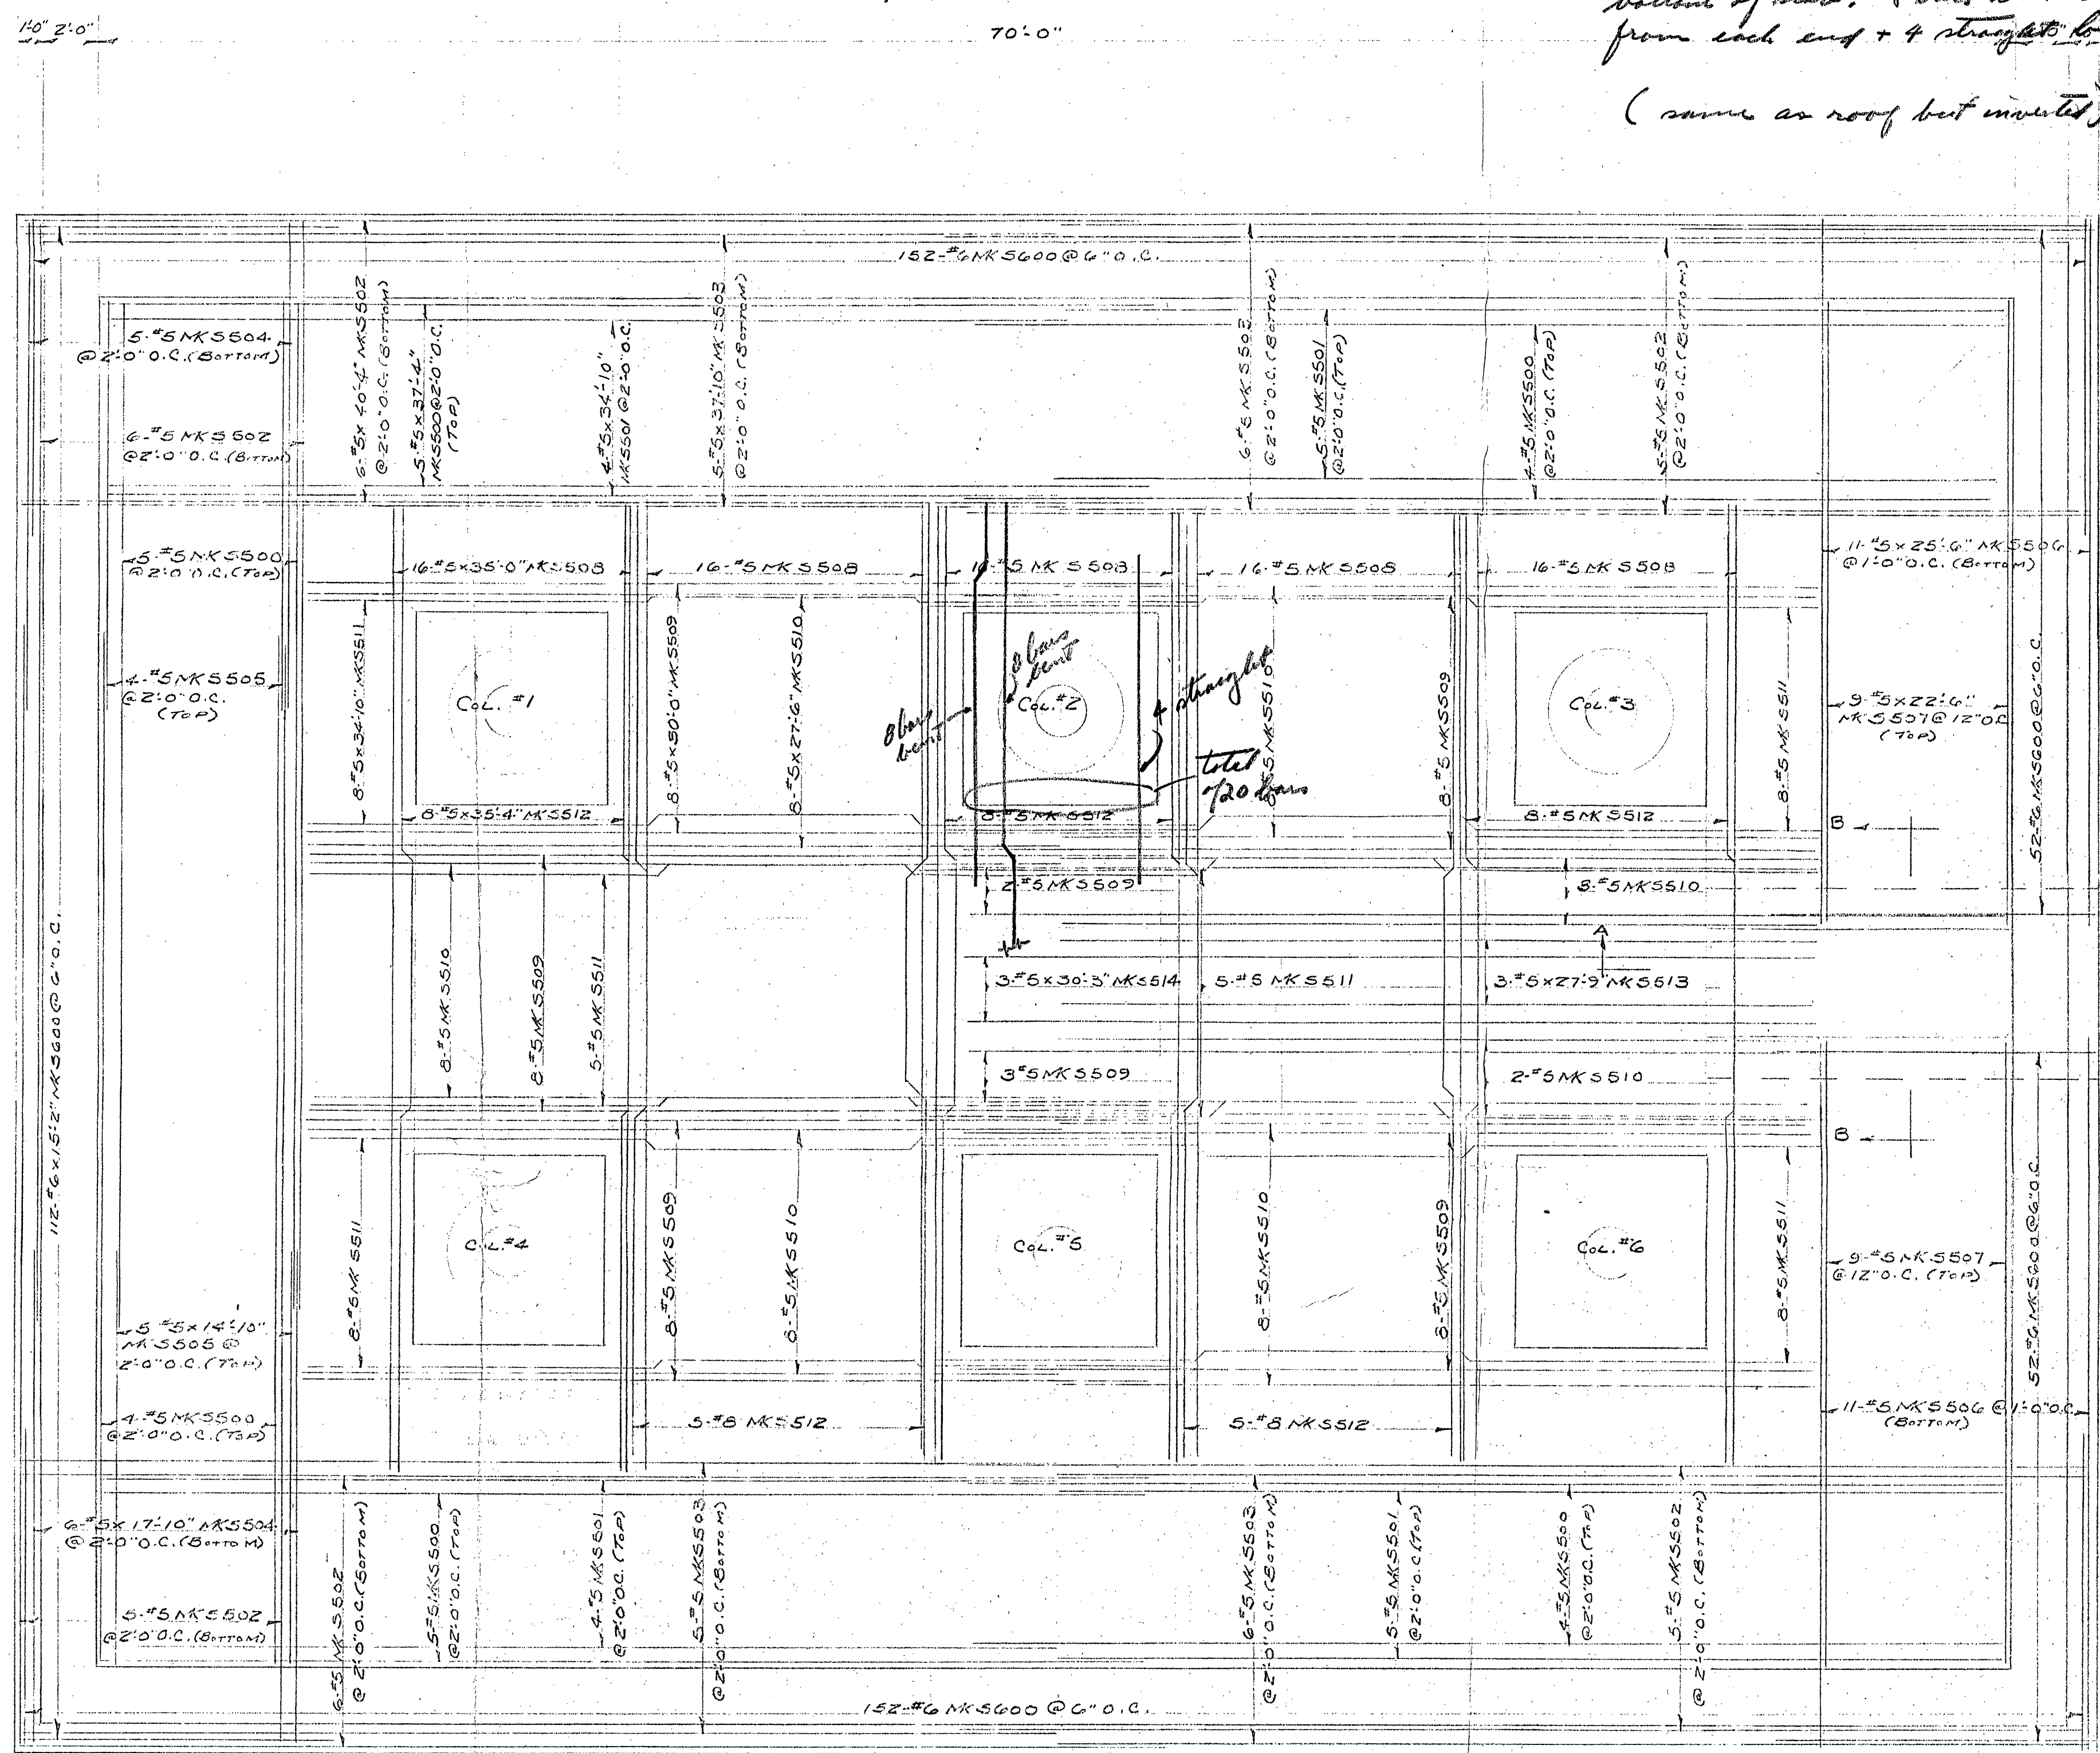


FLOOR SLAB

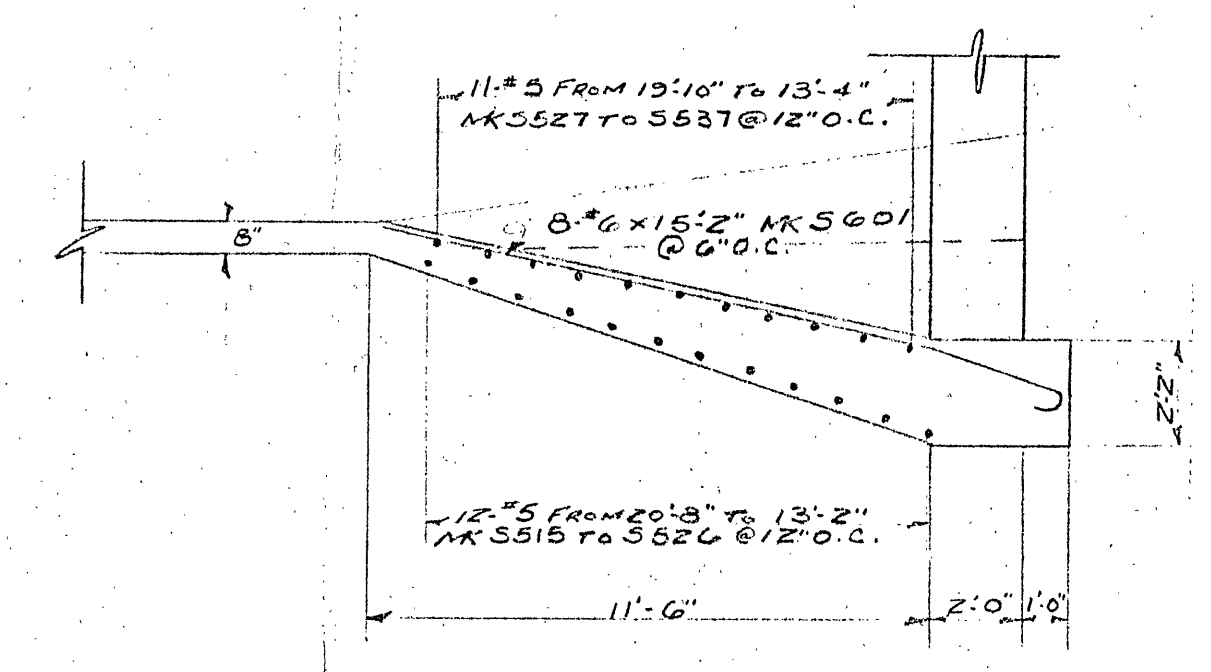

SEC. A-A

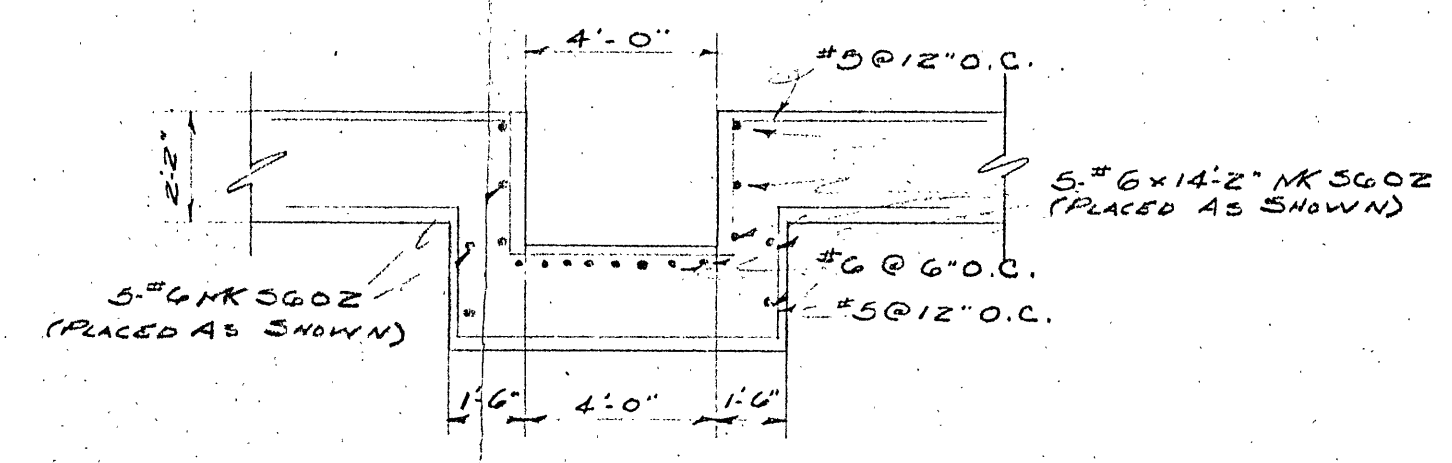

SEC. B-B

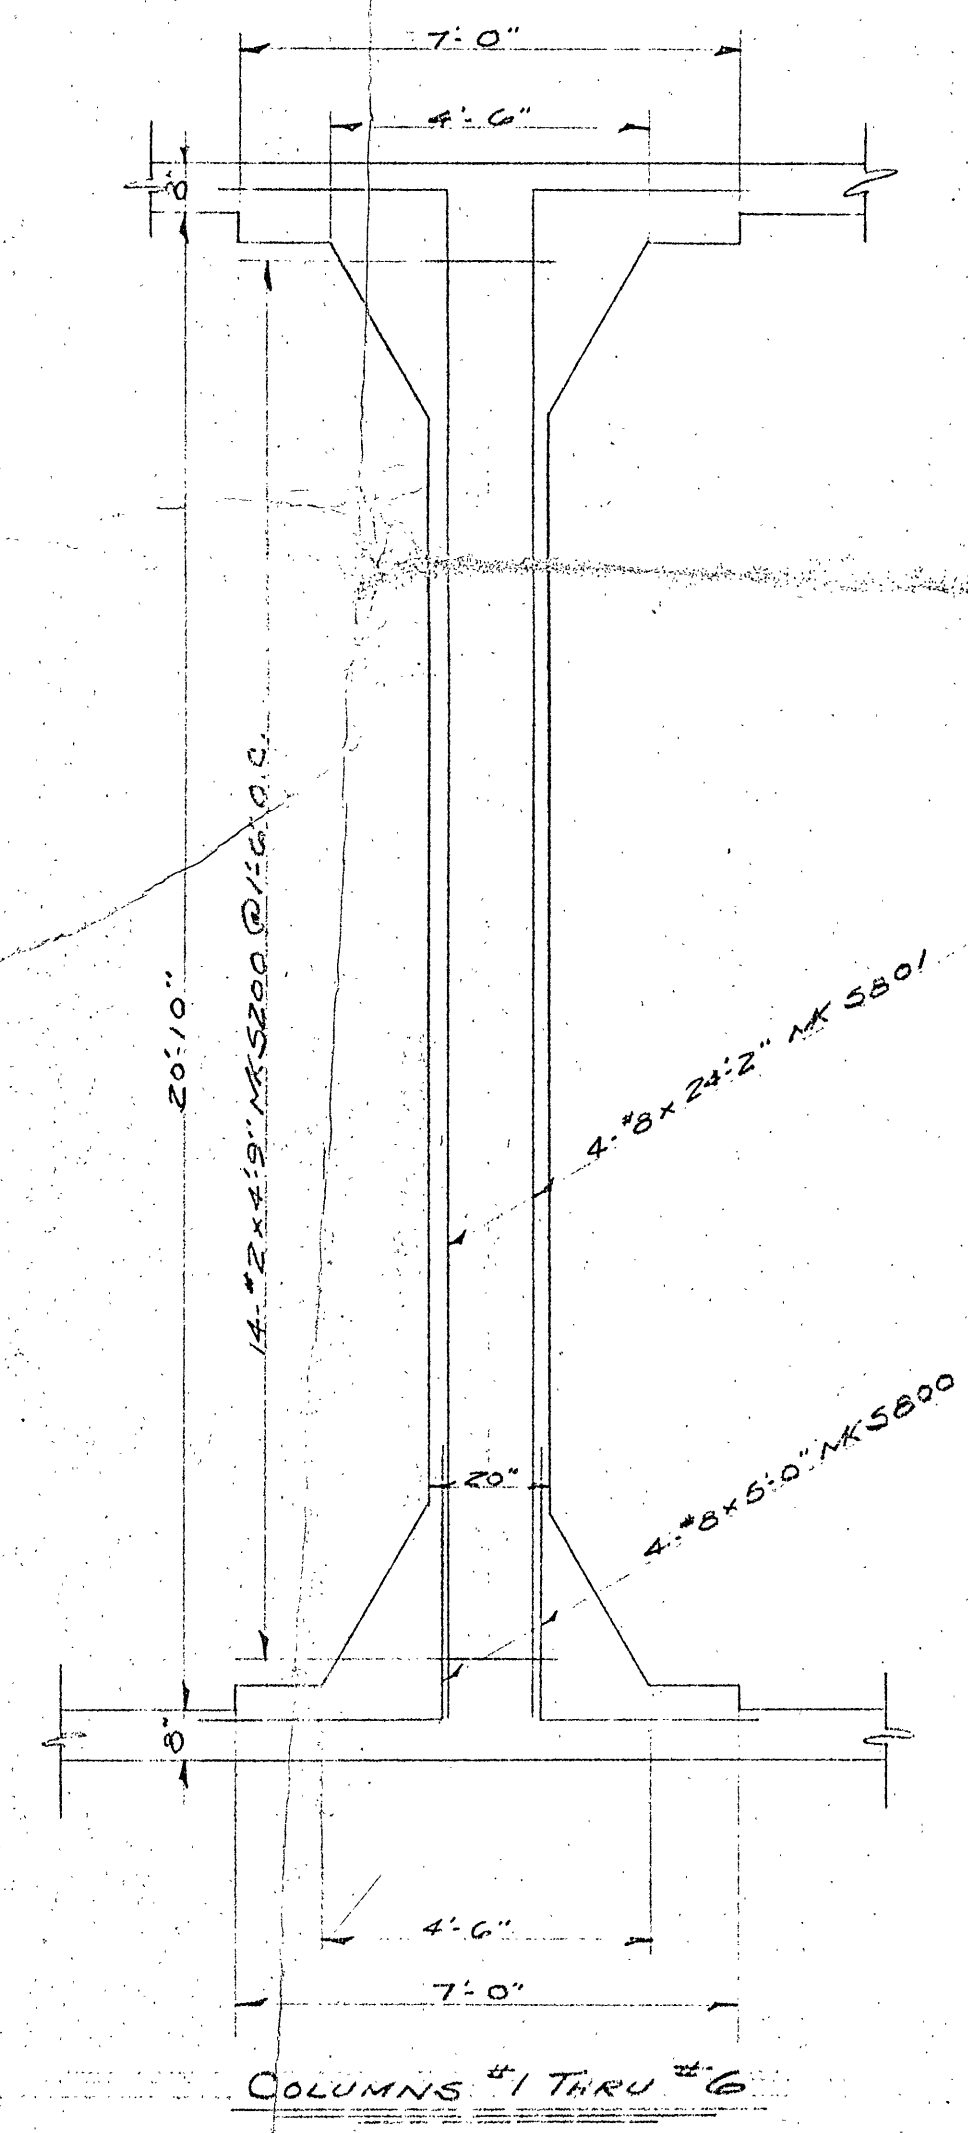

COLUMNS #1 THRU #6

APPROVED
ALVORD, BURDICK & HOWSON
BY *[Signature]*
DATE 5/26/52
For general design only
with corrections as shown

MONTAGUE-BETTS COMPANY LYNCHBURG, VIRGINIA			
REINFORCING STEEL GARDEN CITY RESERVOIR ROANOKE, VIRGINIA			
ARCHITECT: ALVORD, BURDICK & HOWSON			
CONTRACTOR: J. E. JEWELL			
REVISED	DRAWING NO.	ORDER NUMBER	SHEET NO.
DWG. R.M.	15138	15138	1 of 3
CHKD. S.M.			
DATE			