
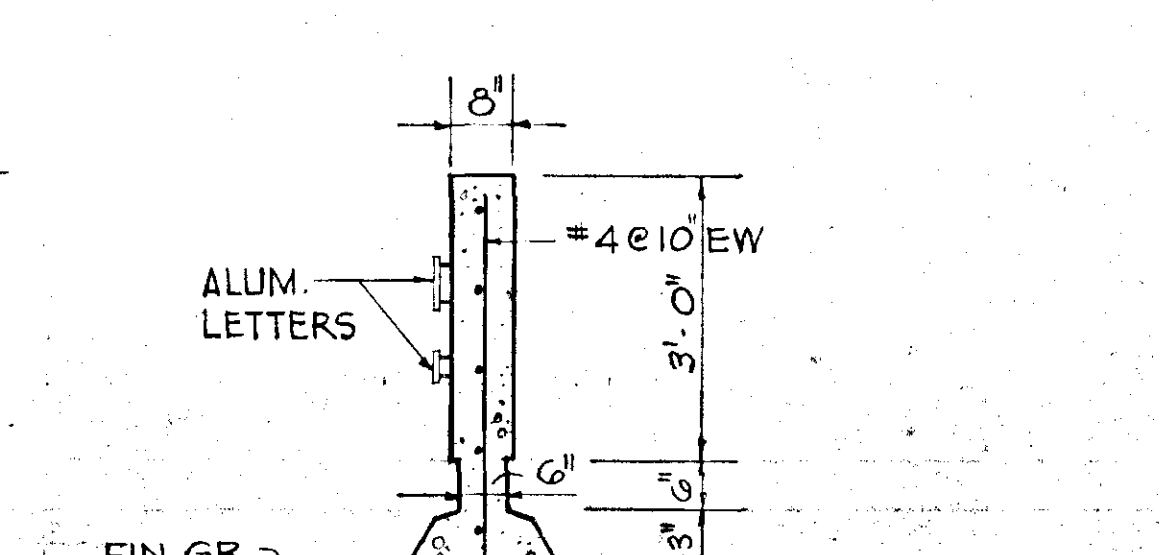
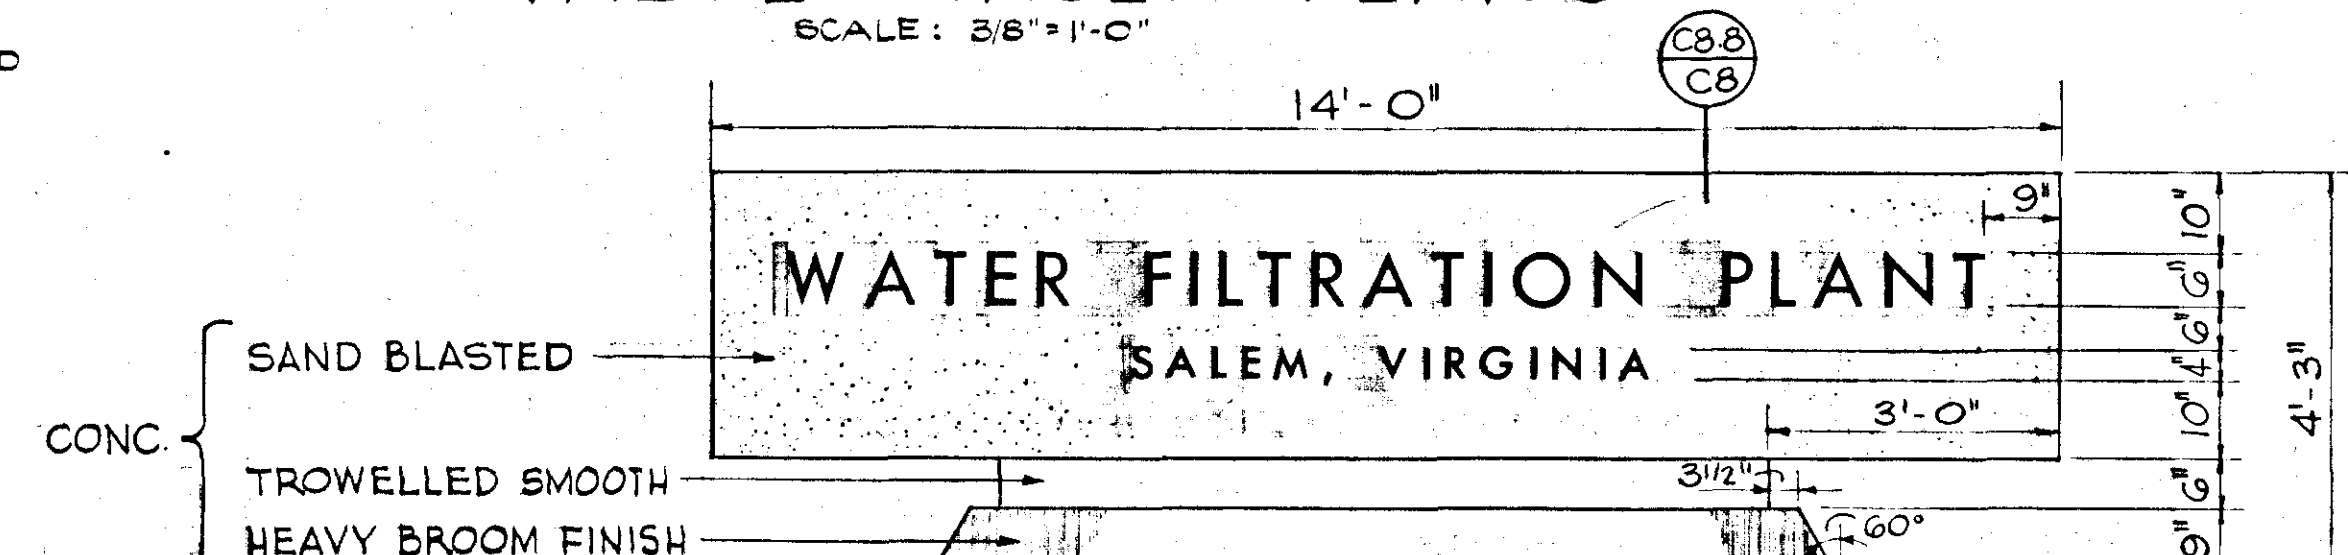
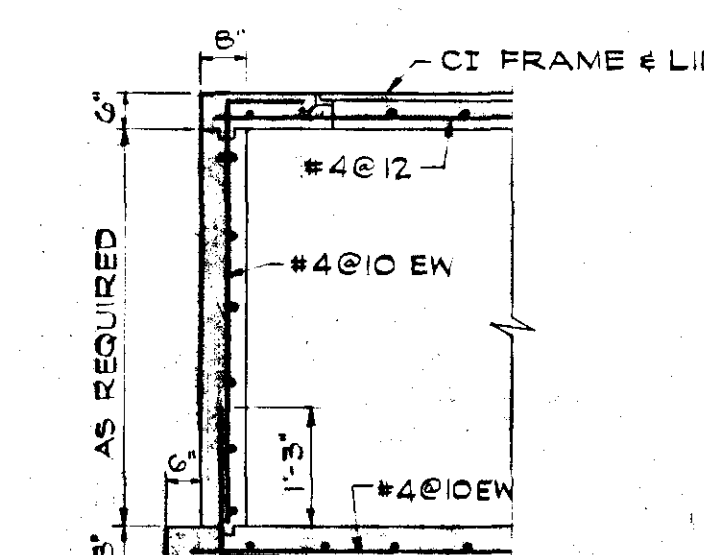
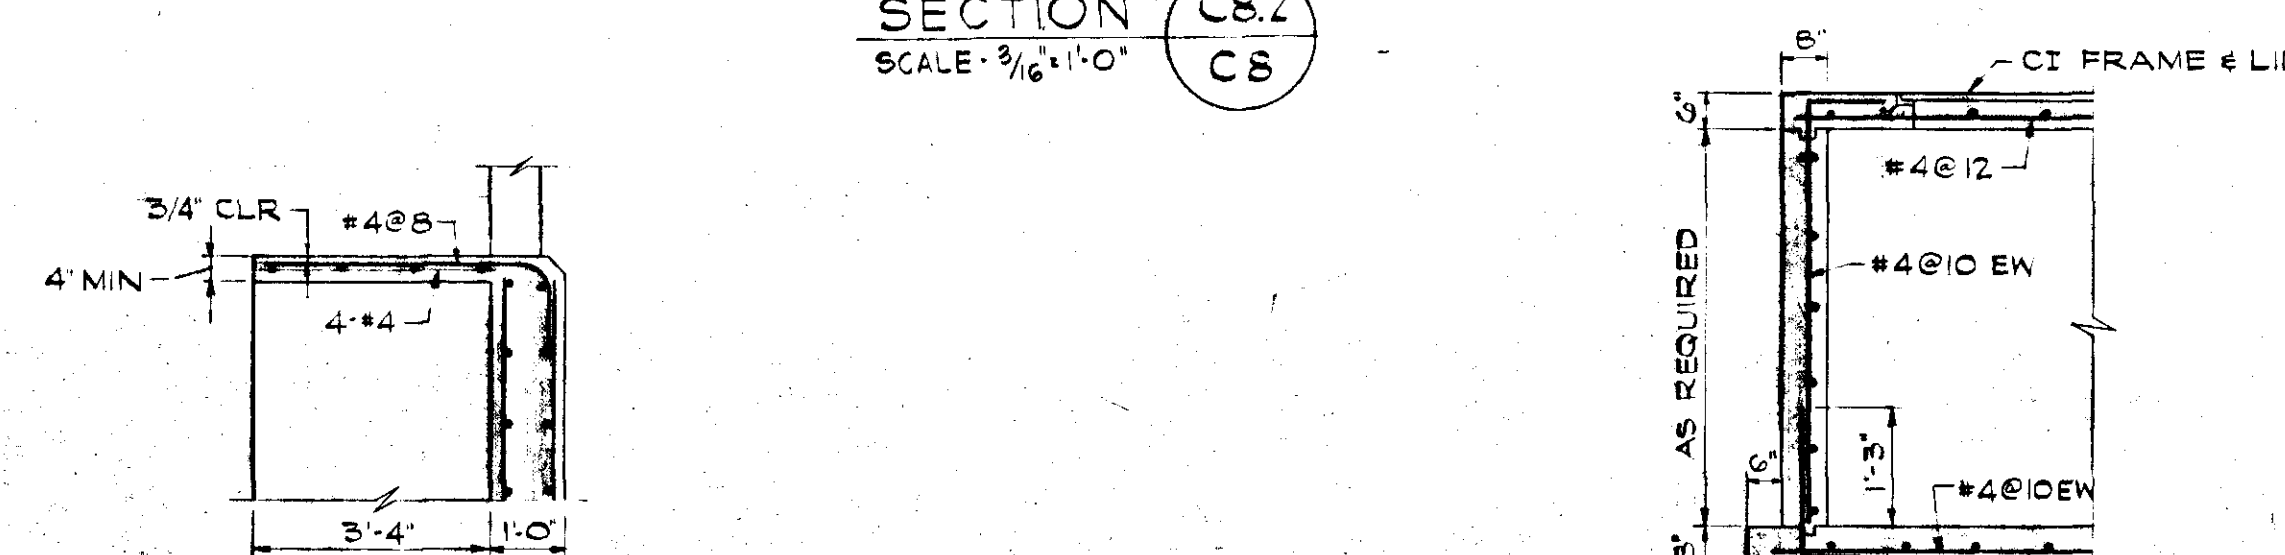
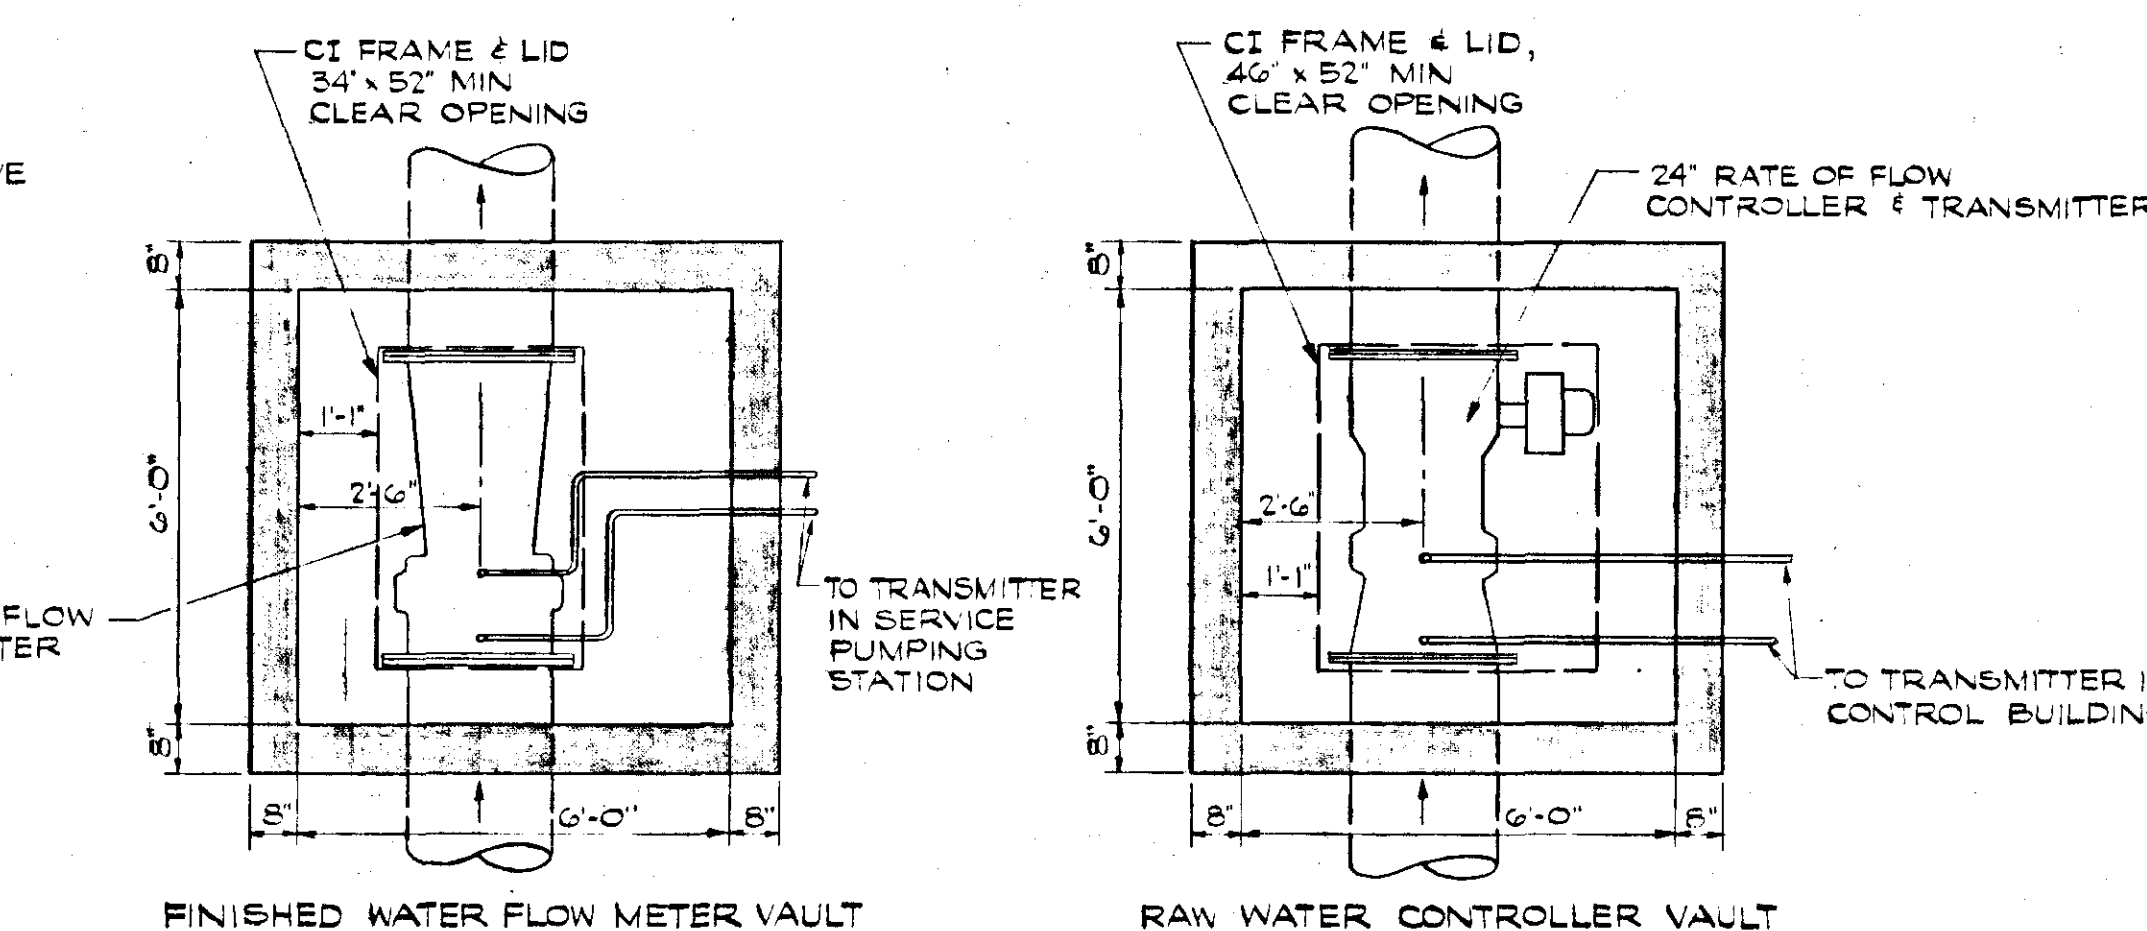
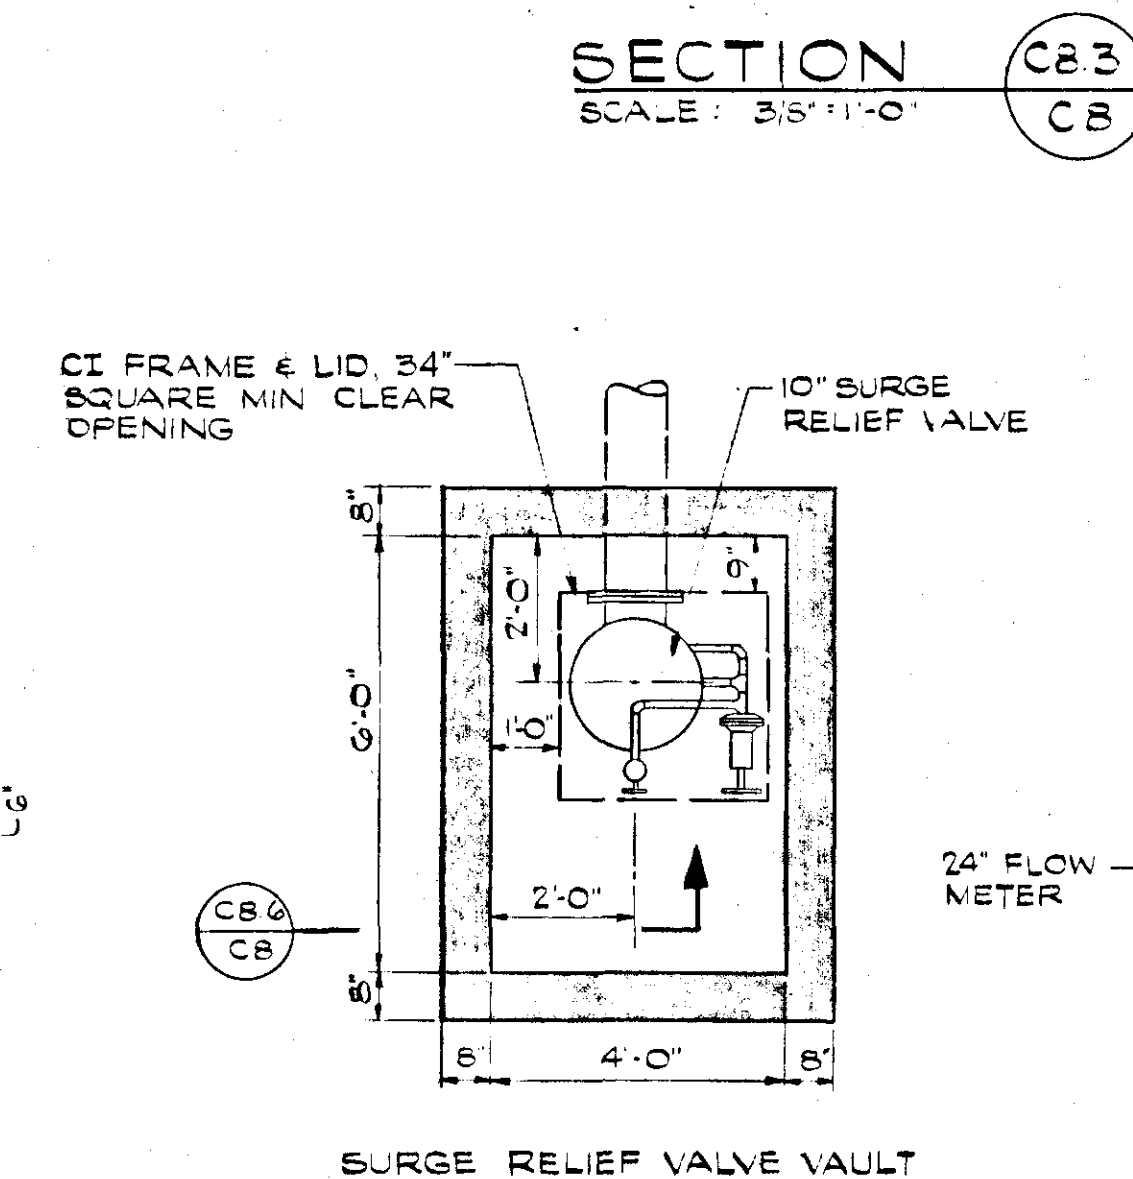
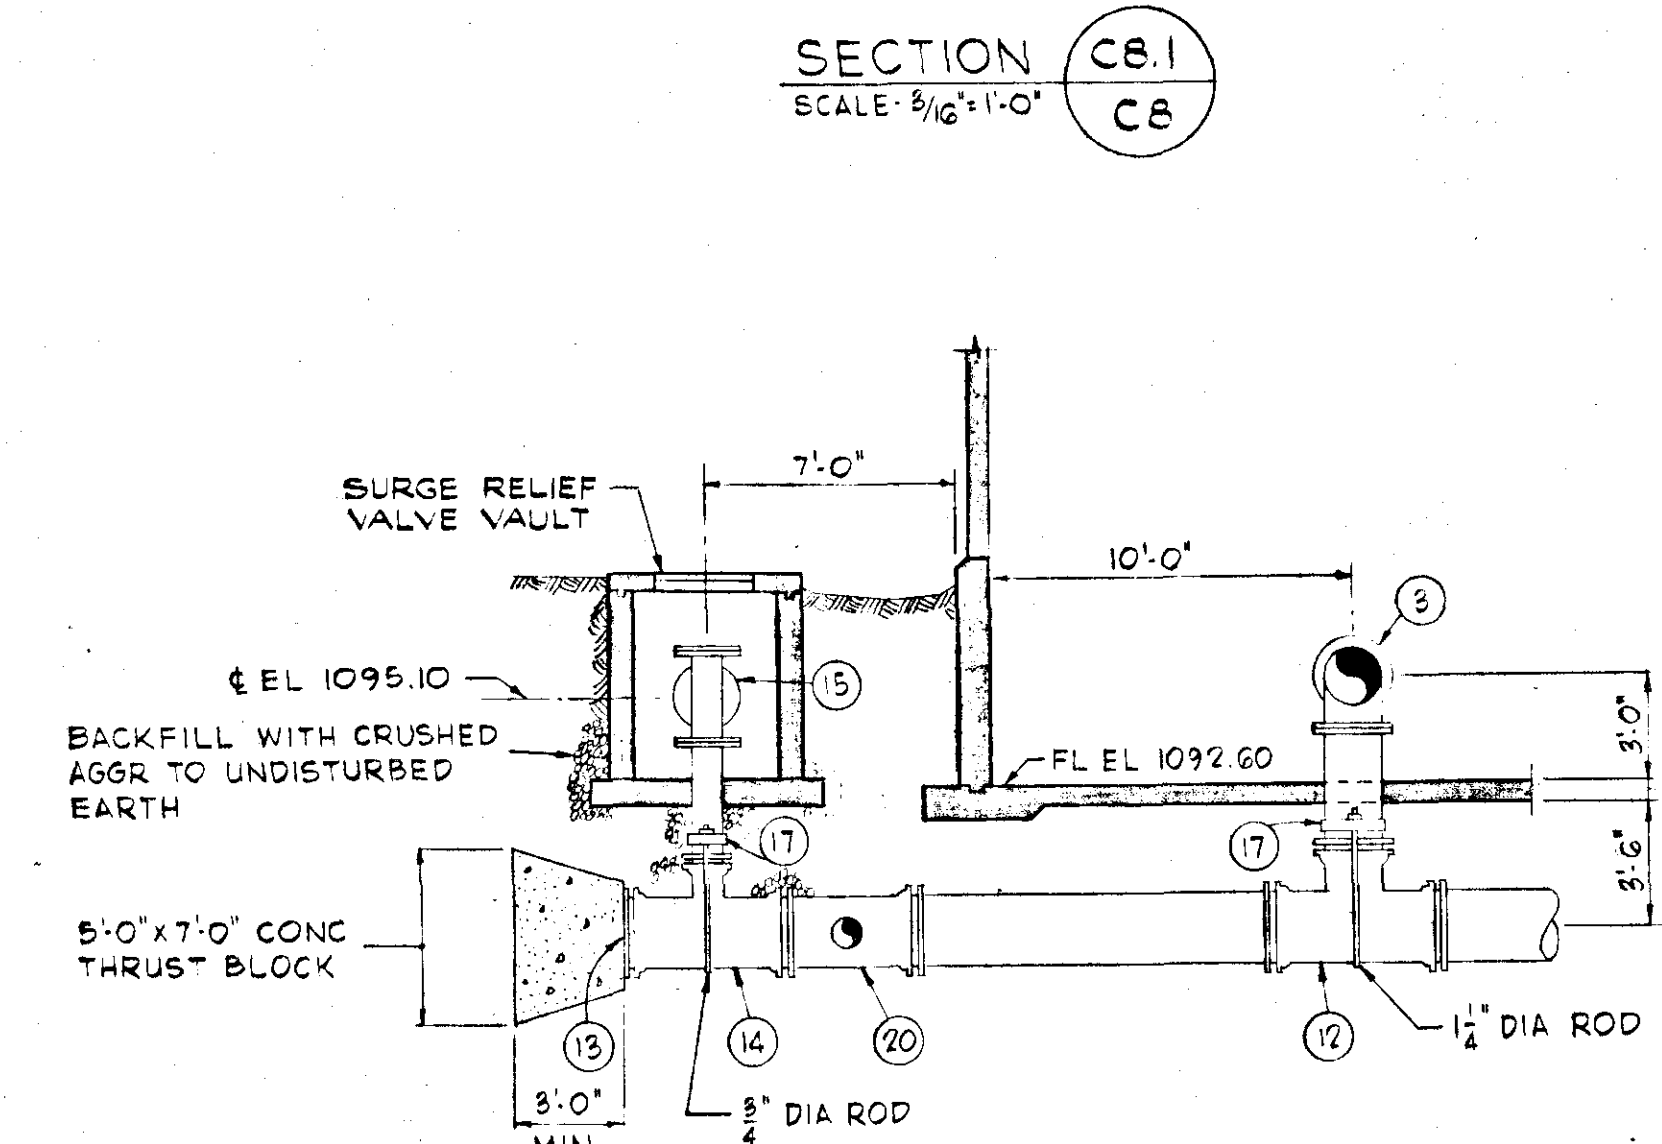
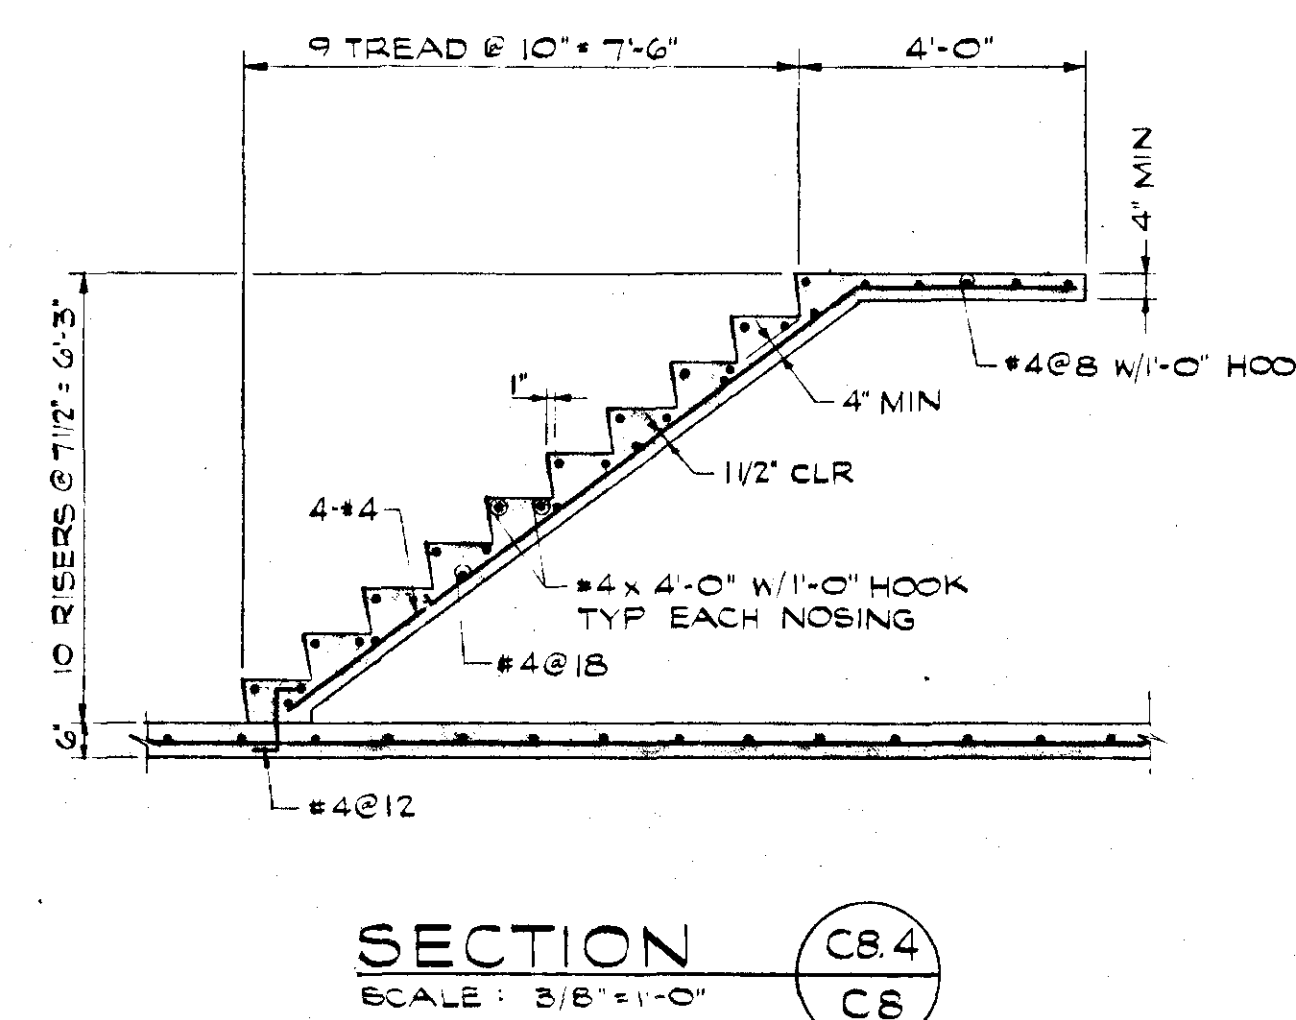
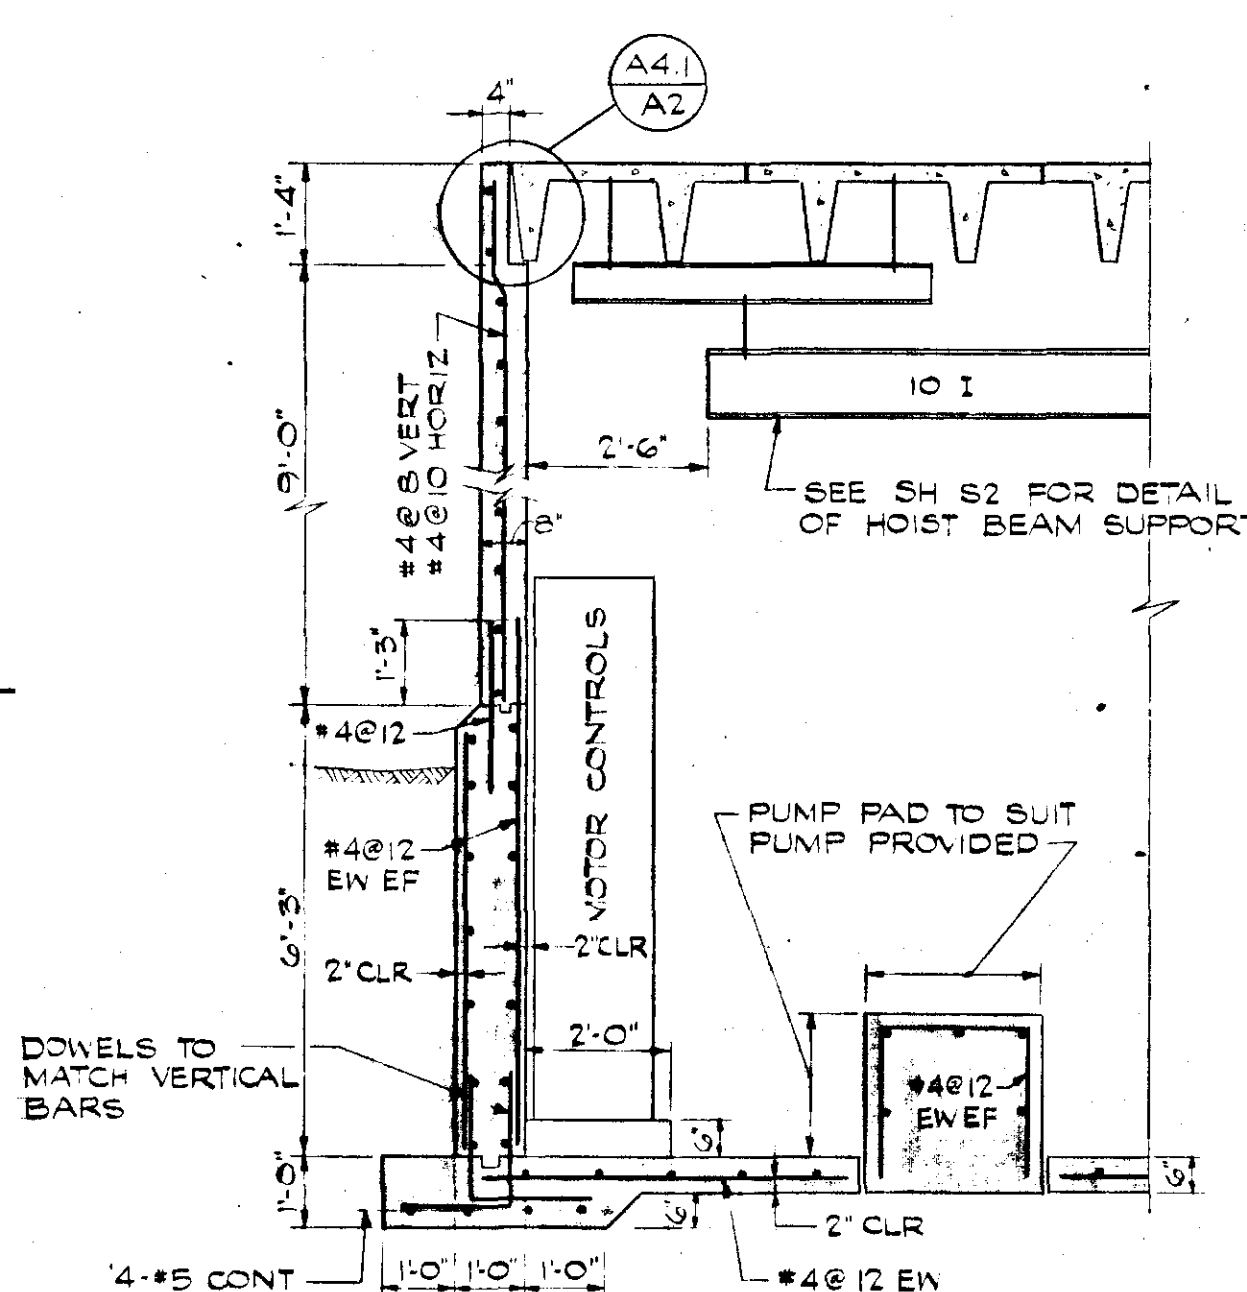
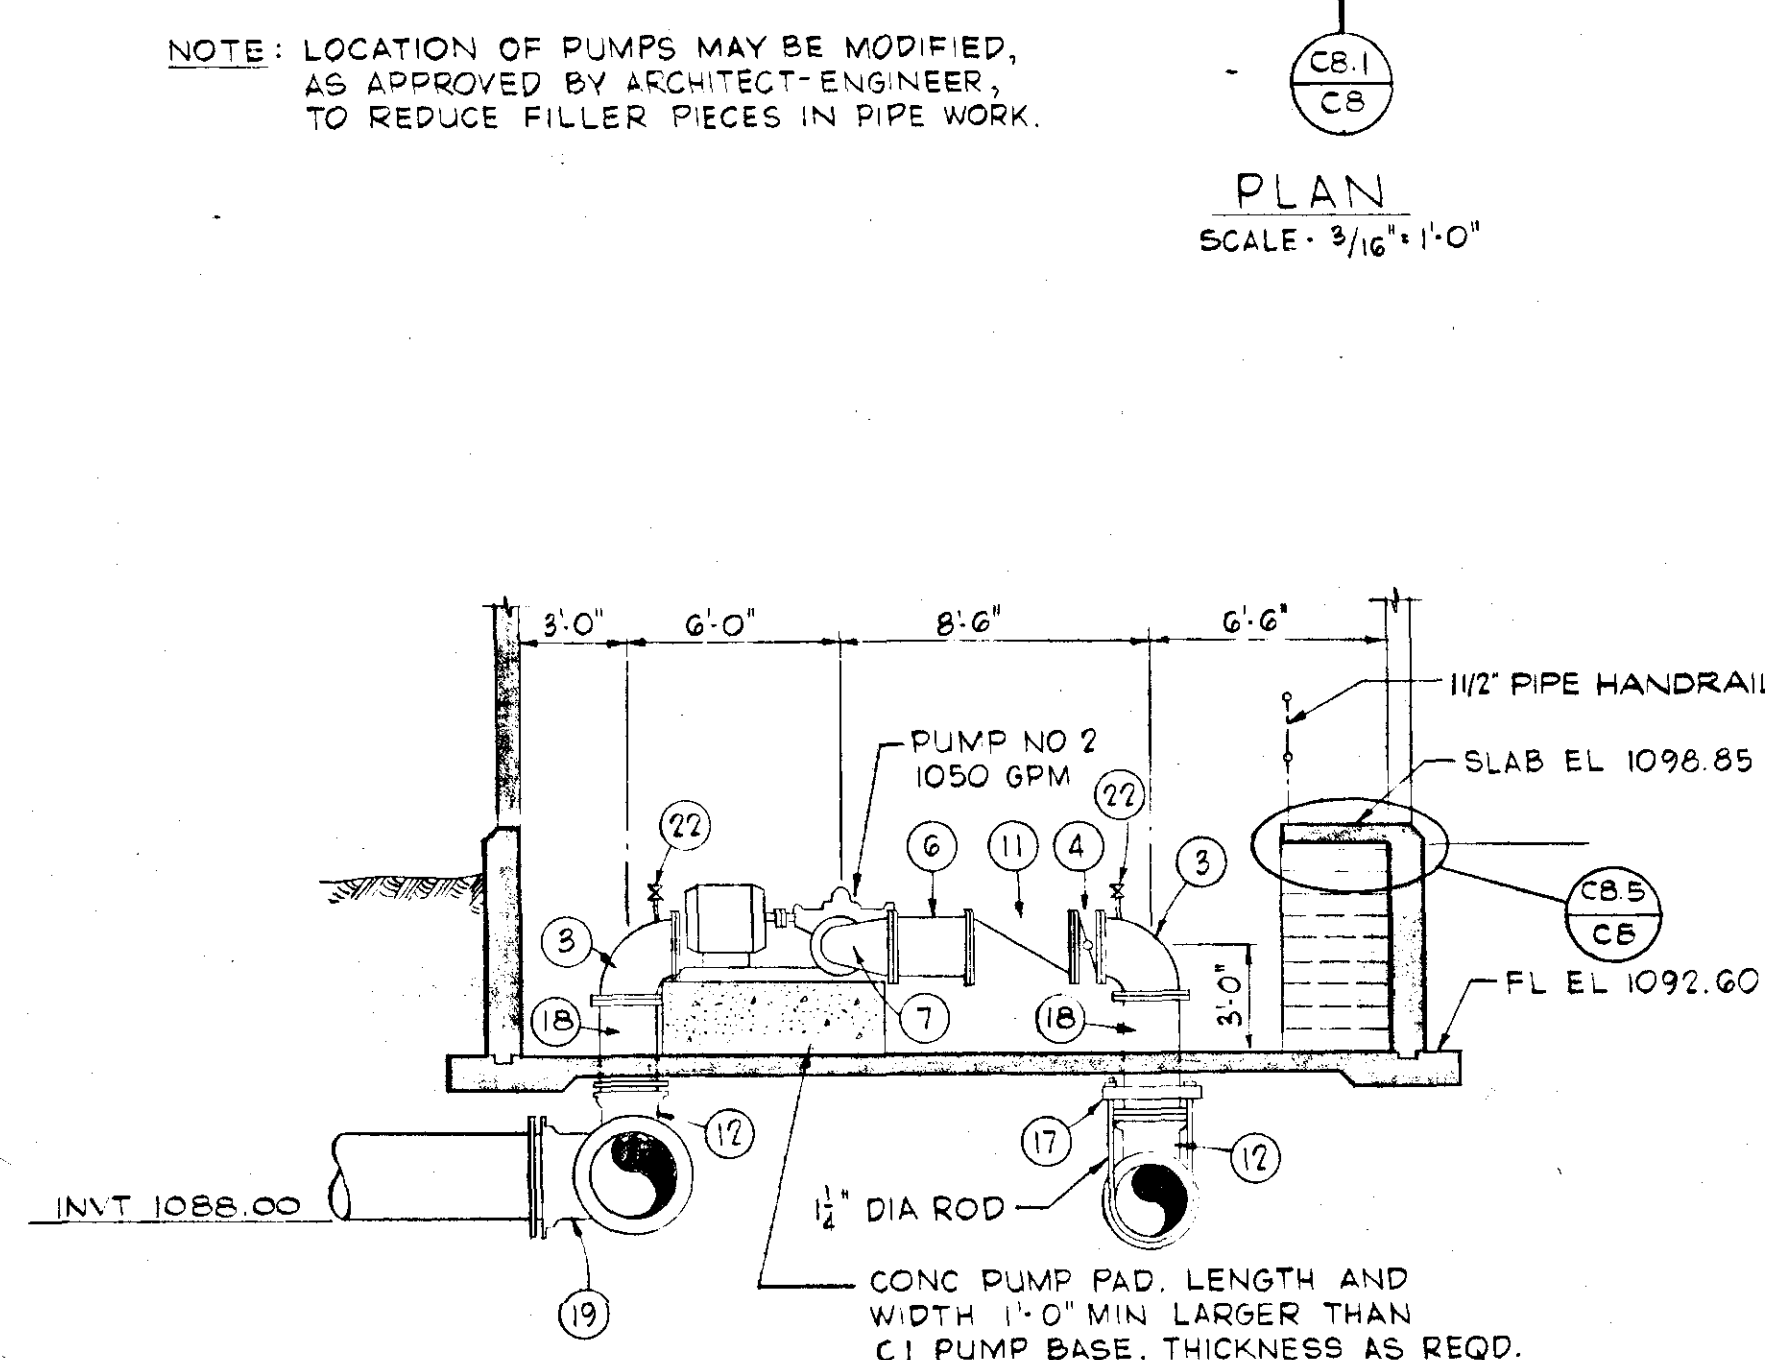
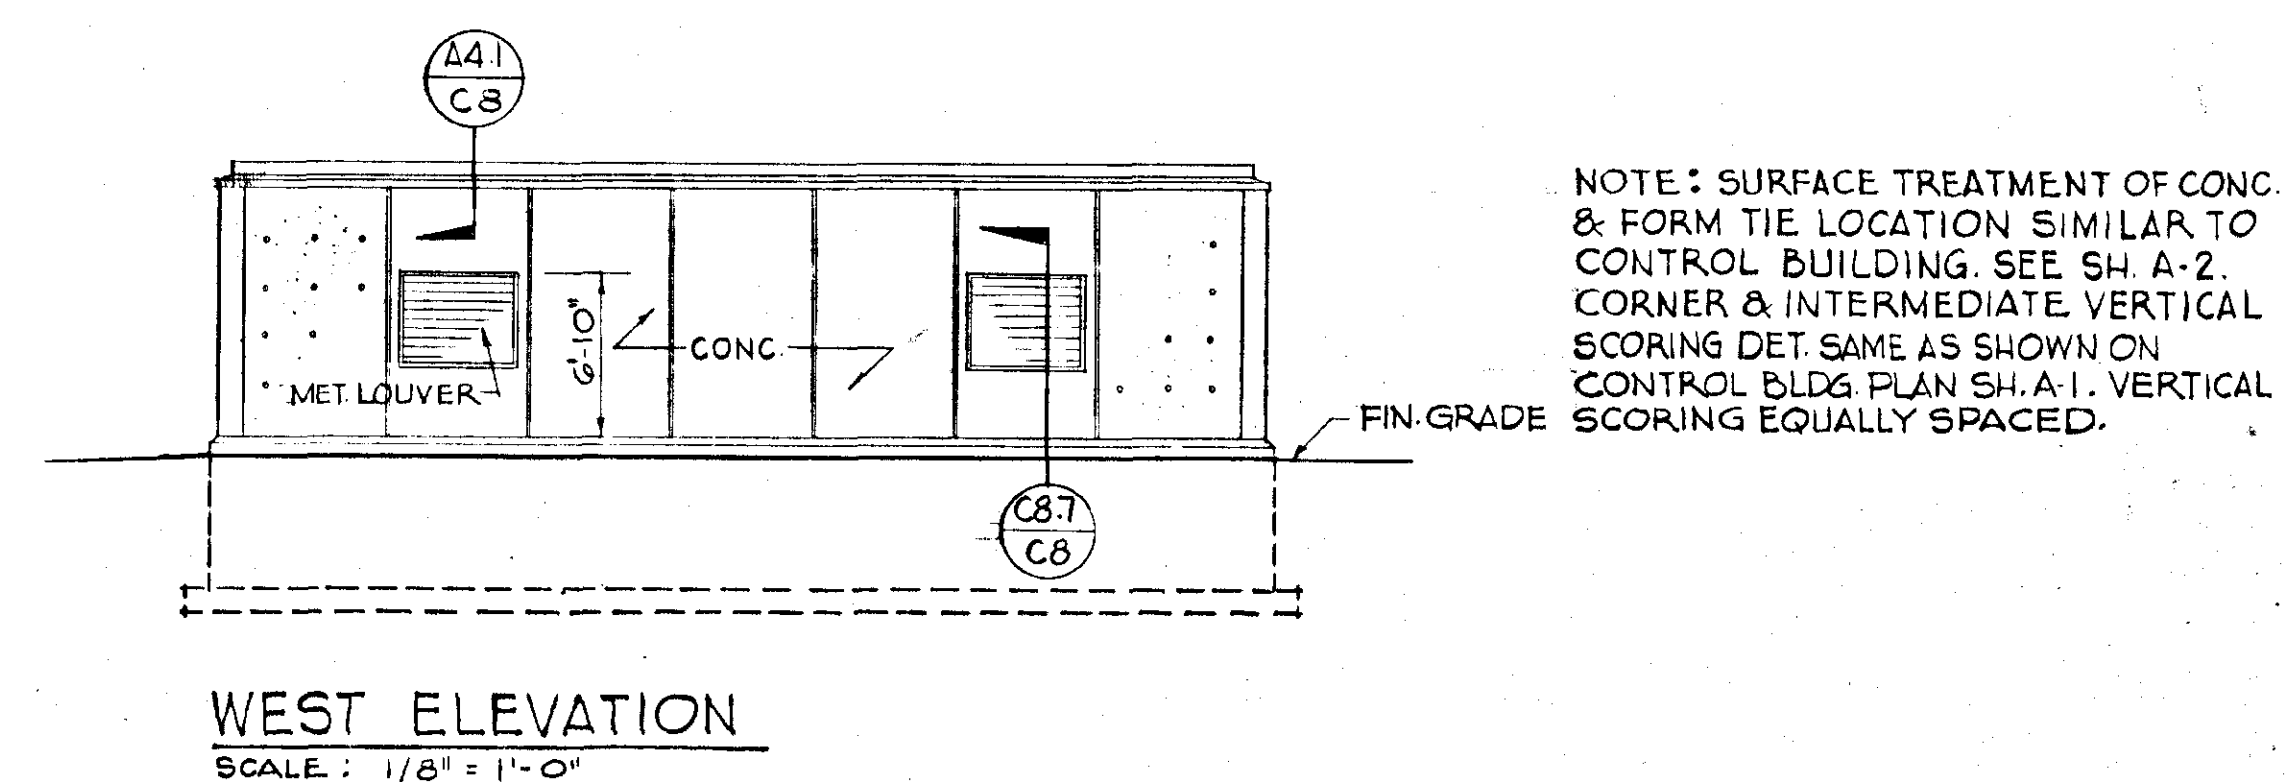
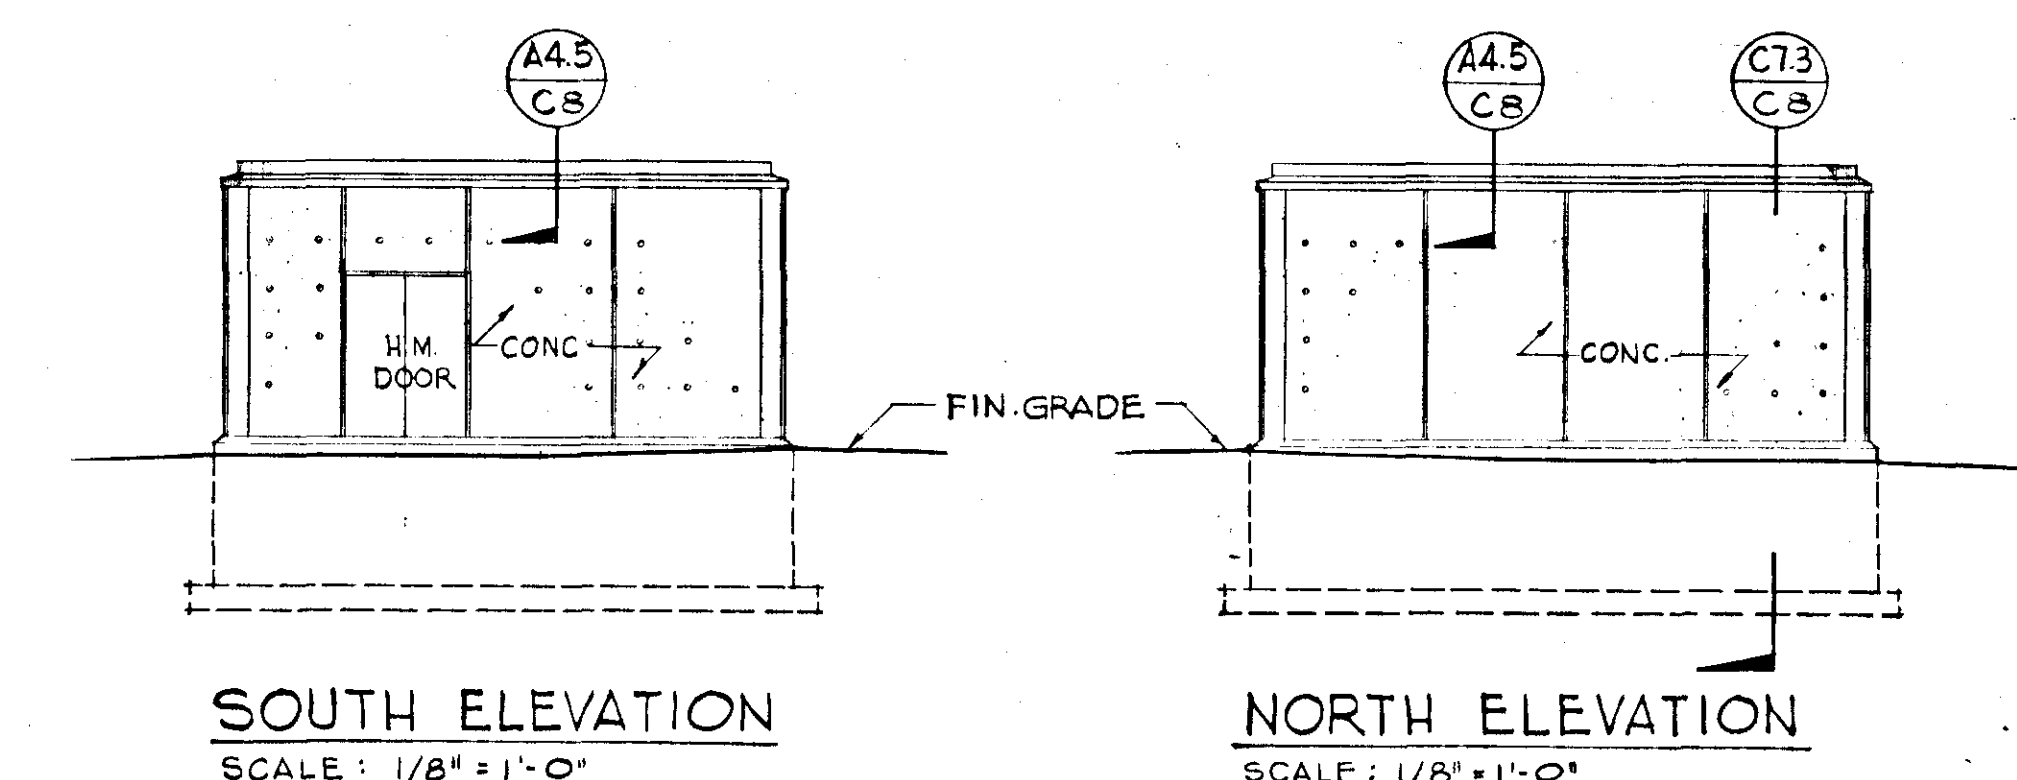
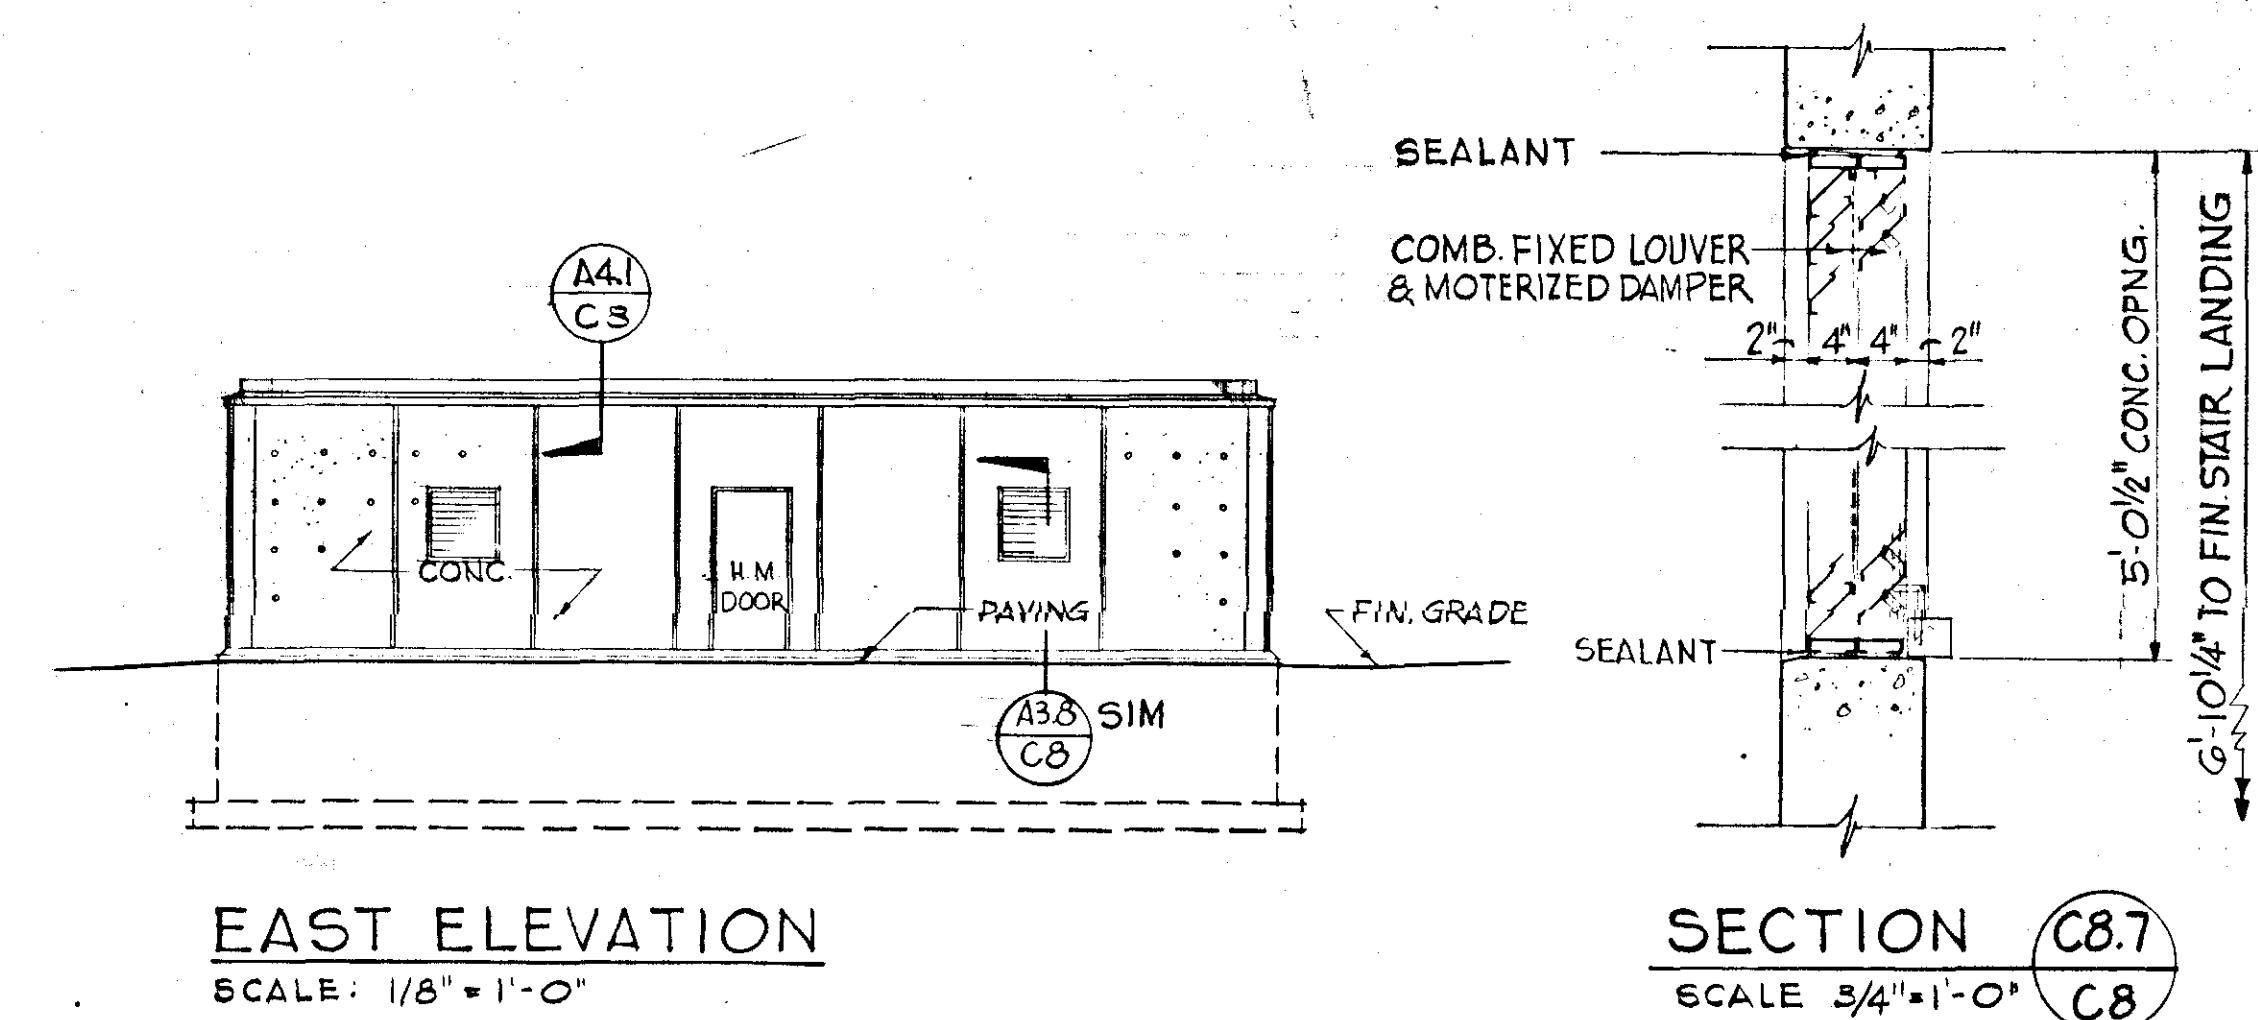
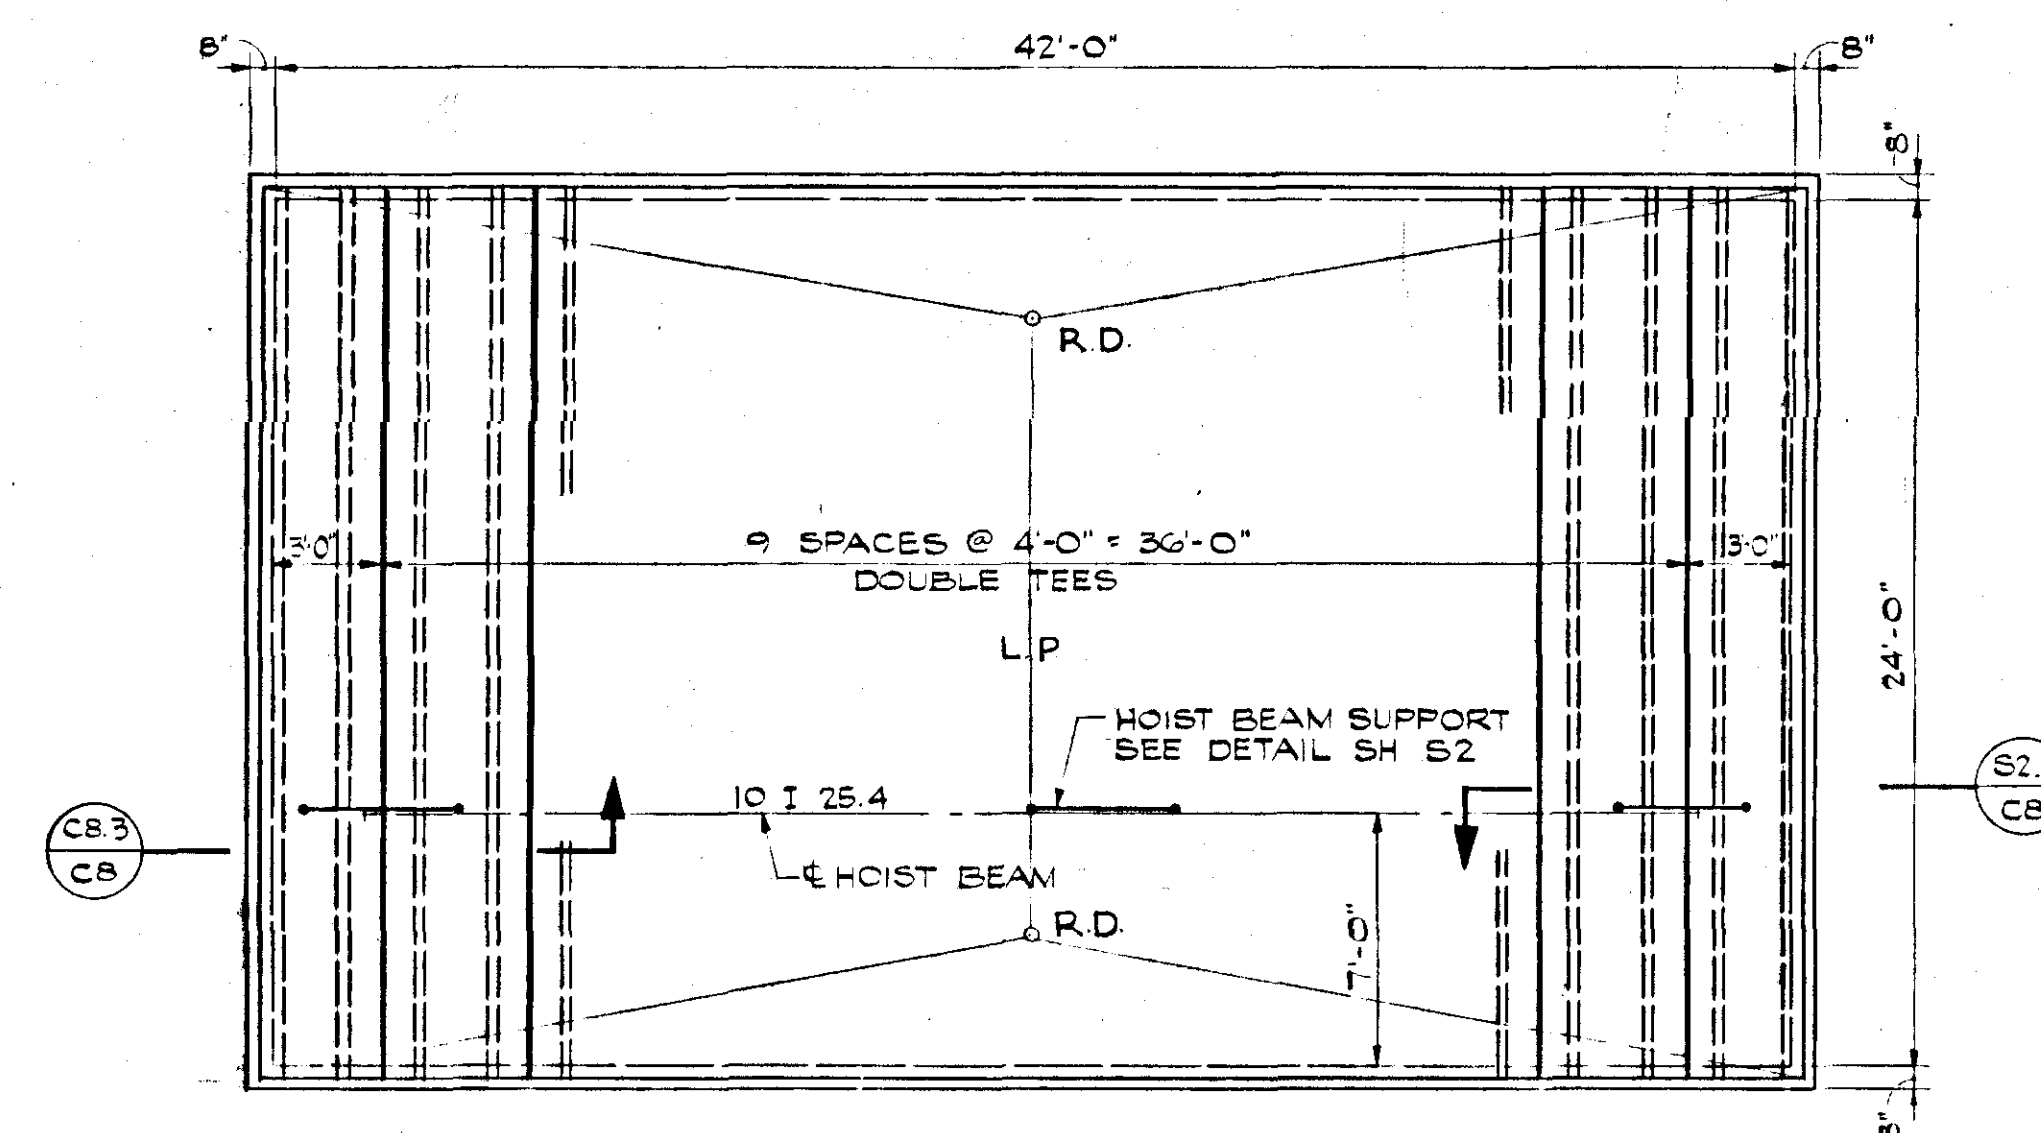


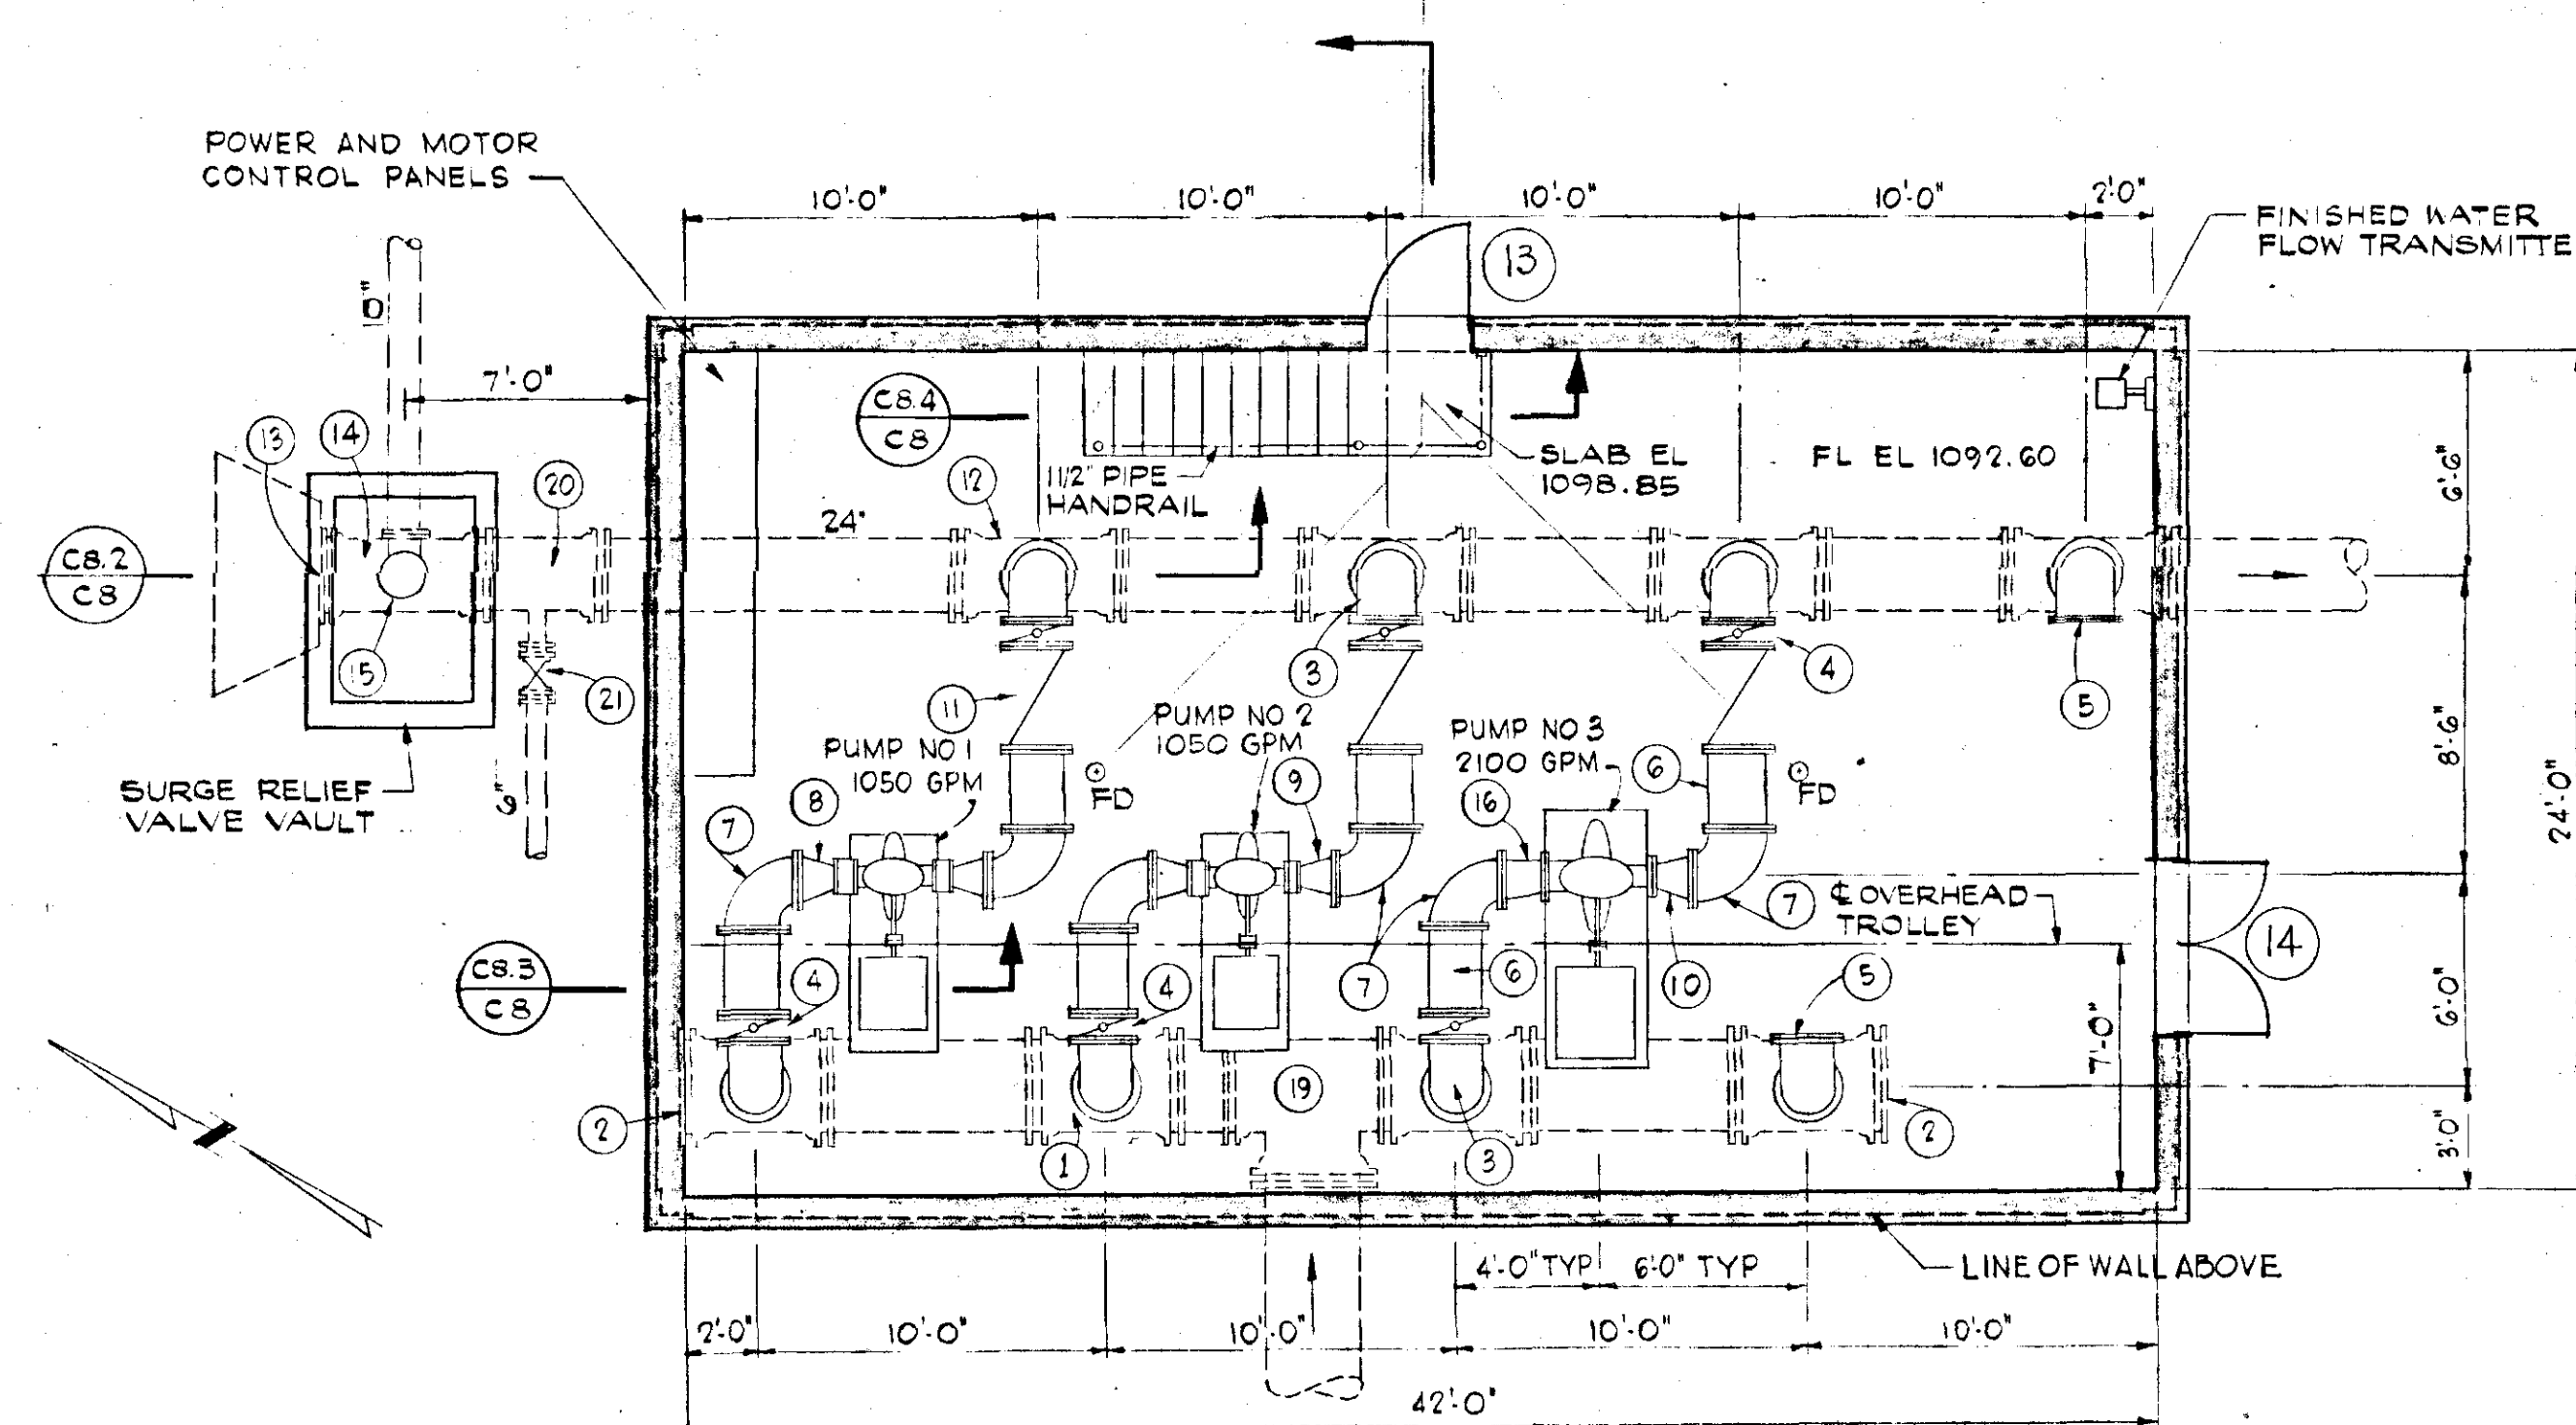

VALVE & FITTING SCHEDULE	
MARK	DESCRIPTION
1	30"x18" MJ TEE
2	30" MJ PLUG
3	18" FLG 90° BEND
4	18" FLG BUTTERFLY VALVE W/ HANDWHEEL OPERATOR
5	18" BLIND FLANGE
6	18" FLG FILLER PIECE AND FLEXIBLE COUPLING
7	18"x12" FLG CONCENTRIC REDUCING 90° BEND
8	12"x6" FLG CONCENTRIC REDUCER
9	12"x5" FLG CONCENTRIC REDUCER
10	12"x8" FLG CONCENTRIC REDUCER
11	18" FLG CHECK VALVE
12	24"x18" MJ TEE
13	24" MJ PLUG
14	24"x10" MJ TEE
15	10" FLG SURGE RELIEF VALVE
16	12"x10" FLG CONCENTRIC REDUCER
17	PIPE STRAPS
18	18" MJ-FLG FILLER PIECE
19	30" MJ TEE
20	24"x6" MJ TEE
21	6" MJ BURIED GATE VALVE W/ 2" OPERATING NUT AND VALVE BOX
22	3/4" PIPE TAP W/ GLOBE VALVE

REVISION	DATE	DESCRIPTION	BY	APP.
DESIGNED	W.C.			
DRAWN	J. GOV			
CHECKED				
APPROVED				
SUBMITTED	4/2/70			
WATER FILTRATION PLANT				
CITY OF SALEM, VIRGINIA				
CIVIL				
SERVICE PUMPING STATION AND VALVE VAULTS				
HAYES, SEAY, MATTERN & MATTERN ARCHITECTS — ENGINEERS			SCALE AS NOTED	COMM. NO. 3627-A
			DATE APRIL 1970	SHEET C-8