

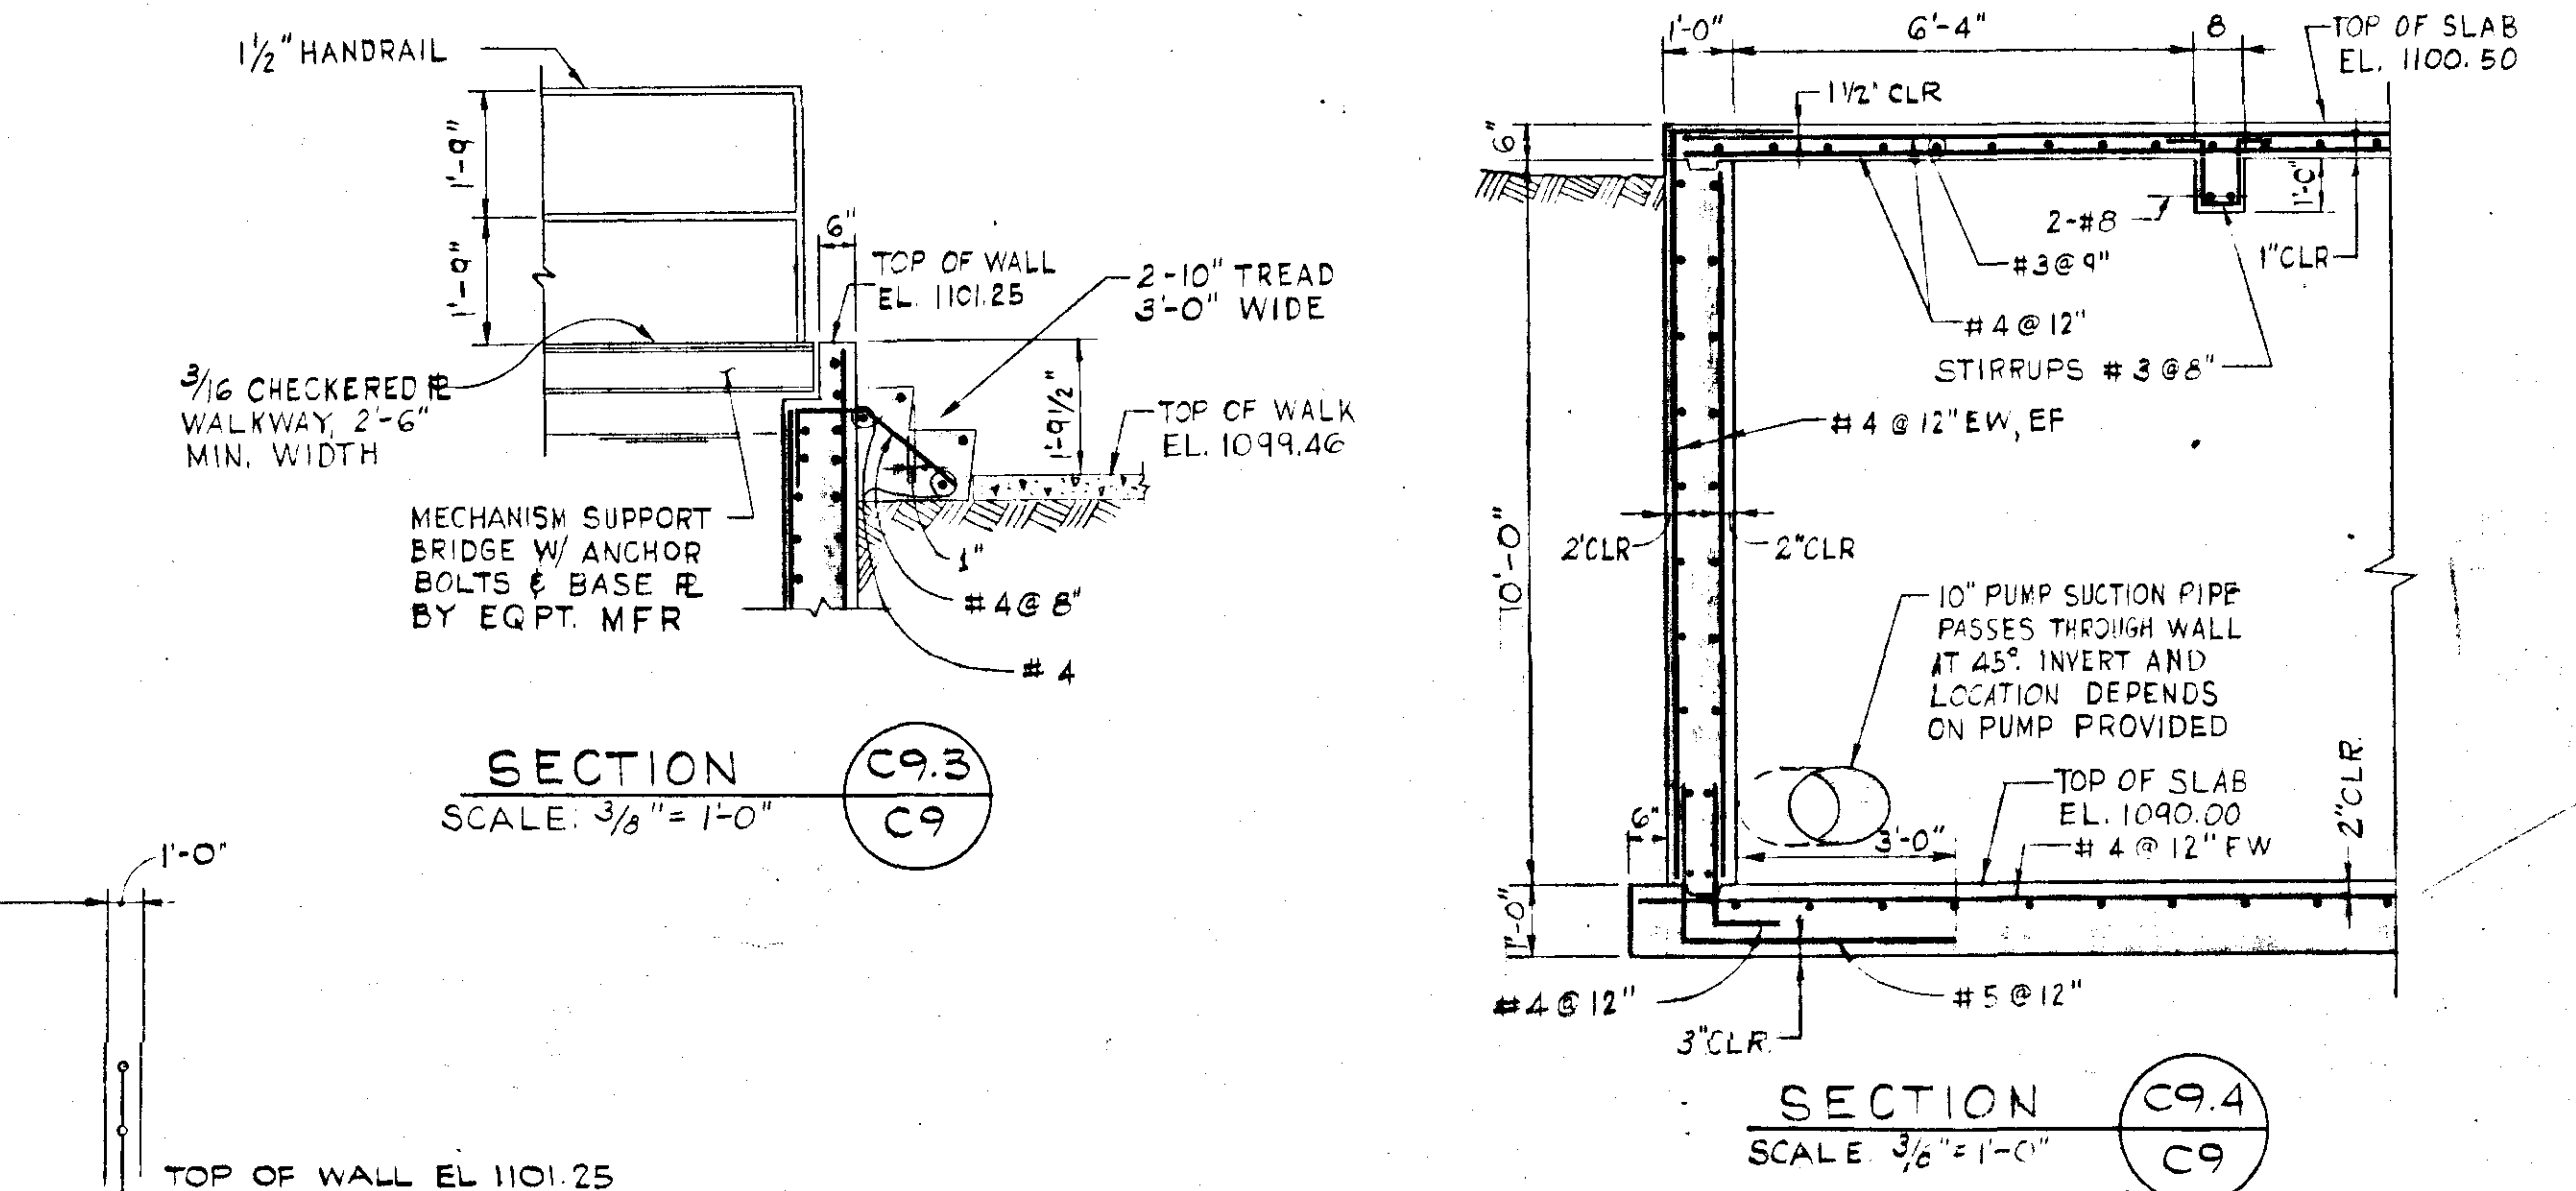


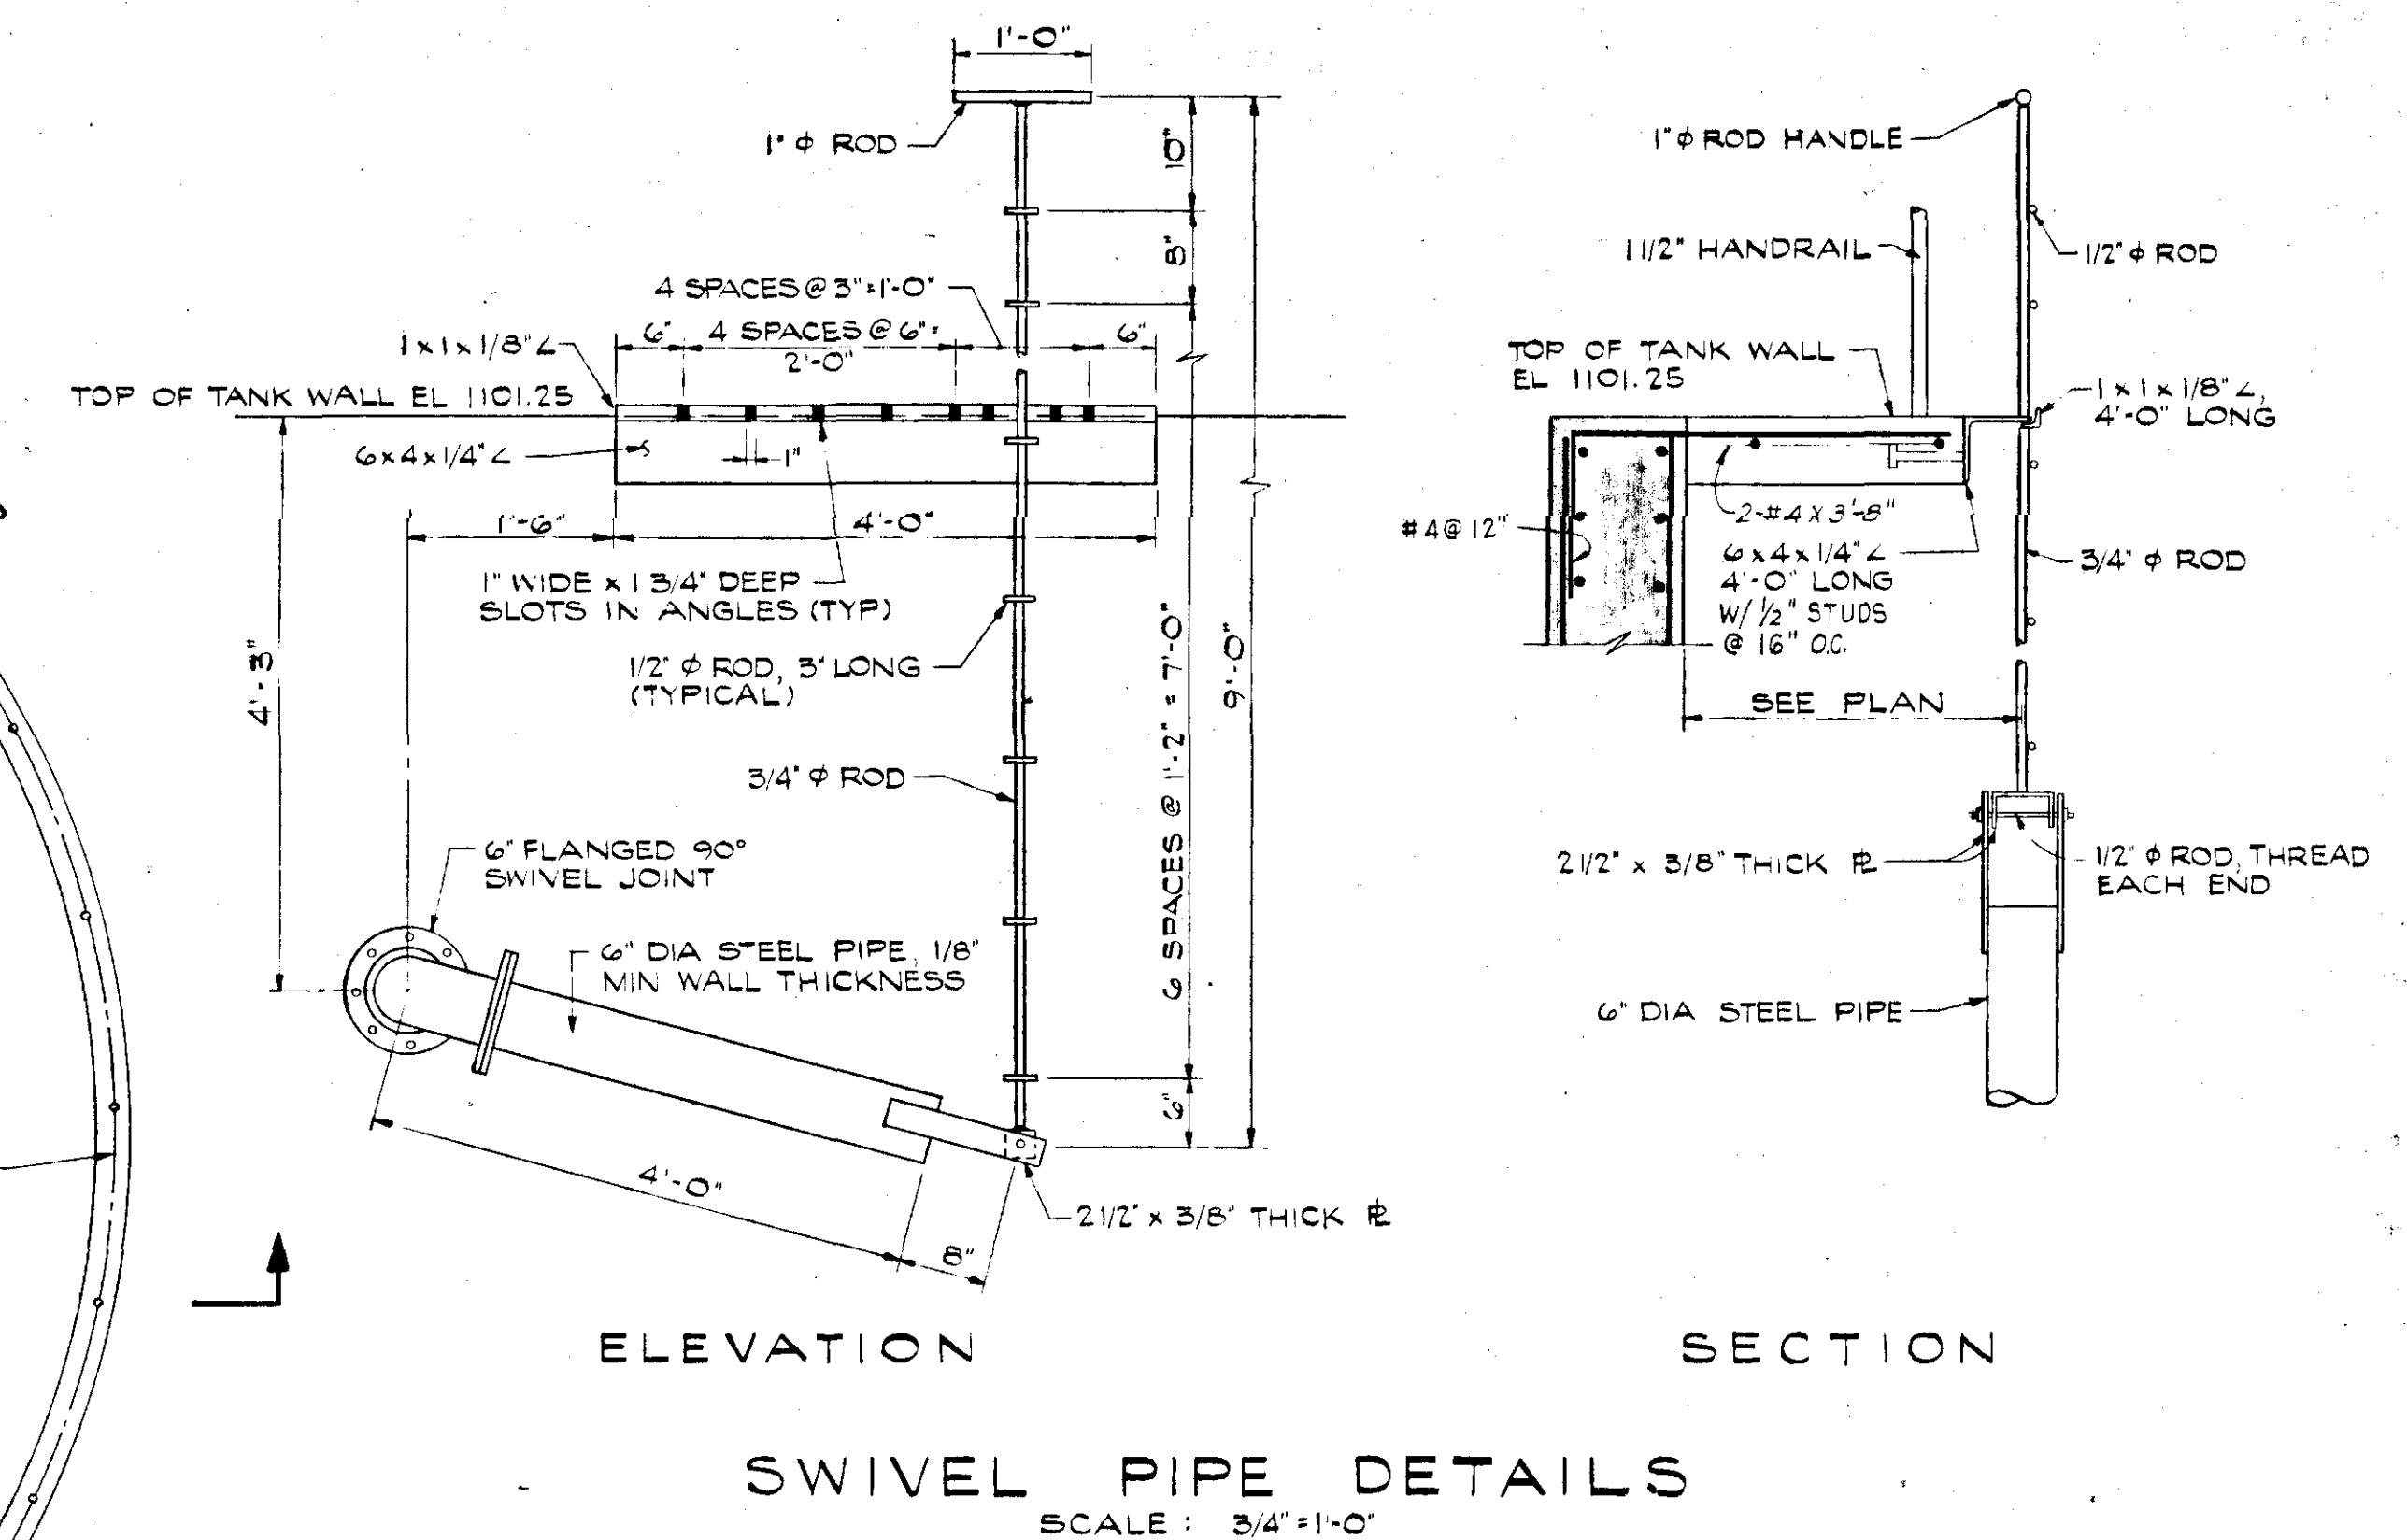

| VALVE & FITTING SCHEDULE |                                                              |      |                                    |
|--------------------------|--------------------------------------------------------------|------|------------------------------------|
| MARK                     | DESCRIPTION                                                  | MARK | DESCRIPTION                        |
| (1)                      | 10" FLG GATE VALVE W/HANDWHEEL OPERATOR                      | (12) | 6" FLG 90° BEND                    |
| (2)                      | 10"x8" FLG CONCENTRIC REDUCER                                | (13) | 4" CI WALL SLEEVE                  |
| (3)                      | 10"x6" FLG CONCENTRIC REDUCER                                | (14) | 6" FLG 90° SWIVEL JOINT            |
| (4)                      | 10" FLG CHECK VALVE                                          | (15) | 4" FLG 90° BEND                    |
| (5)                      | 10" CI WALL SLEEVE                                           | (16) | 6" MJ 90° BEND                     |
| (6)                      | 6" CI WALL SLEEVE                                            | (17) | 24" CI WALL SLEEVE                 |
| (7)                      | 4" FLG PLUG VALVE W/EXTENSION STEM AND OPERATING FLOOR STAND | (18) | 4" FLG PLUG VALVE W/LEVER OPERATOR |
| (8)                      | 6" FLG PLUG VALVE W/EXTENSION STEM AND OPERATING FLOOR STAND | (19) | 1 1/4" STEEL WALL SLEEVE           |
| (9)                      | 6"x6" FLG TEE                                                | (20) | 10" FLG 90° BEND                   |
| (10)                     | 4"x4" FLG TEE                                                | (21) | 10" x 4" FLG TEE                   |
| (11)                     | 6"x4" FLG CROSS                                              | (22) | 10" BLIND FLG                      |

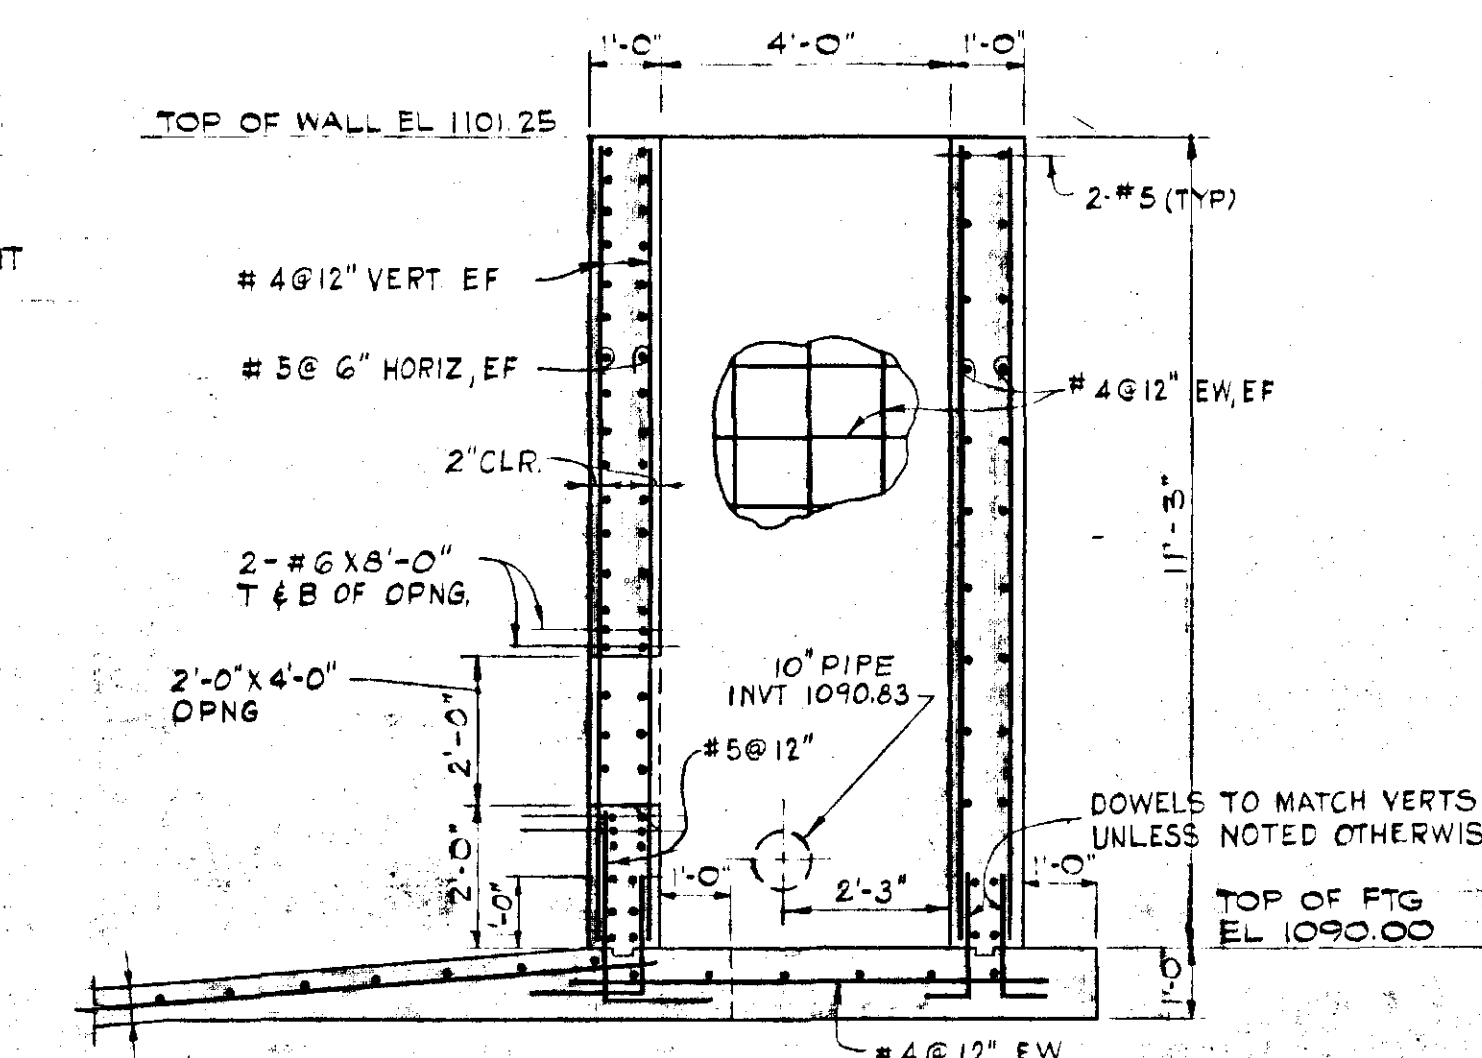

SECTION C9.5  
SCALE: 3/8" = 1'-0" C9

|  |  |  |  |  |  |
|--|--|--|--|--|--|
|  |  |  |  |  |  |
|  |  |  |  |  |  |
|  |  |  |  |  |  |
|  |  |  |  |  |  |
|  |  |  |  |  |  |
|  |  |  |  |  |  |

| REVISION  | DATE        | DESCRIPTION                                           | BY | AUTH. |
|-----------|-------------|-------------------------------------------------------|----|-------|
| DESIGNED  | RRC         | WATER FILTRATION PLANT<br><br>CITY OF SALEM, VIRGINIA |    |       |
| DRAWN     | JT          |                                                       |    |       |
| CHECKED   | SARL        |                                                       |    |       |
| APPROVED  | [Signature] |                                                       |    |       |
| SUBMITTED | 11-8-70     | HOLDING TANKS                                         |    |       |

|                                                                     |                 |                     |
|---------------------------------------------------------------------|-----------------|---------------------|
| <b>HAYES, SEAY, MATTERN &amp; MATTERN</b><br>ARCHITECTS — ENGINEERS | SCALE AS NOTED  | COMM.<br>NO. 3627-A |
|                                                                     | DATE APRIL 1970 | SHEET C-9           |