
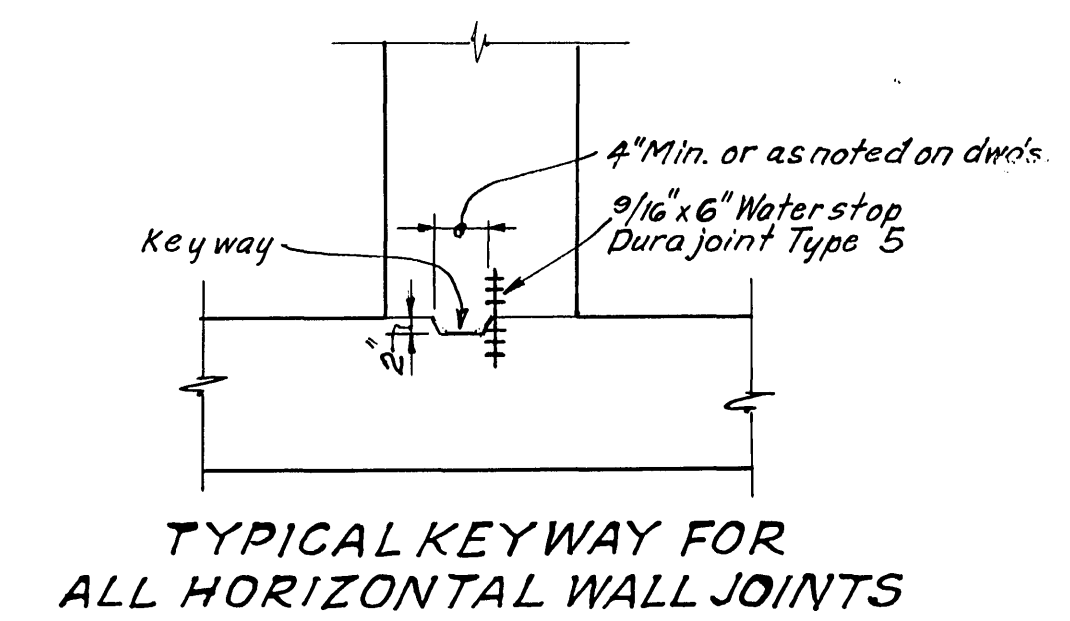
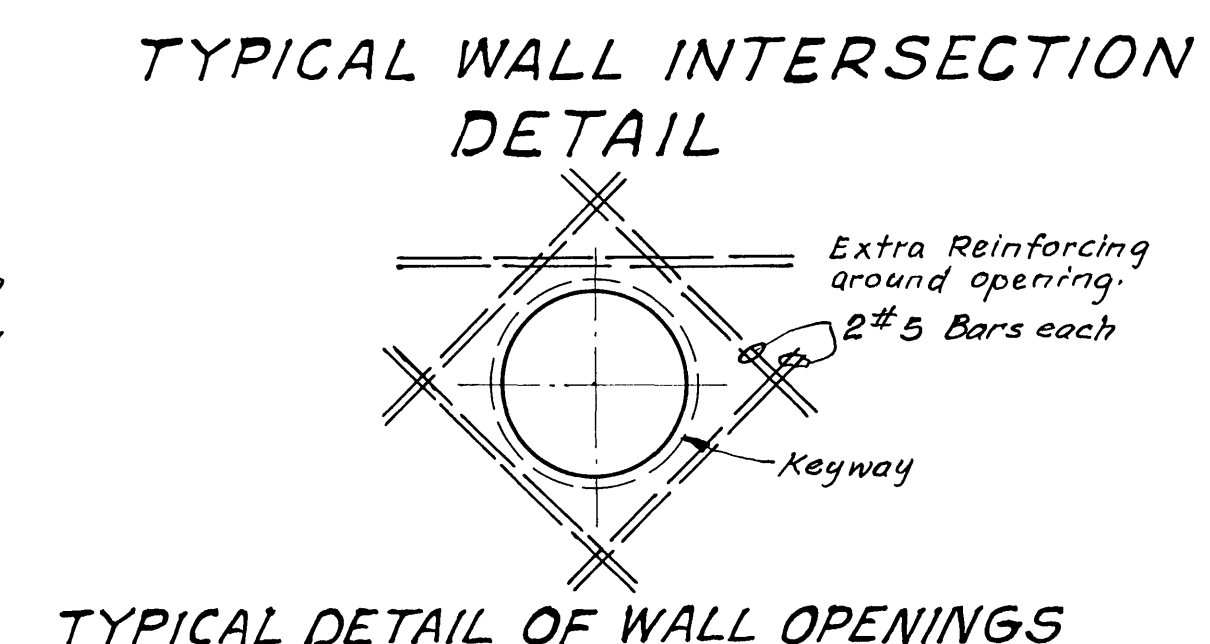
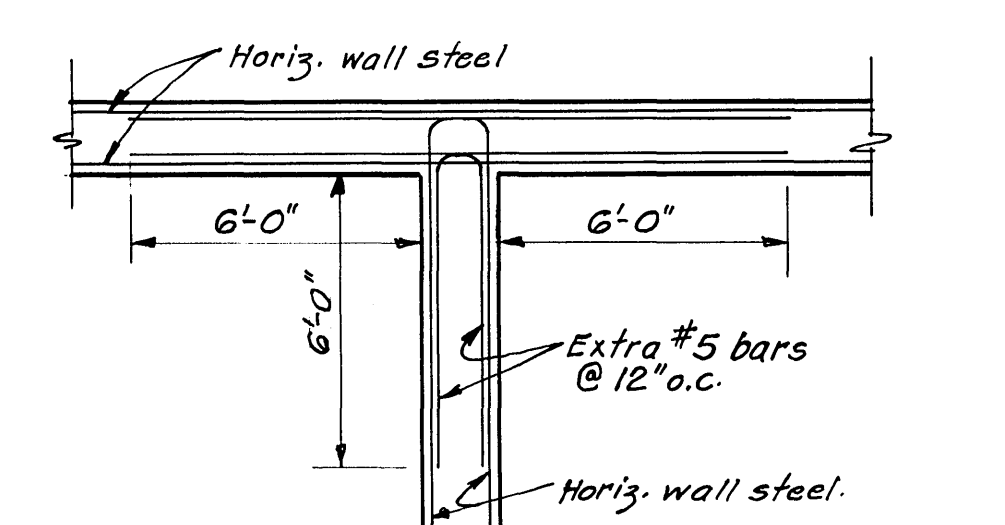
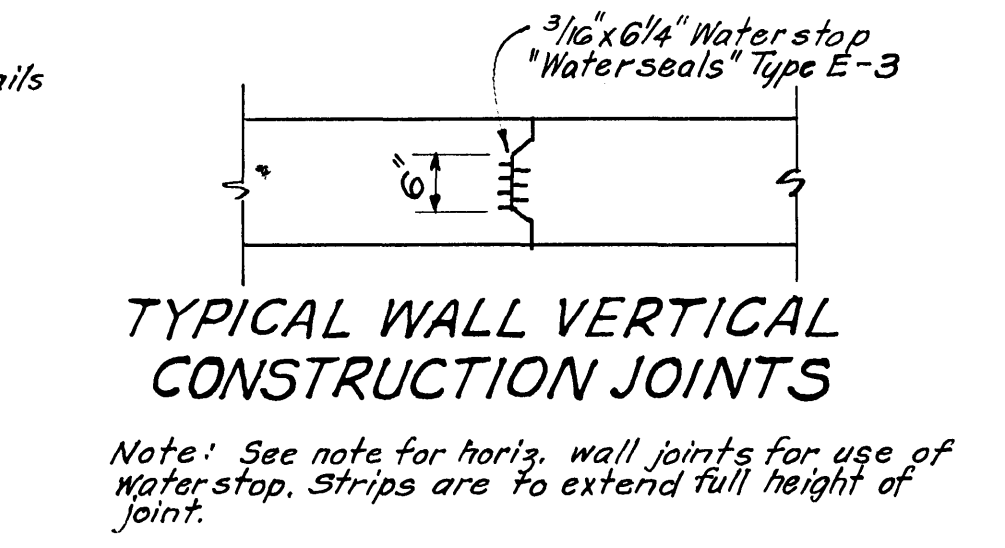
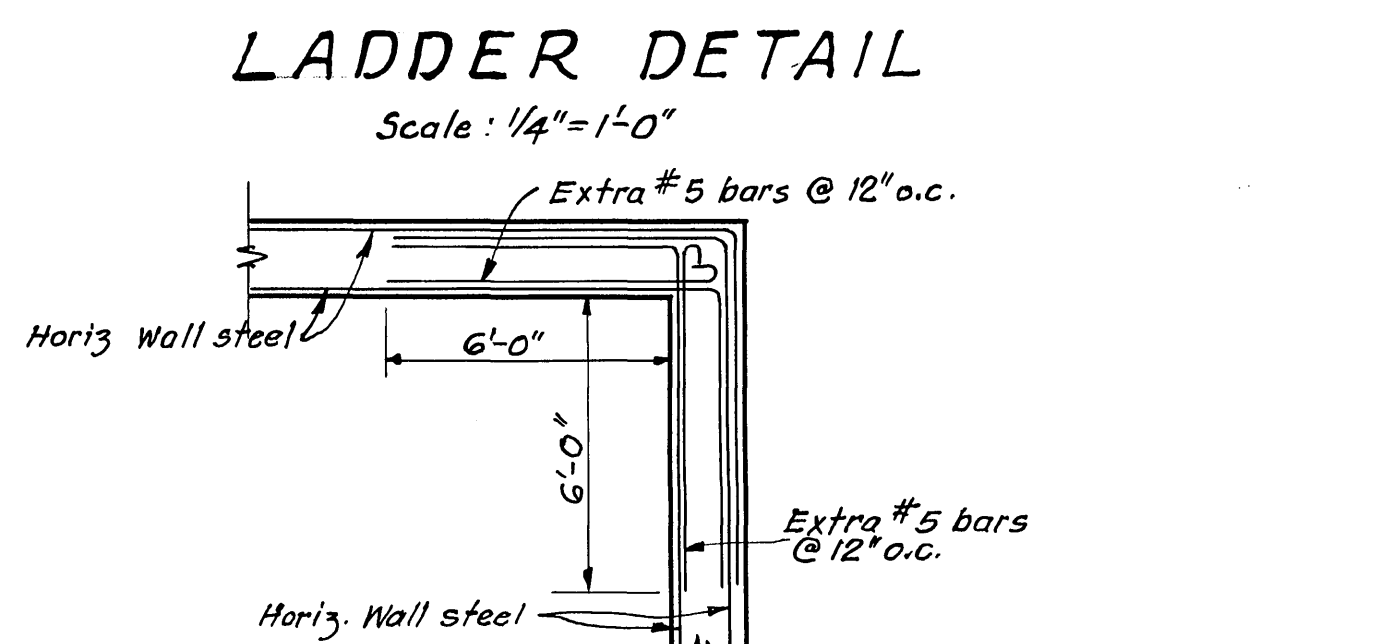
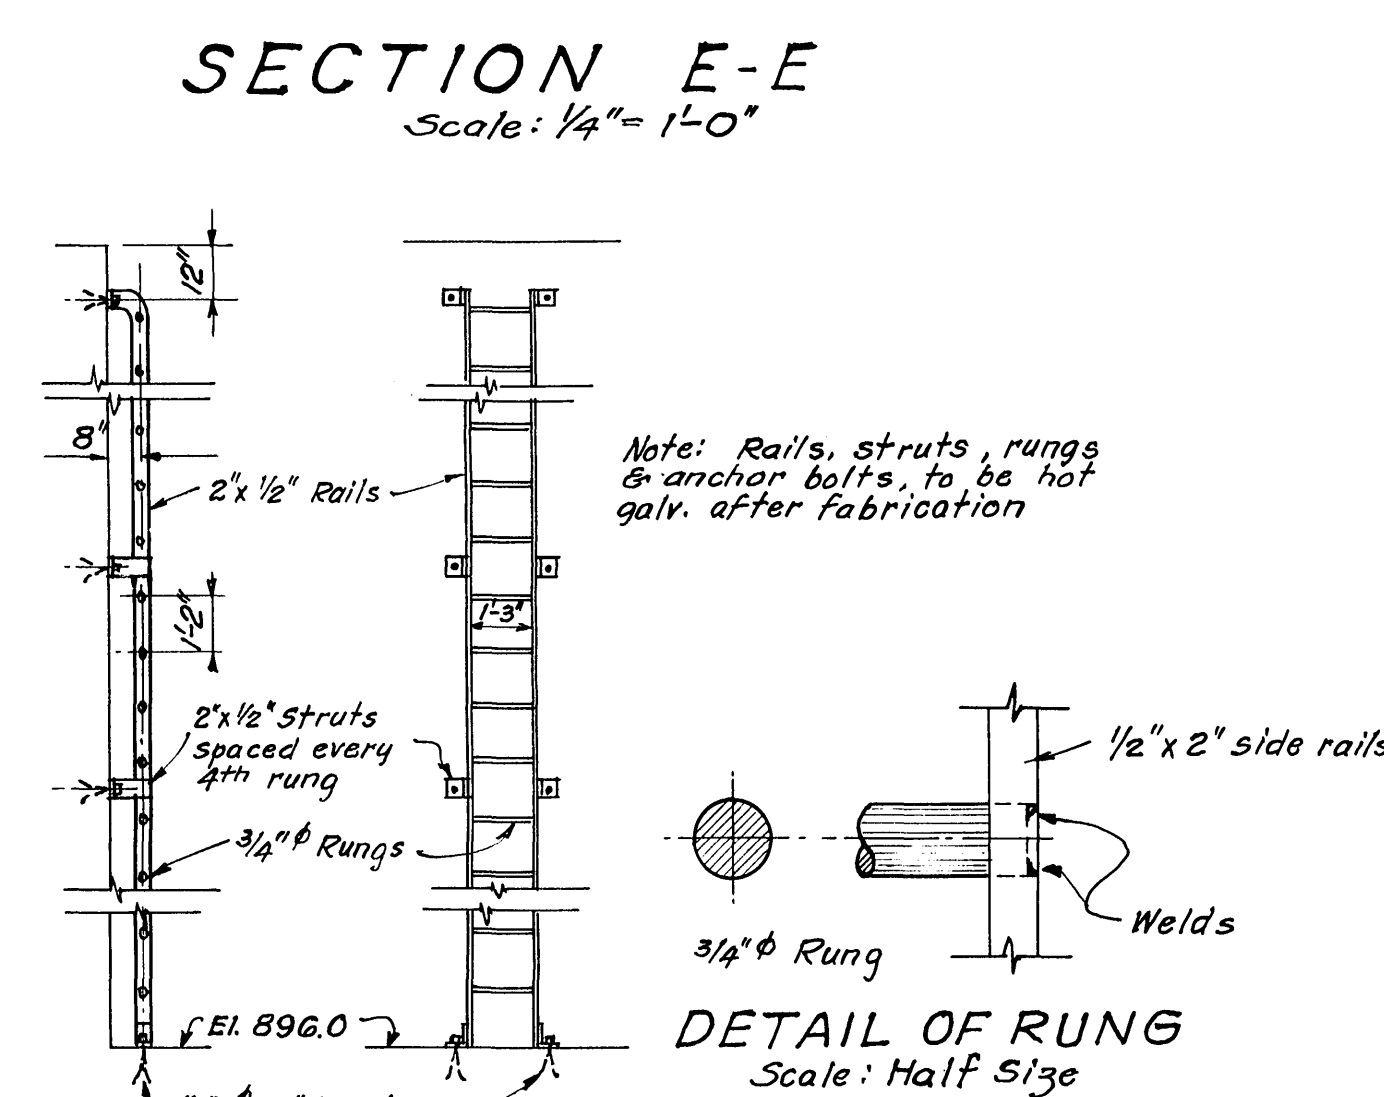
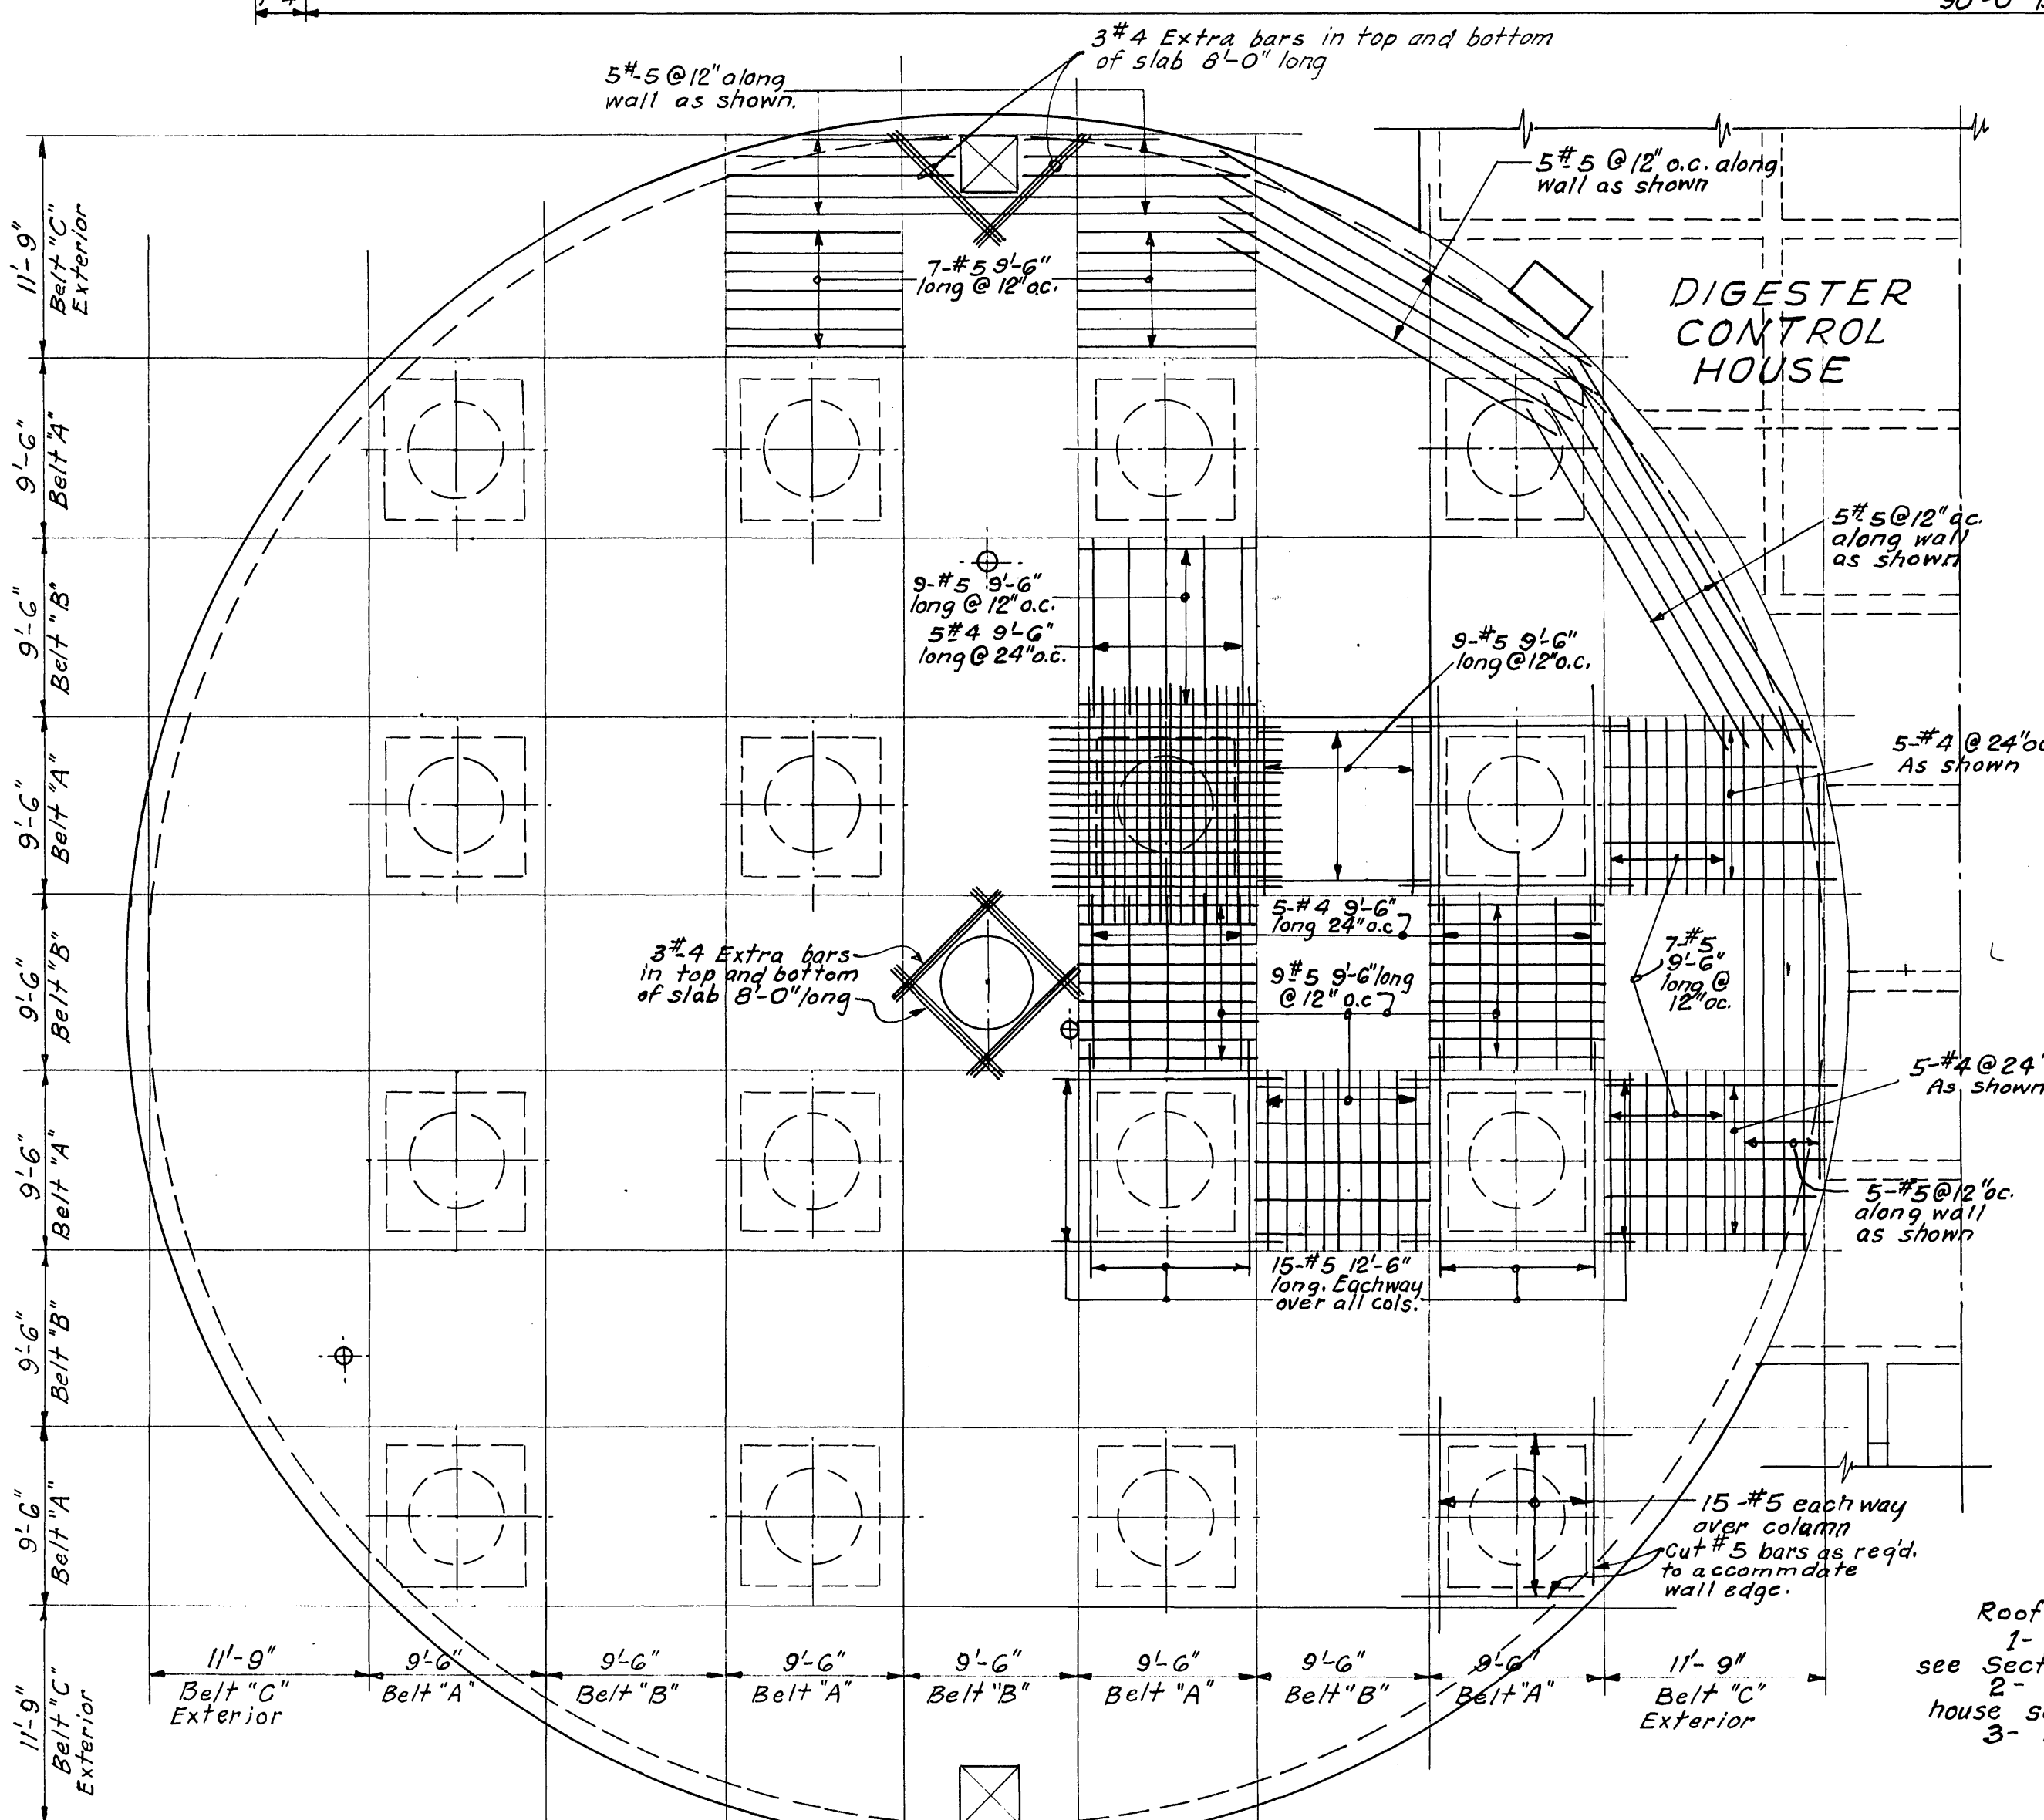
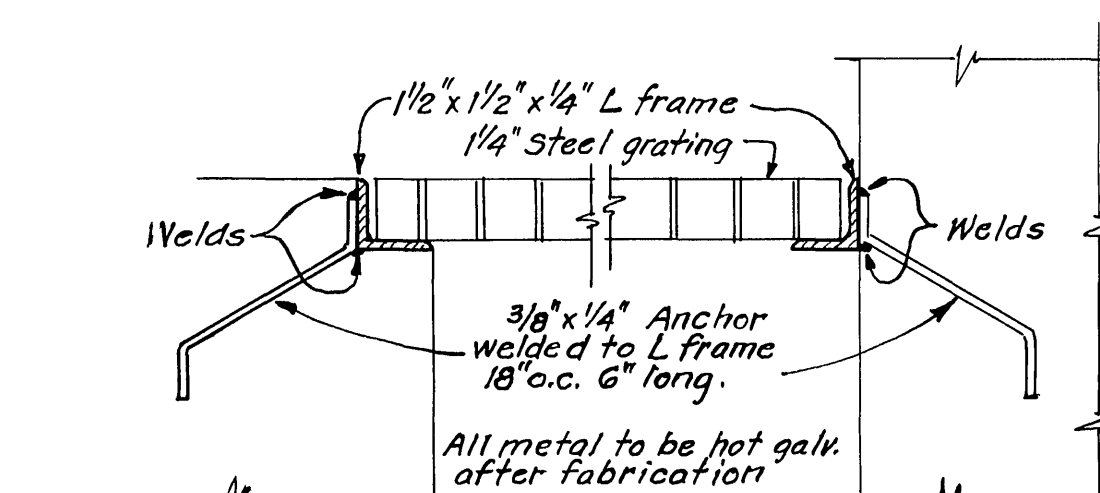
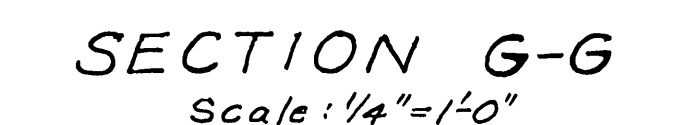
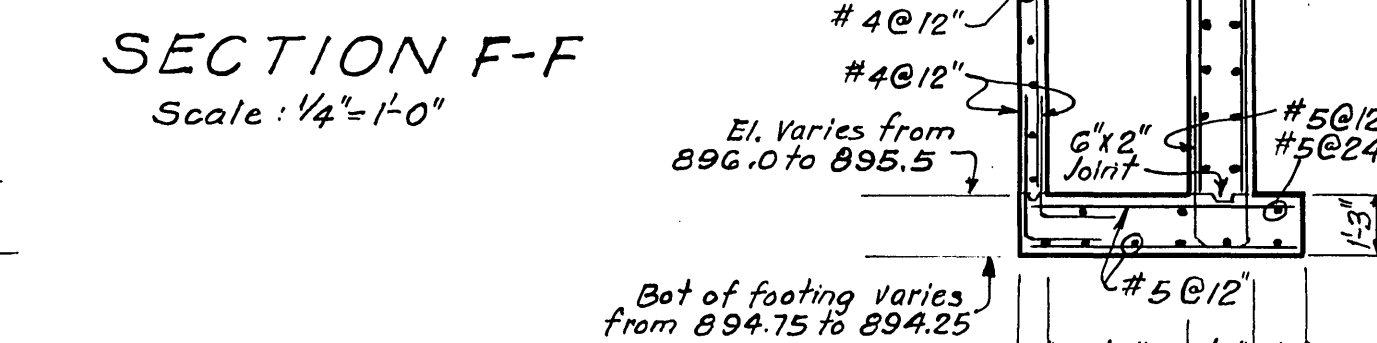


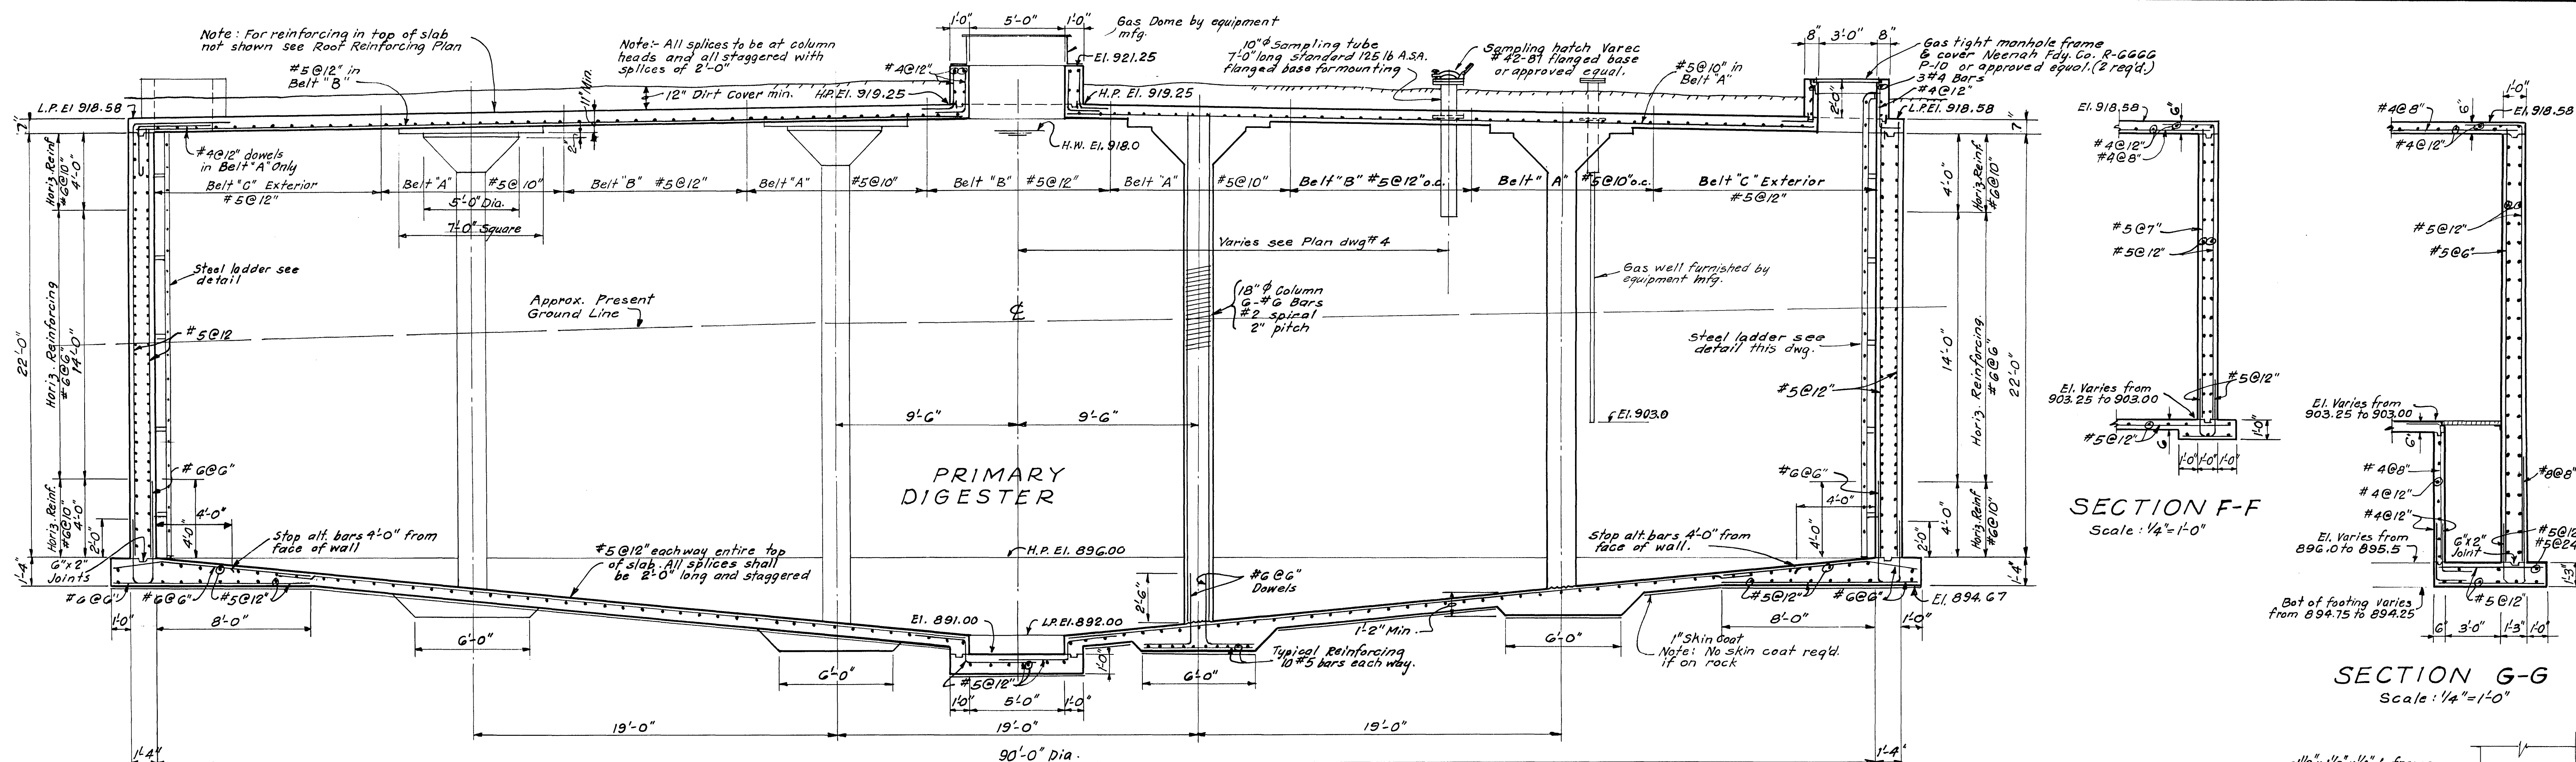

Roof reinforcing notes
 1- For #4 extra dowels for belt 'A' and #5 dowels from wall not shown
 see Section E-E this dwg.
 2- For Extra reinforcing in top of slab between digester and control
 house see Top of Concrete Plan, dwg #4
 3- For reinforcing in bottom of slab see Section E-E this dwg.

Note :
 Waterstop strip to be used in joints of walls of water containing structures,
 1) Where wall is between structure and a dry room of gallery.
 2) Where joint is in an outside wall between structure and ground
 Waterstop strip to be used in all dry rooms or gallery construction joints.
 Waterstop strips are to be continuous by fusing strips together. **DO NOT OVERLAP**

ADDITIONS TO SEWAGE TREATMENT PLANT
ROANOKE, VIRGINIA

*SLUDGE DIGESTERS
SECTIONS AND DETAILS*



ALYORD, BURDICK & HOWSON
ENGINEERS CHICAGO

1966