

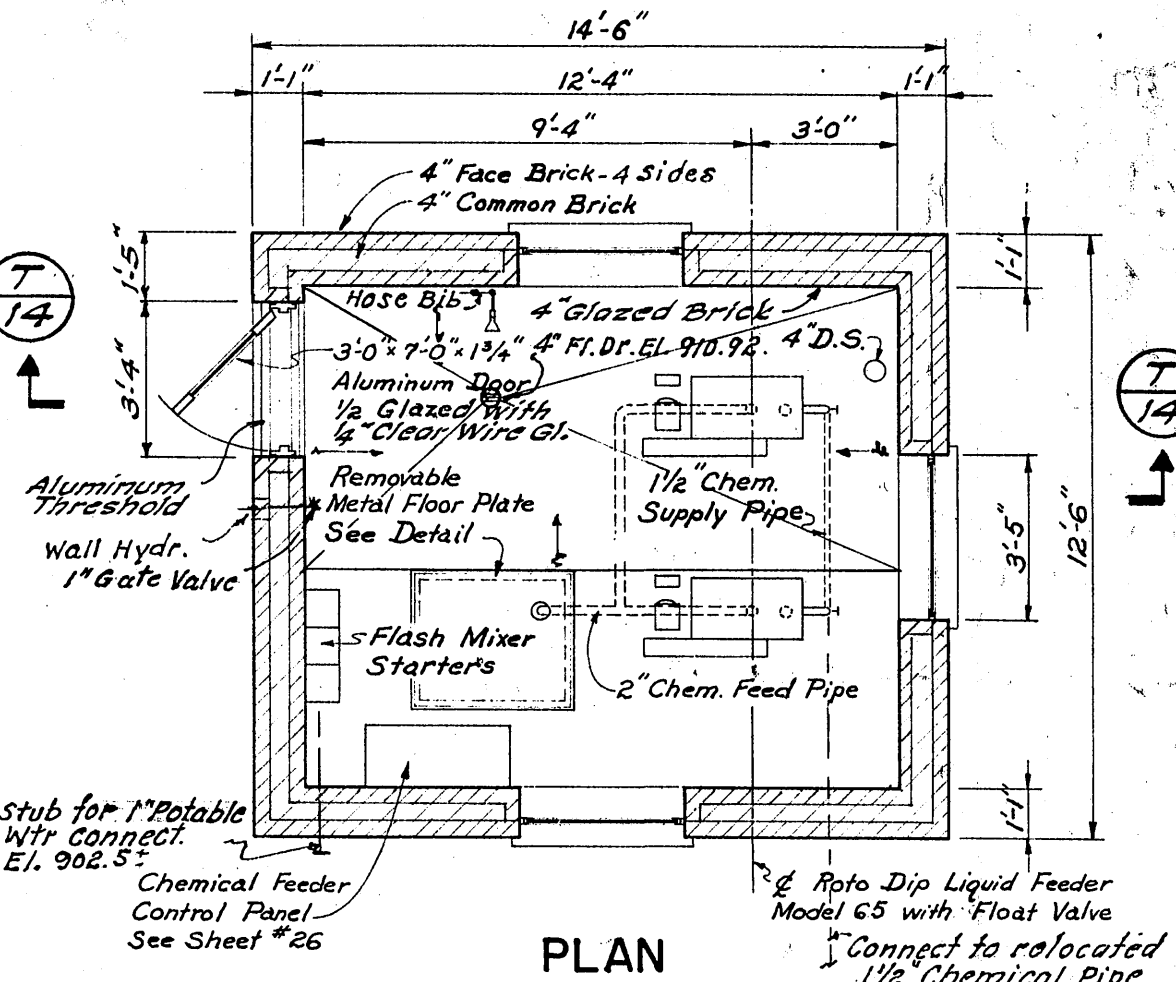
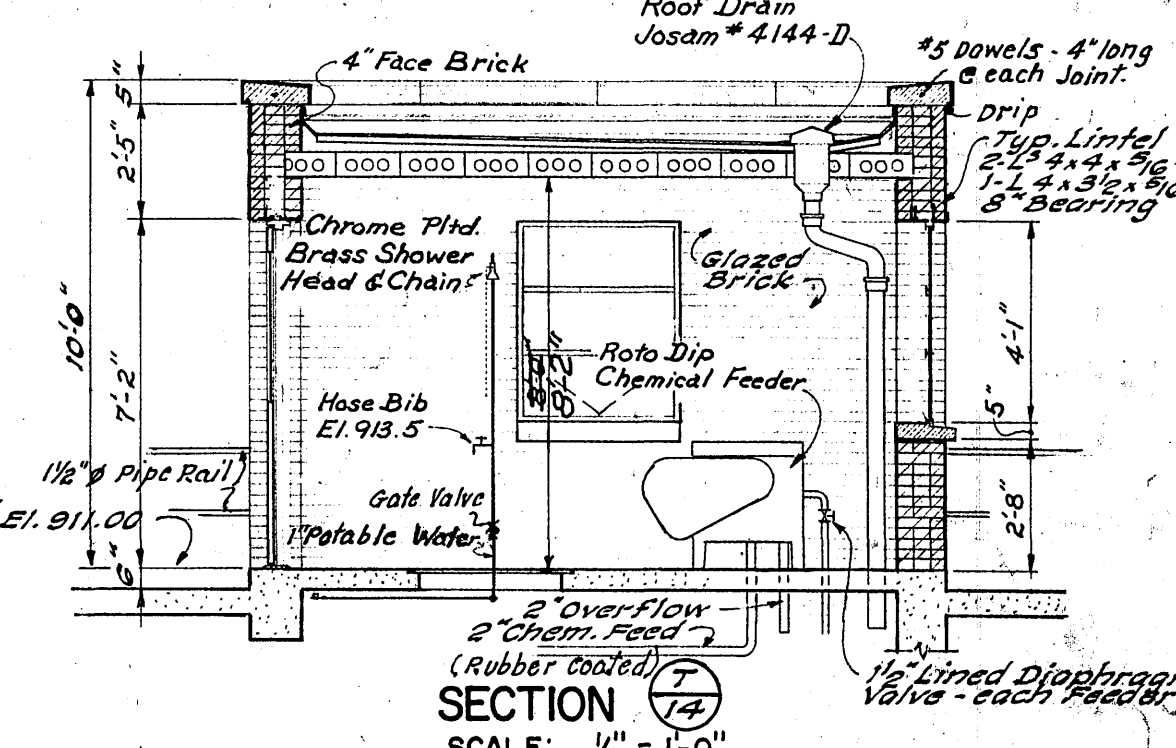
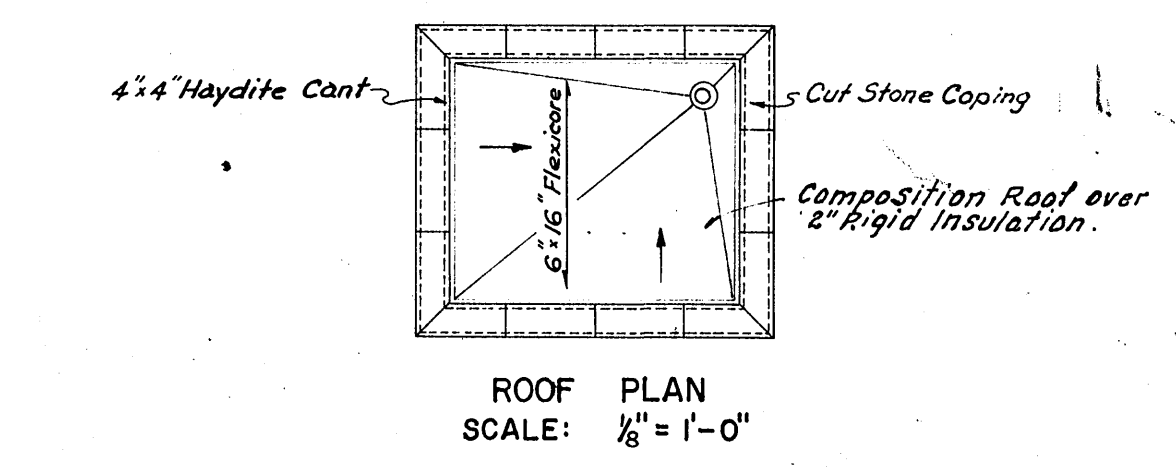
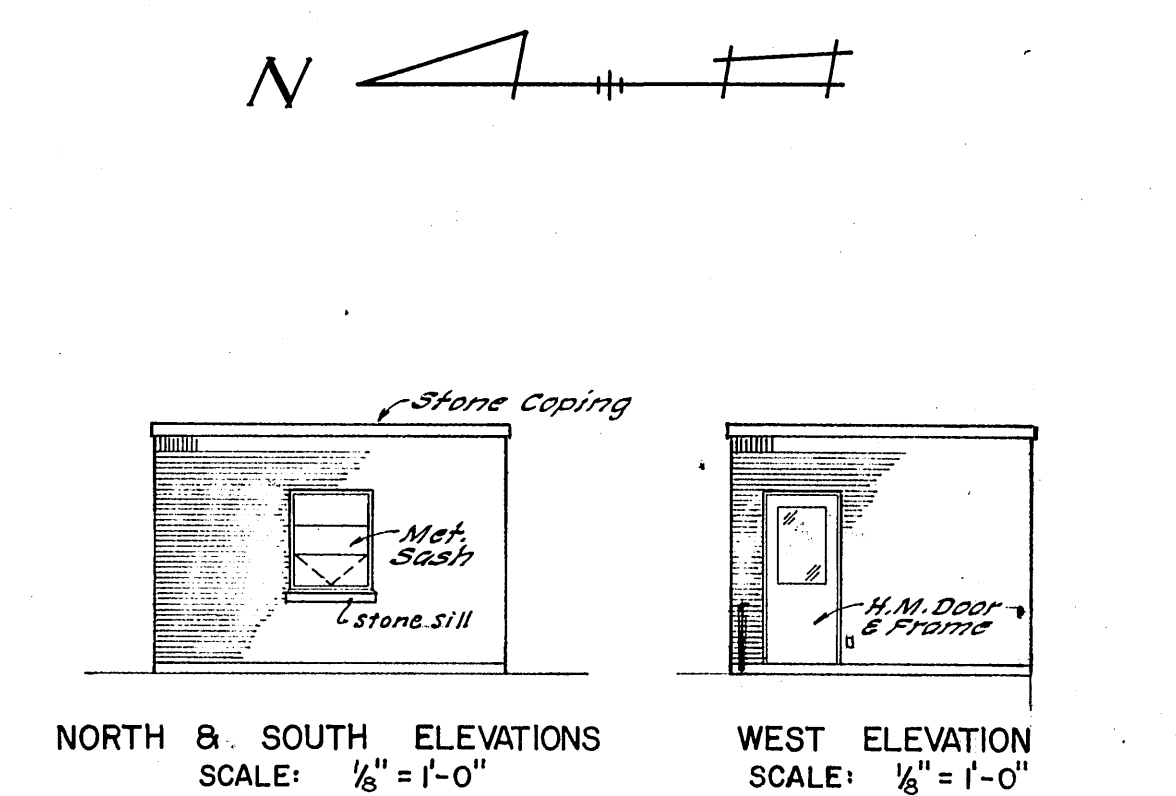


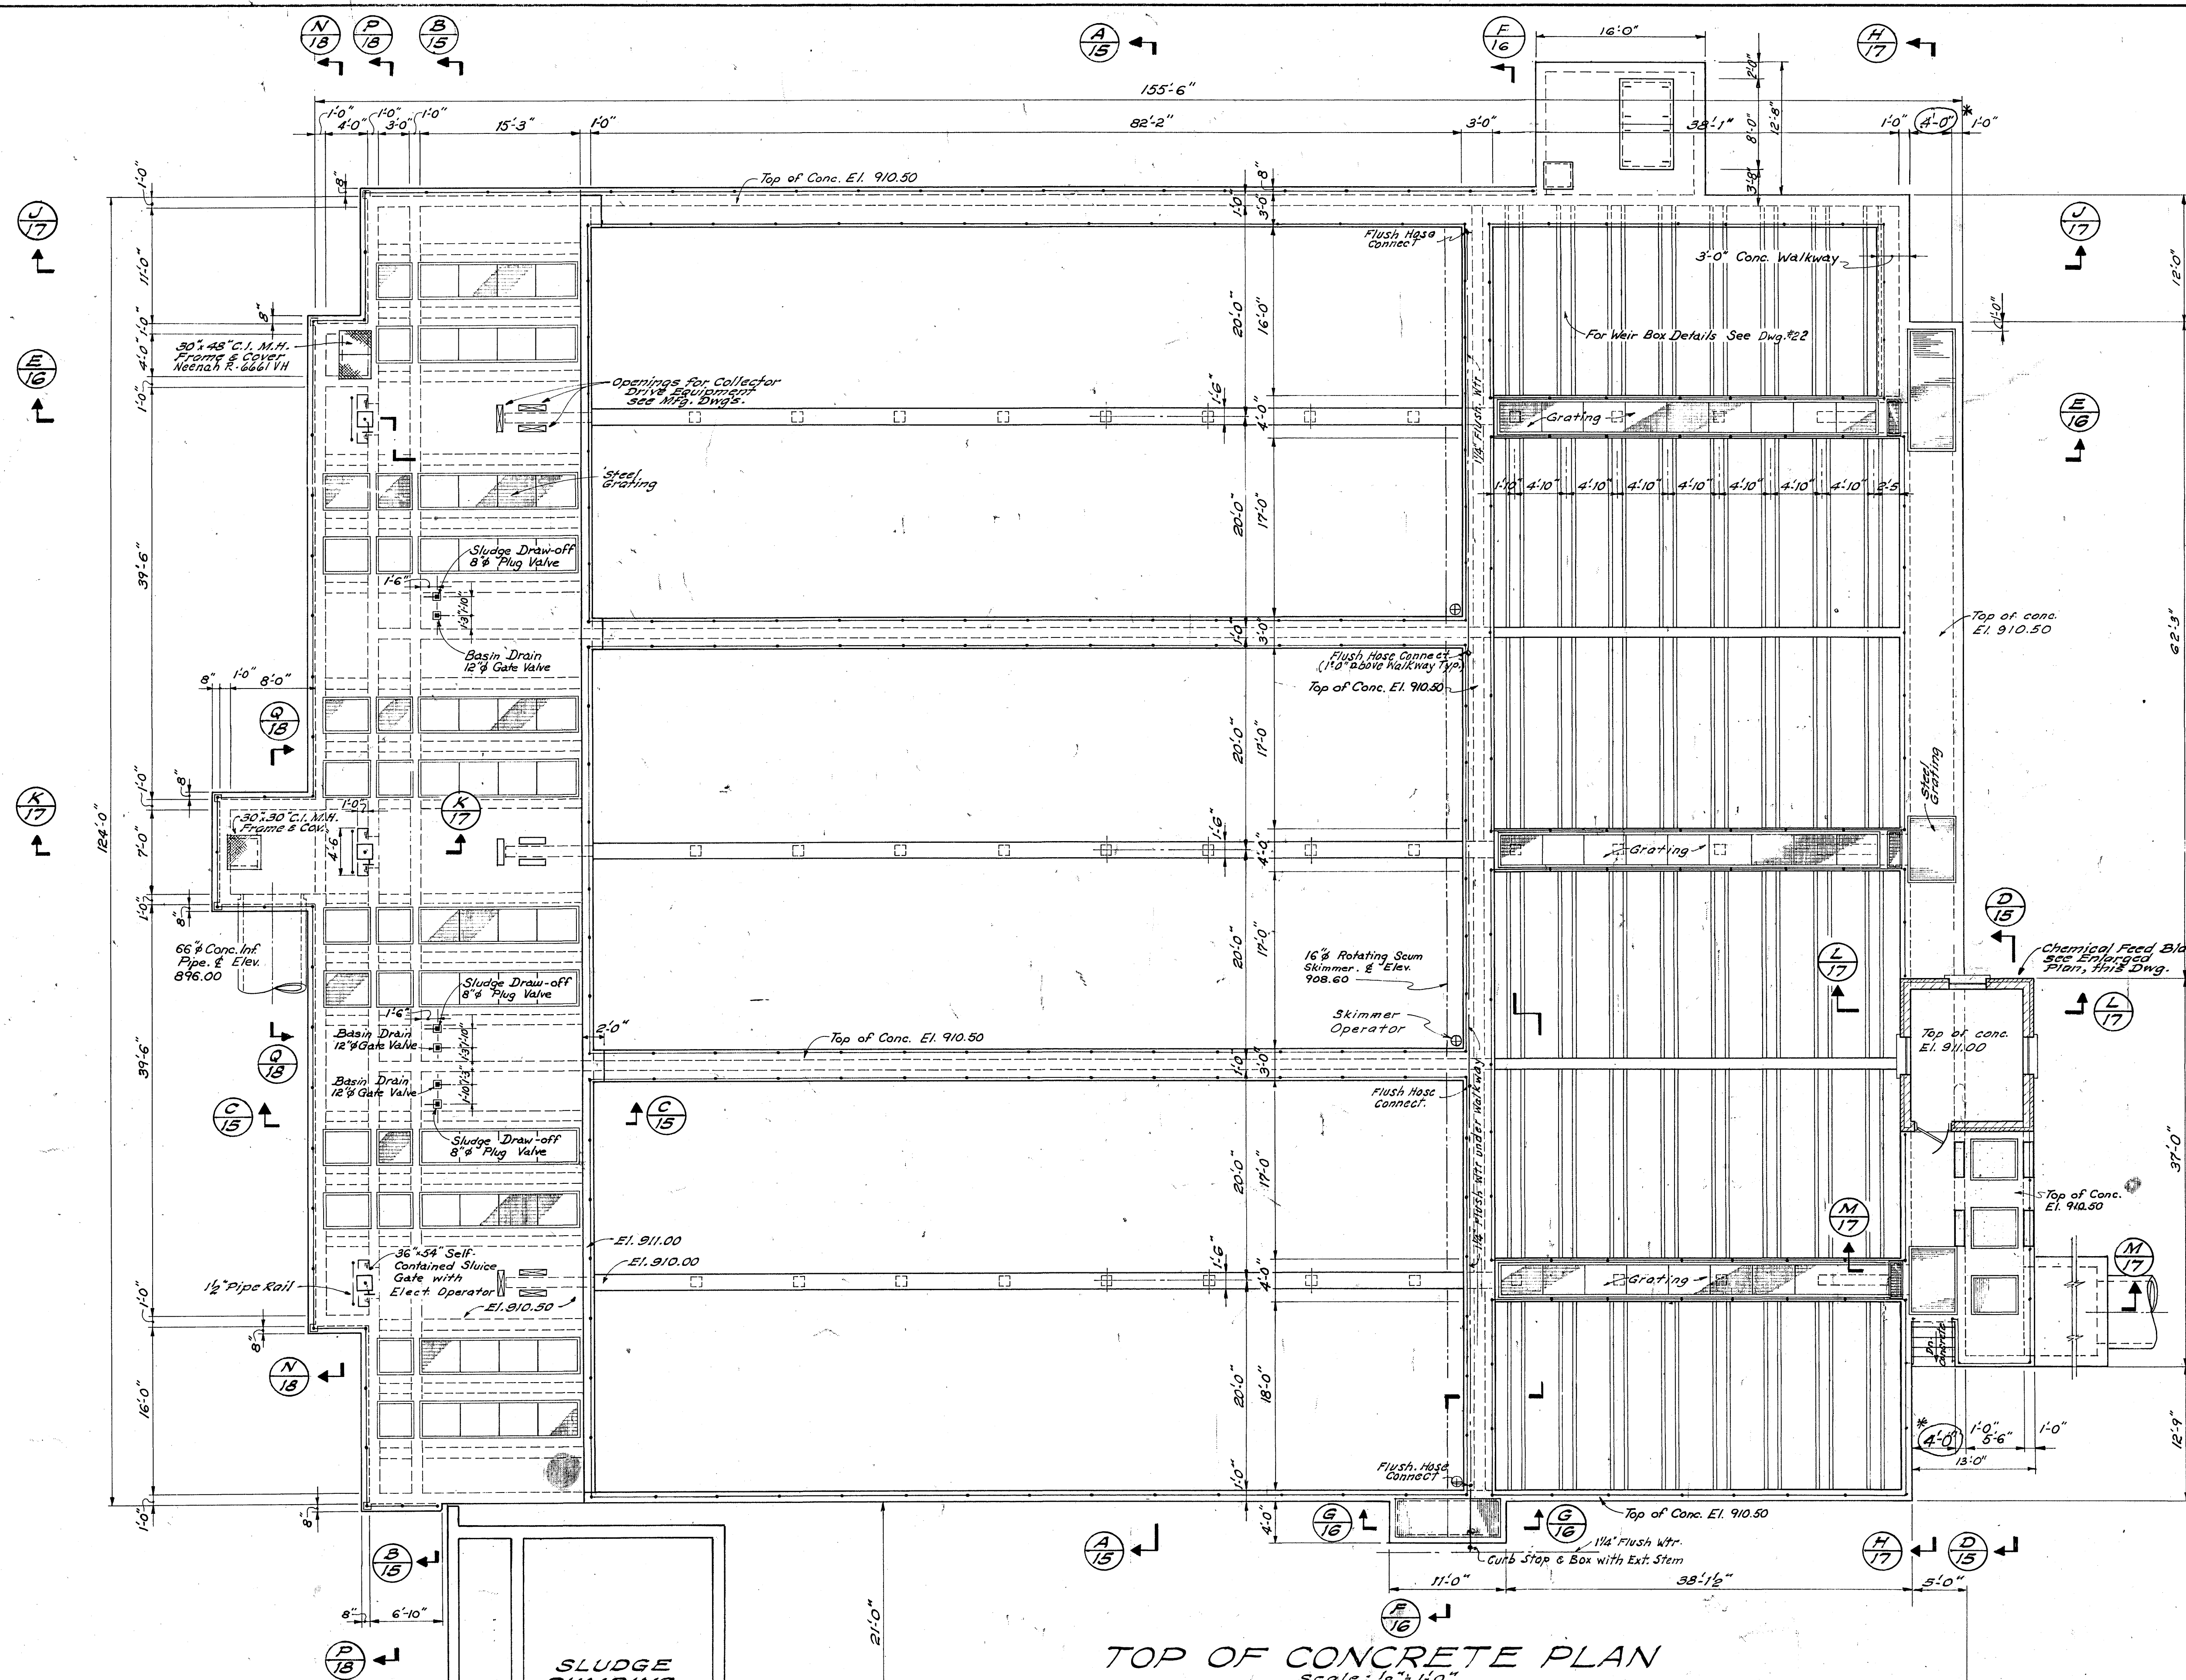

CHEMICAL FEED BLDG.
 Note: 1. See Sections A-A, B-B, C-C, Sheet #7 for Architectural Details.
 2. All chemical supply and feed lines are rubber lined and rubber coated.
 3. See Myfr's dwgs. for anchor bolt locations and piping connections.

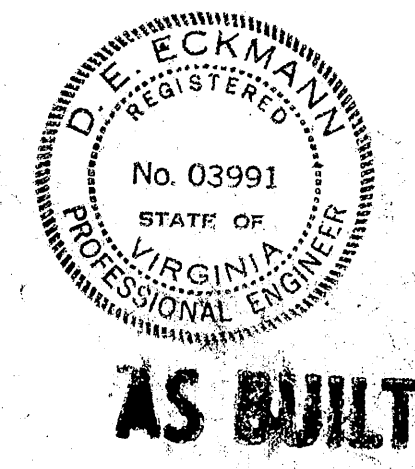

ADDITIONS TO SEWAGE TREATMENT PLANT
 ROANOKE, VIRGINIA
**PRIMARY SETTLING BASINS
 CONCRETE PLAN**
 ALVORD, BURDICK & HOWSON
 ENGINEERS CHICAGO
 1973

* Revised 5/25/73