


NOTE:
See Dwg's. 32, 33 and 34
for piping not shown

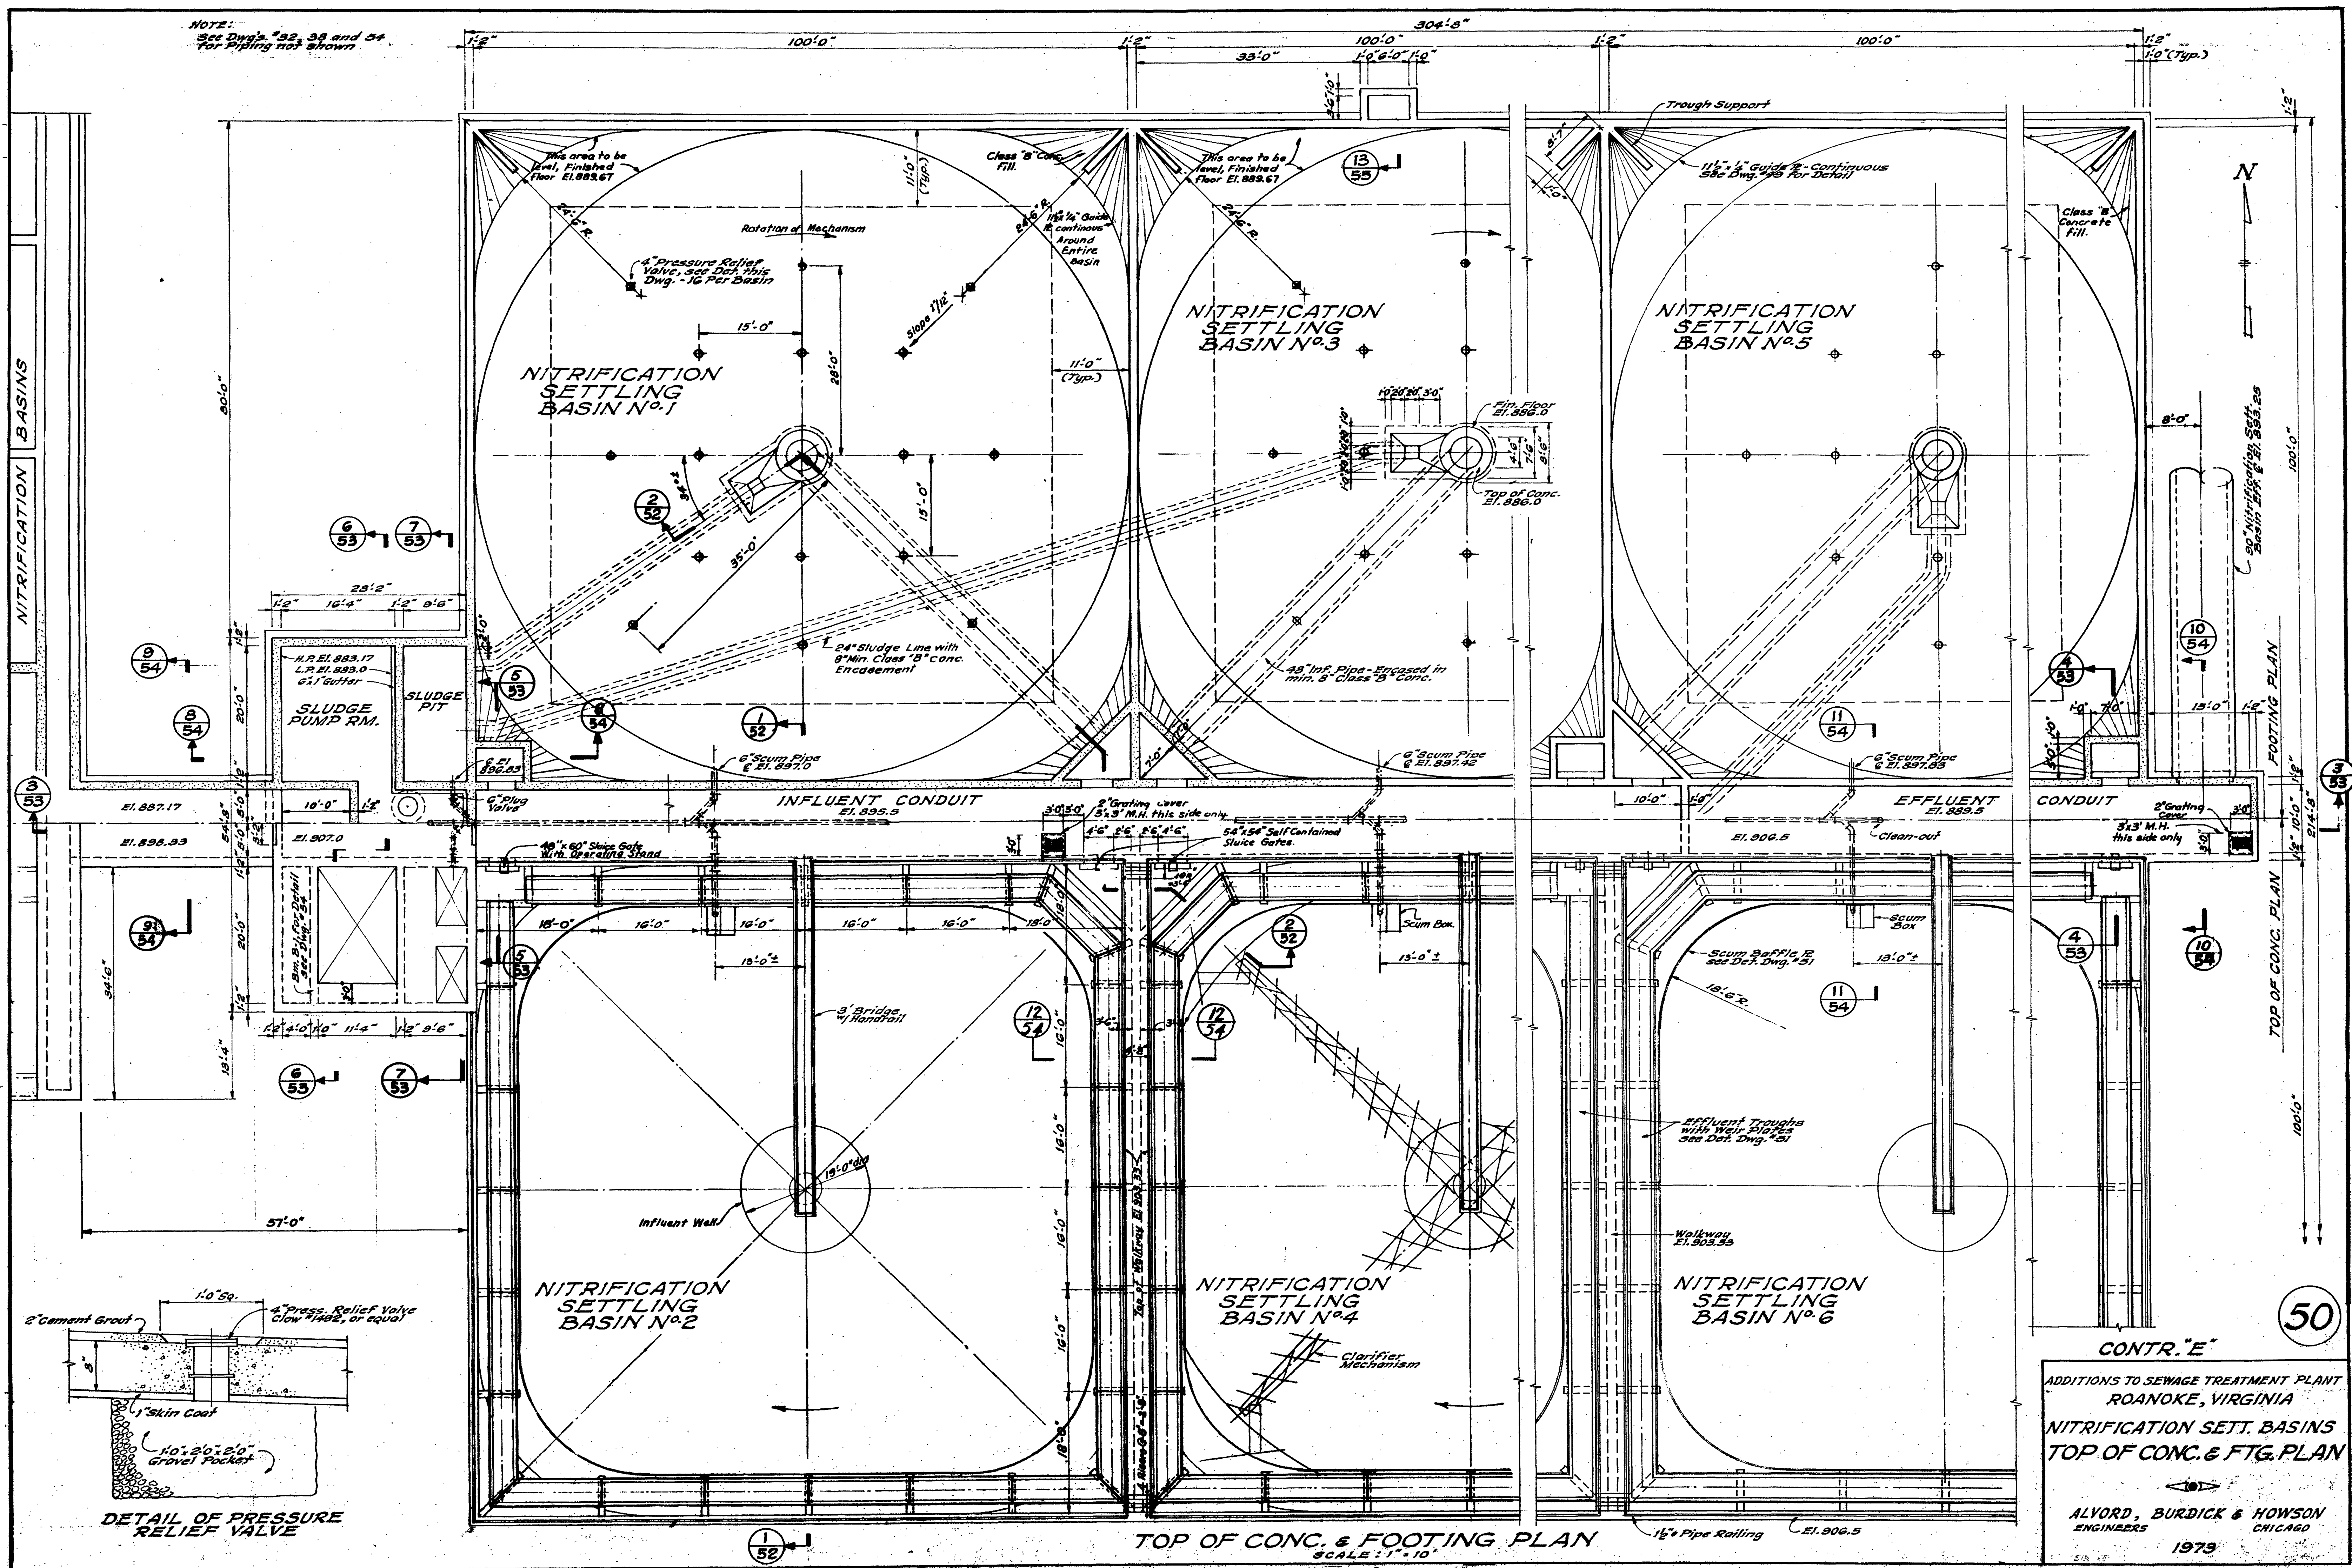

CONTR. "E"

ADDITIONS TO SEWAGE TREATMENT PLANT
ROANOKE, VIRGINIA

NITRIFICATION SETT. BASINS
TOP OF CONC. & FTG. PLAN

ALVORD, BURDICK & HOWSON
ENGINEERS CHICAGO

1979