



MCC NO. 1 AT SLUDGE THICKENER BLDG.

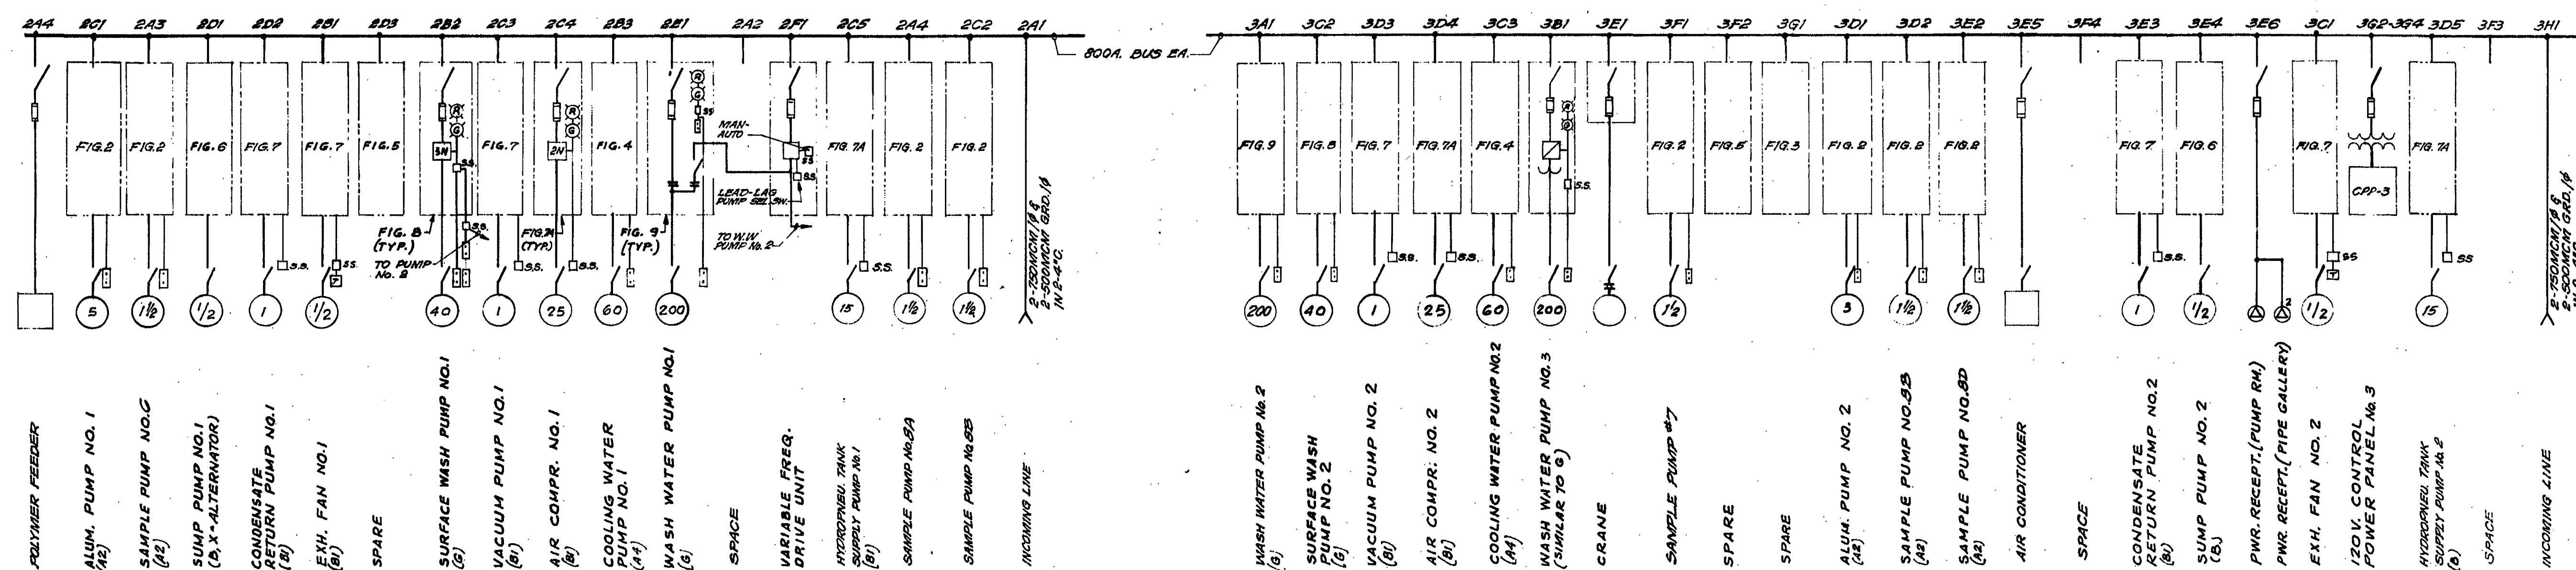


MCC. NO. 2 AT FILTER BLDG.

MCC. NO. 3 AT FILTER BLDG.

NOTE:
ALL BUSES 480V, 3Ø, 3W, 600A.
EXCEPT OTHERWISE NOTED
(FOR MCC #1-#3)

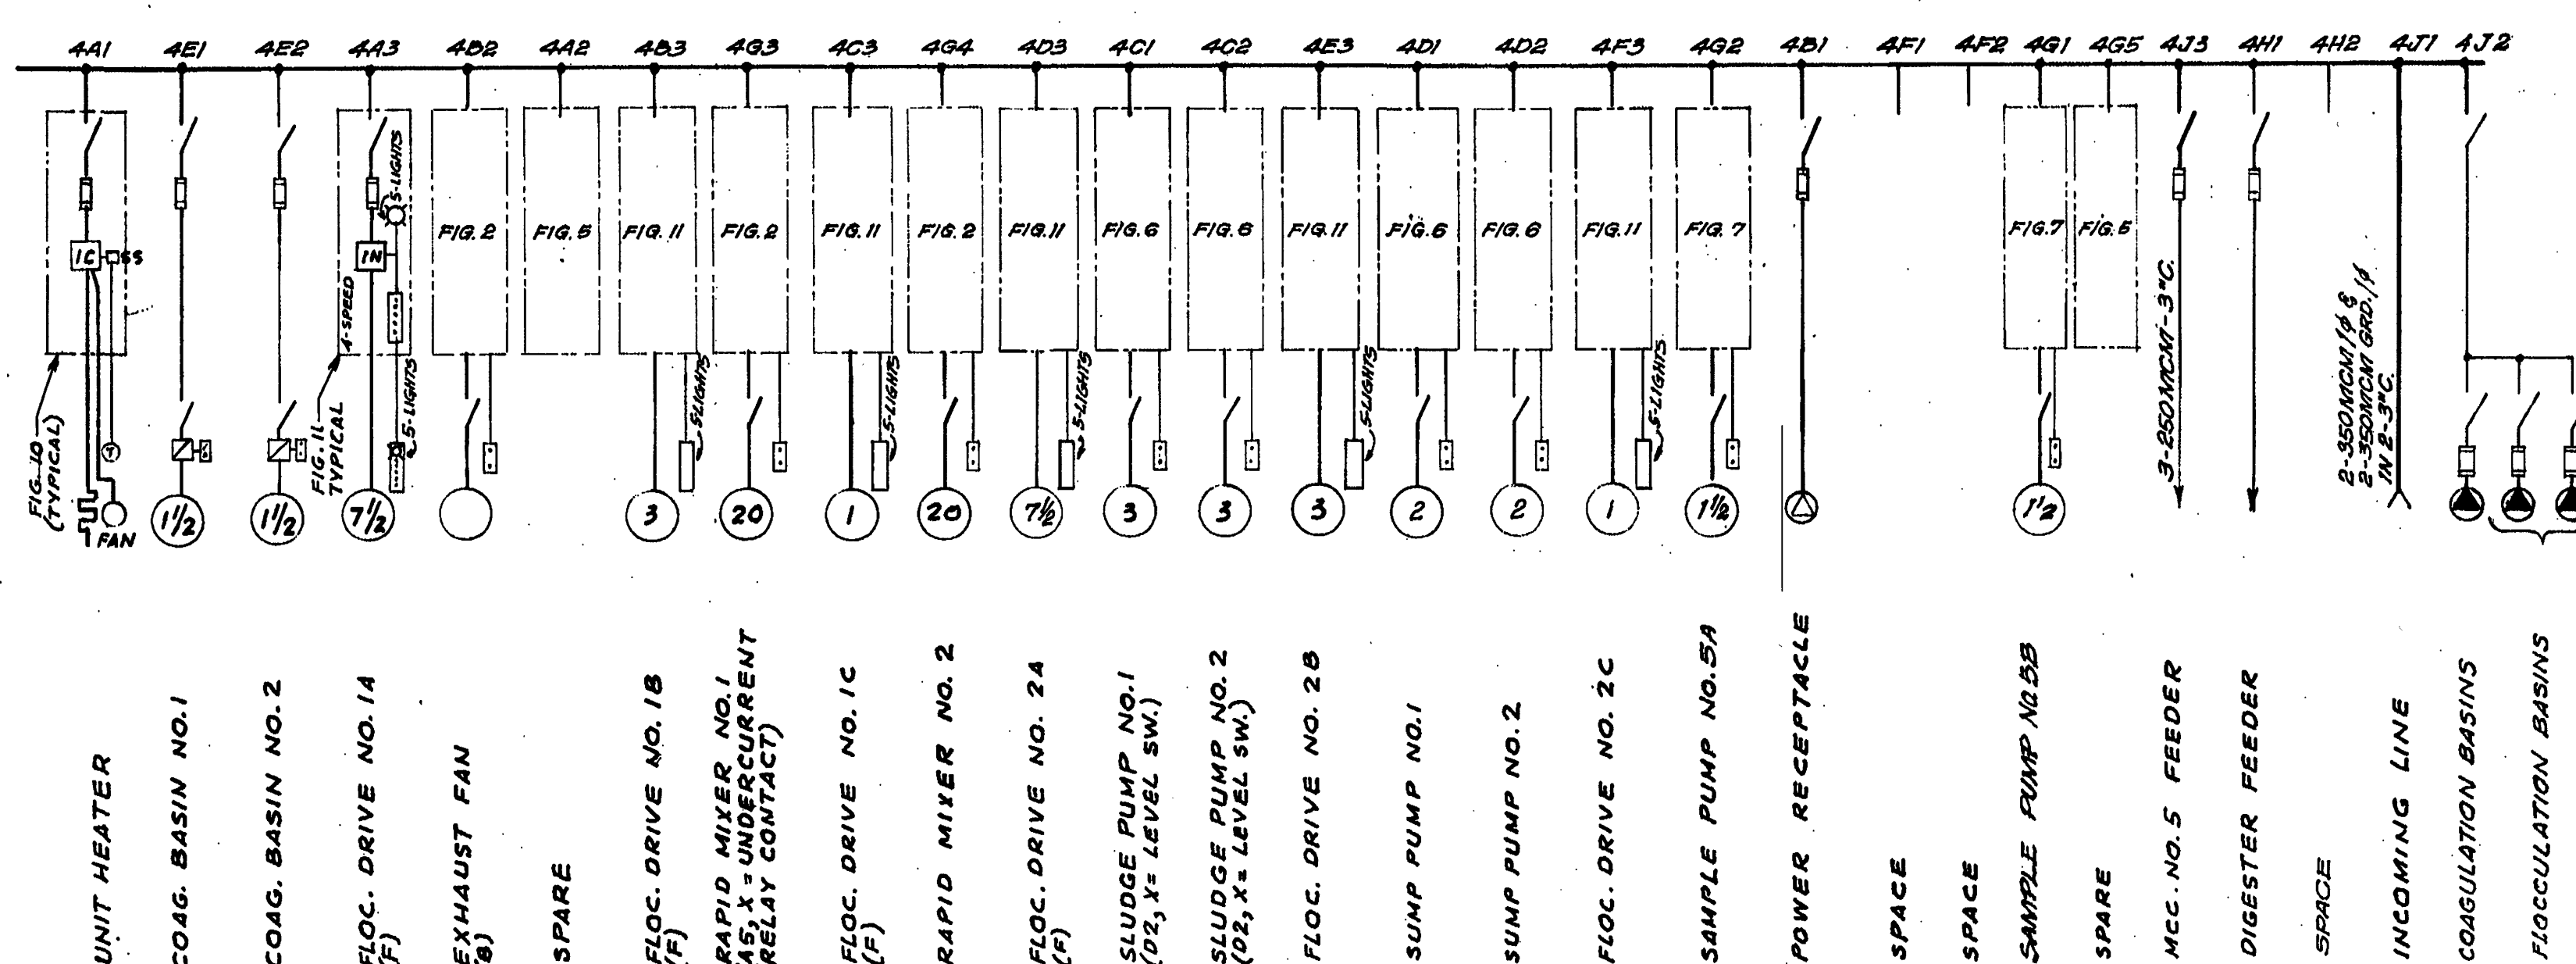

MCC NO. 4 AT FLOC. BASIN STRUCTURE NO. 1 (WEST)

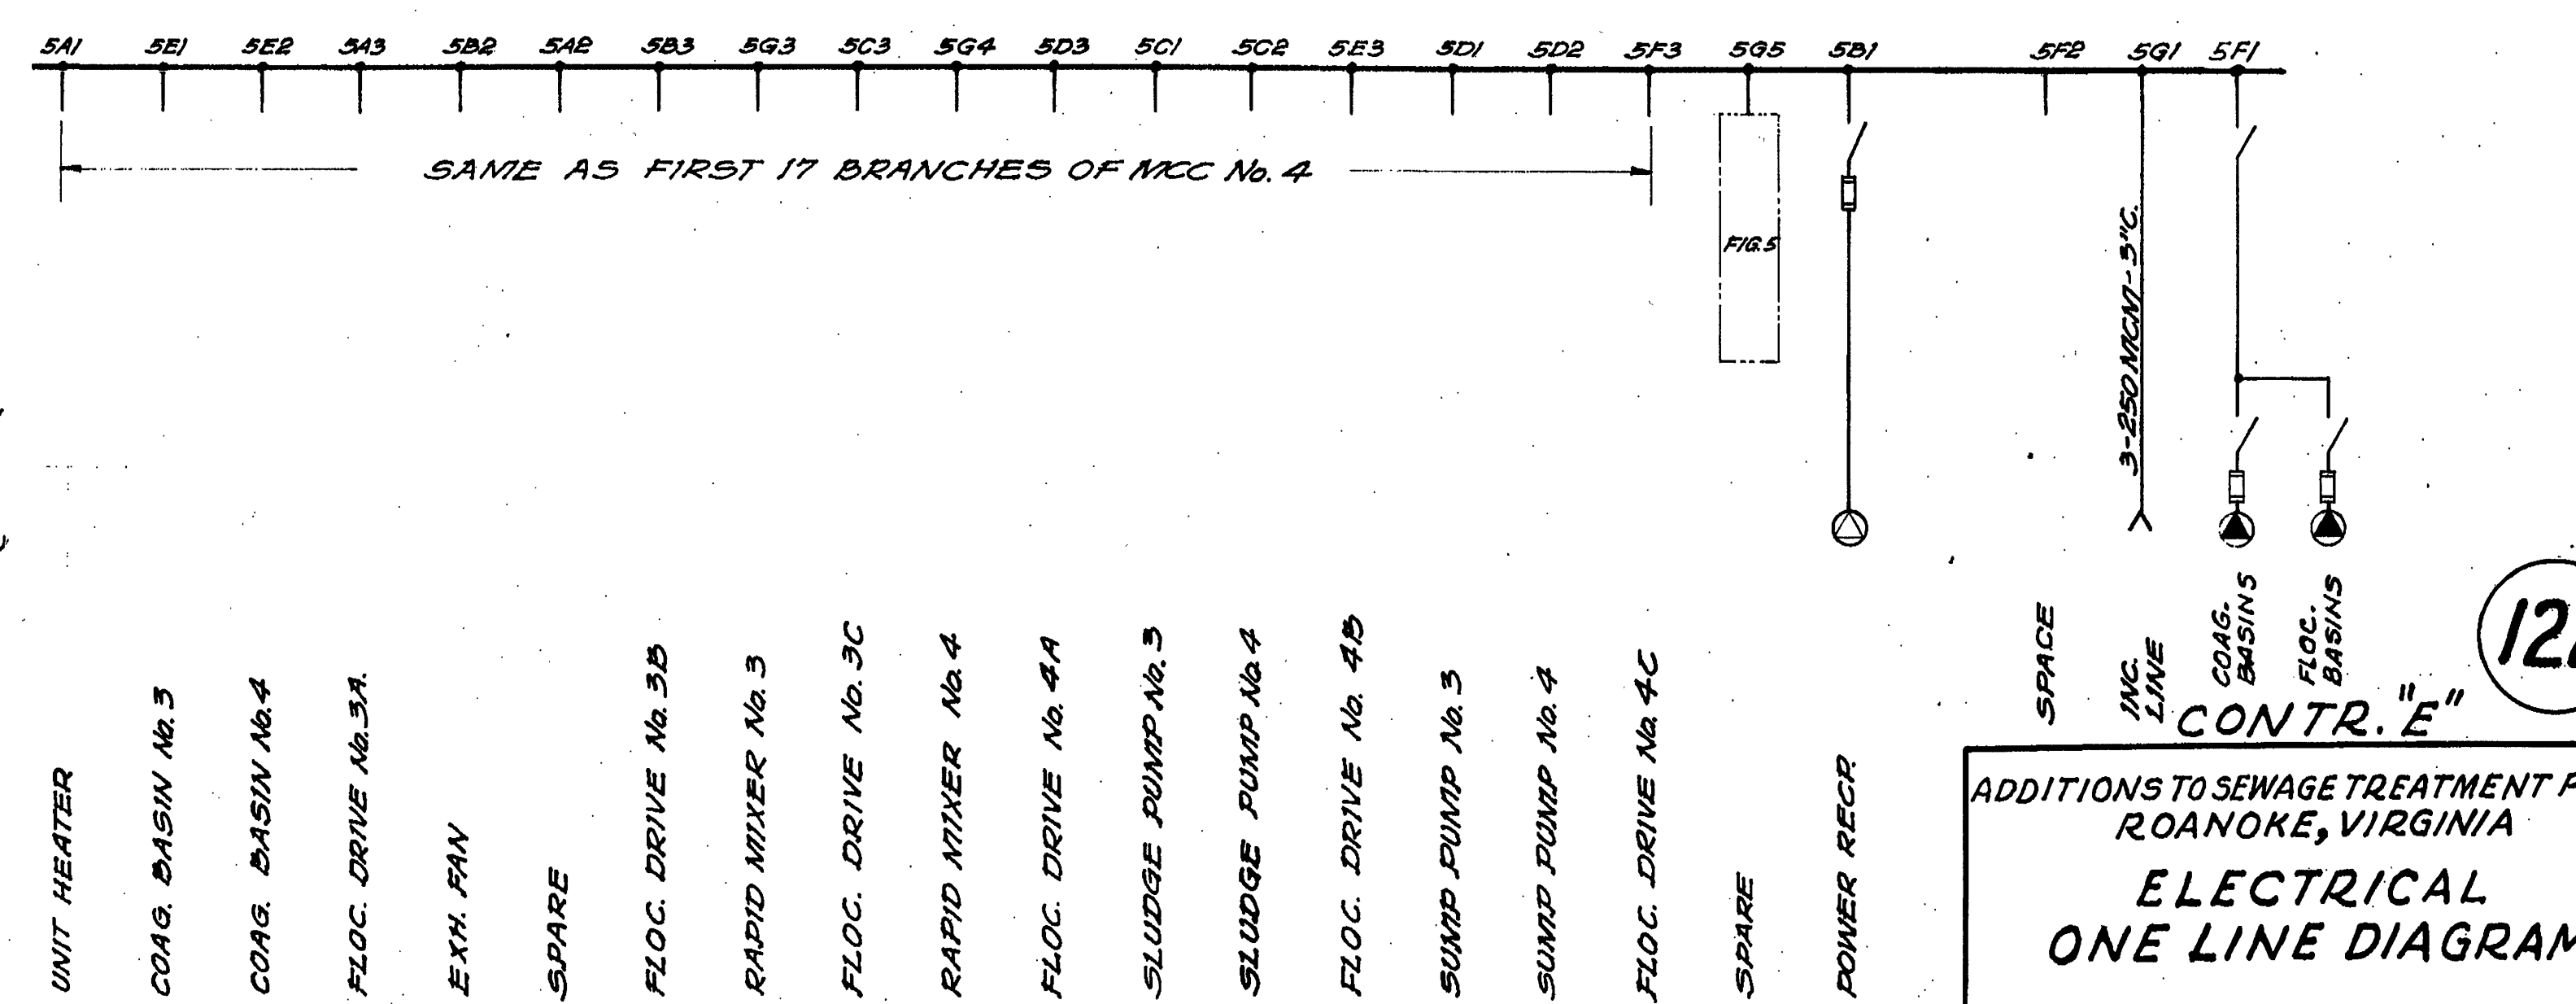

MCC No. 5 AT FLOC. BASIN STRUCTURE No. 2 (EAST)

122

CONTR. "E"

ADDITIONS TO SEWAGE TREATMENT PLANT
ROANOKE, VIRGINIA

**ELECTRICAL
ONE LINE DIAGRAM**

ALVORD, BURDICK & HOWSON
ENGINEERS CHICAGO
1973