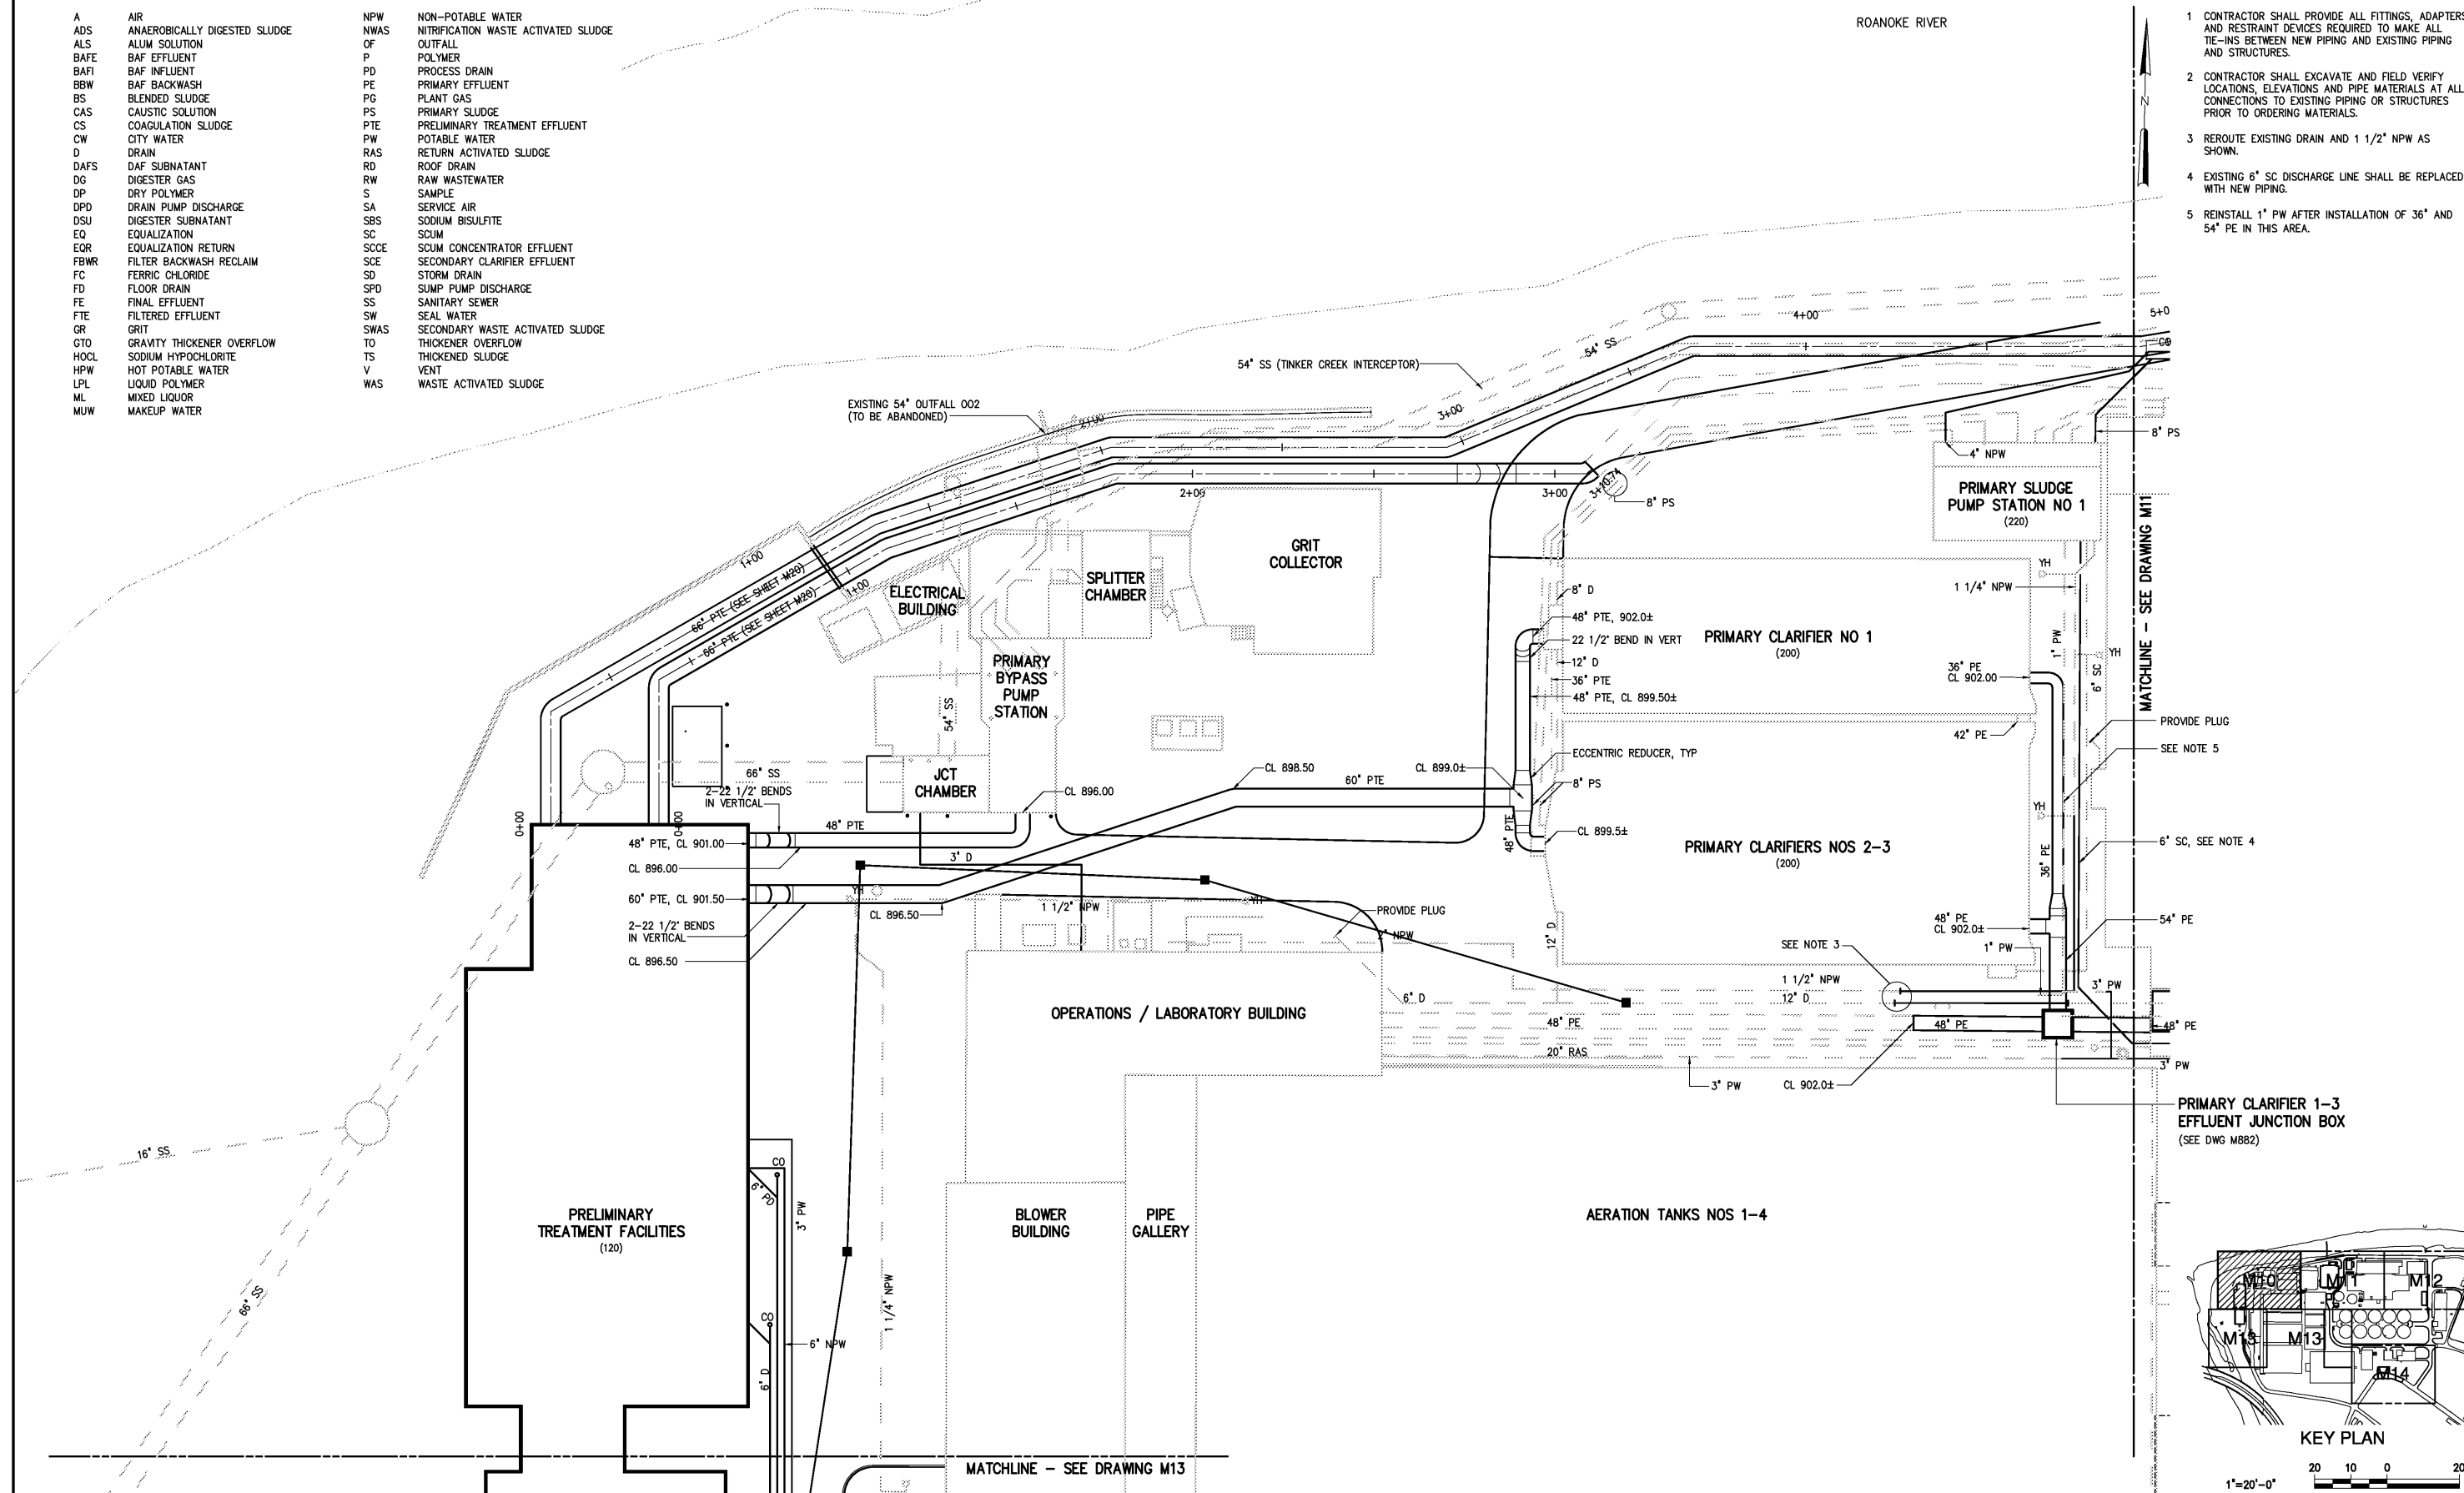


AIR	NPW	NON-POTABLE WATER
ANEROBICALLY DIGESTED SLUDGE	NWAS	NITRIFICATION WASTE ACTIVATED SLUDGE
ALUM SOLUTION	OF	OUTFALL
BAF EFFLUENT	P	POLYMER
BAF INFLUENT	PD	PROCESS DRAIN
BAF BACKWASH	PE	PRIMARY EFFLUENT
BLENDED SLUDGE	PG	PLANT GAS
CAUSTIC SOLUTION	PS	PRIMARY SLUDGE
COAGULATION SLUDGE	PTE	PRELIMINARY TREATMENT EFFLUENT
CITY WATER	PW	POTABLE WATER
DRAIN	RAS	RETURN ACTIVATED SLUDGE
DAF SUBNATANT	RD	ROOF DRAIN
DIGESTER GAS	RW	RAW WASTEWATER
DRY POLYMER	S	SAMPLE
DRAIN PUMP DISCHARGE	SA	SERVICE AIR
DIGESTER SUBNATANT	SBS	SODIUM BISULFITE
EQUALIZATION	SC	SCUM
EQUALIZATION RETURN	SCM	SCUM CONCENTRATOR EFFLUENT
FILTER BACKWASH RECLAIM	SCE	SECONDARY CLARIFIER EFFLUENT
FERRIC CHLORIDE	SD	STORM DRAIN
FLOOR DRAIN	SPD	SUMP PUMP DISCHARGE
FINAL EFFLUENT	SS	SANITARY SEWER
FILTERED EFFLUENT	SW	SEAL WATER
GRIT	SWAS	SECONDARY WASTE ACTIVATED SLUDGE
GRAVITY THICKENER OVERFLOW	TO	THICKENER OVERFLOW
SODIUM HYPOCHLORITE	TS	THICKENED SLUDGE
HOT POTABLE WATER	V	VENT
LIQUID POLYMER	WAS	WASTE ACTIVATED SLUDGE
MIXED LIQUOR		
MAKEUP WATER		

- 1 CONTRACTOR SHALL PROVIDE ALL FITTINGS, ADAPTERS AND RESTRAINT DEVICES REQUIRED TO MAKE ALL TIE-INS BETWEEN NEW PIPING AND EXISTING PIPING AND STRUCTURES.
- 2 CONTRACTOR SHALL EXCAVATE AND FIELD VERIFY LOCATIONS, ELEVATIONS AND PIPE MATERIALS AT ALL CONNECTIONS TO EXISTING PIPING OR STRUCTURES PRIOR TO ORDERING MATERIALS.
- 3 REROUTE EXISTING DRAIN AND 1 1/2" NPW AS SHOWN.
- 4 EXISTING 6" SC DISCHARGE LINE SHALL BE REPLACED WITH NEW PIPING.
- 5 REINSTALL 1" PW AFTER INSTALLATION OF 36" AND 54" PE IN THIS AREA.

[illegible]

PLOT DATE 07/08/03 11:20am FILE= H:\30788\30788A\MECH\m010 by PLAWANSON XREF= m\30788a\misc\30788b.001\ag-st.001\key plan.001\ag-mb. MISC\PIPEABR.001\ag-st-serial-2002.001\ag-st-norms