

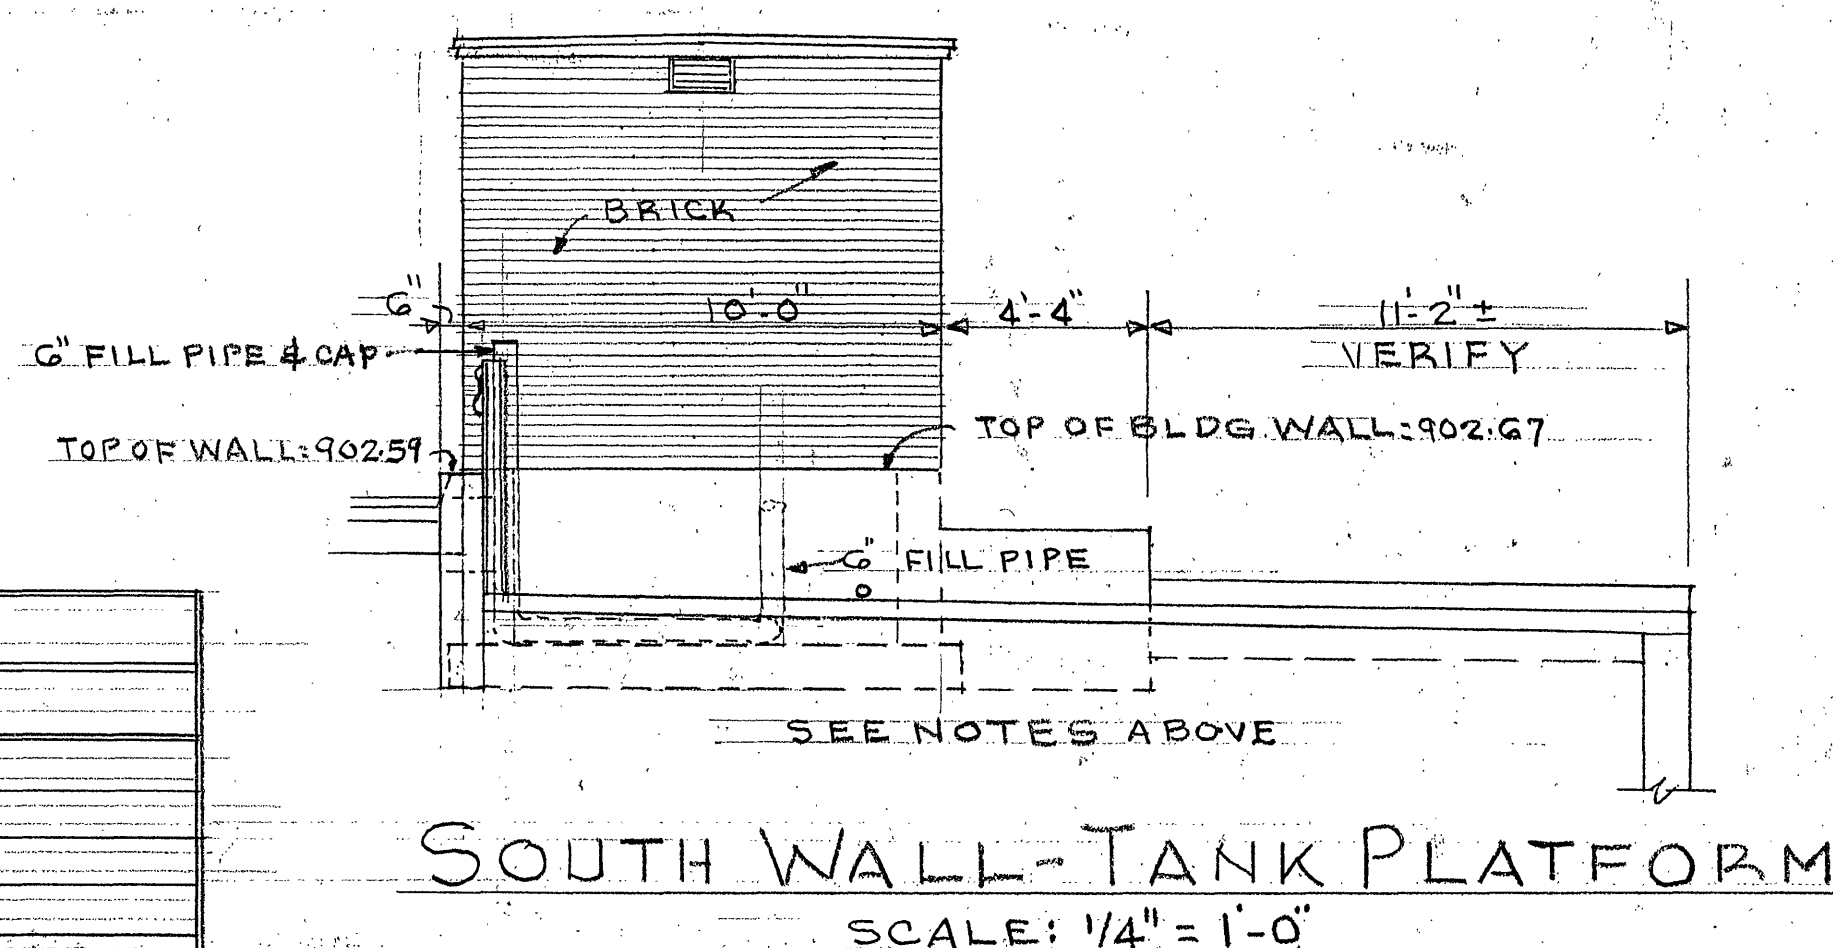
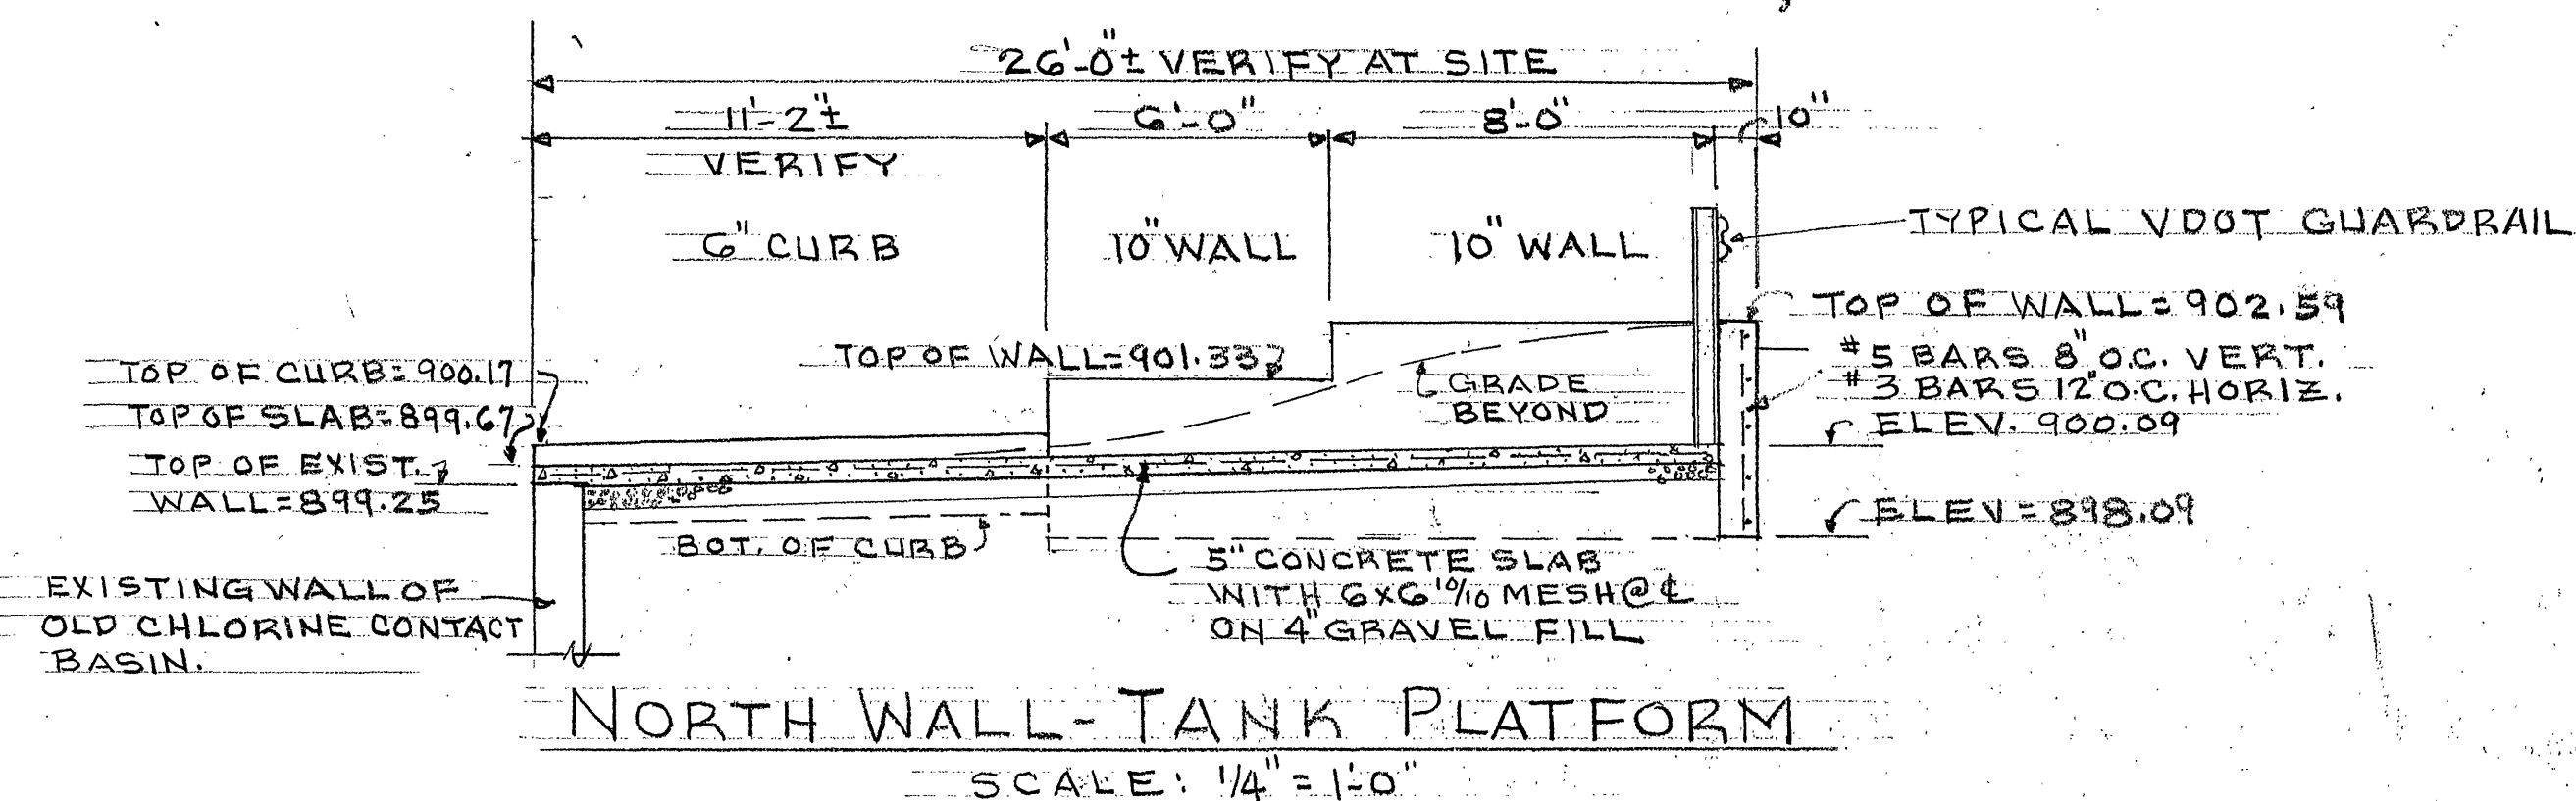
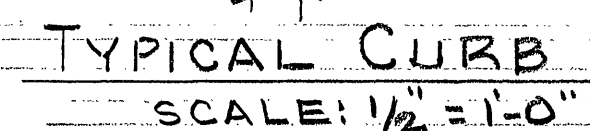
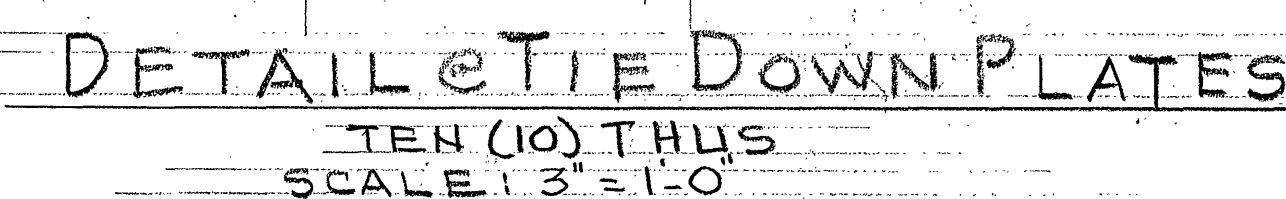
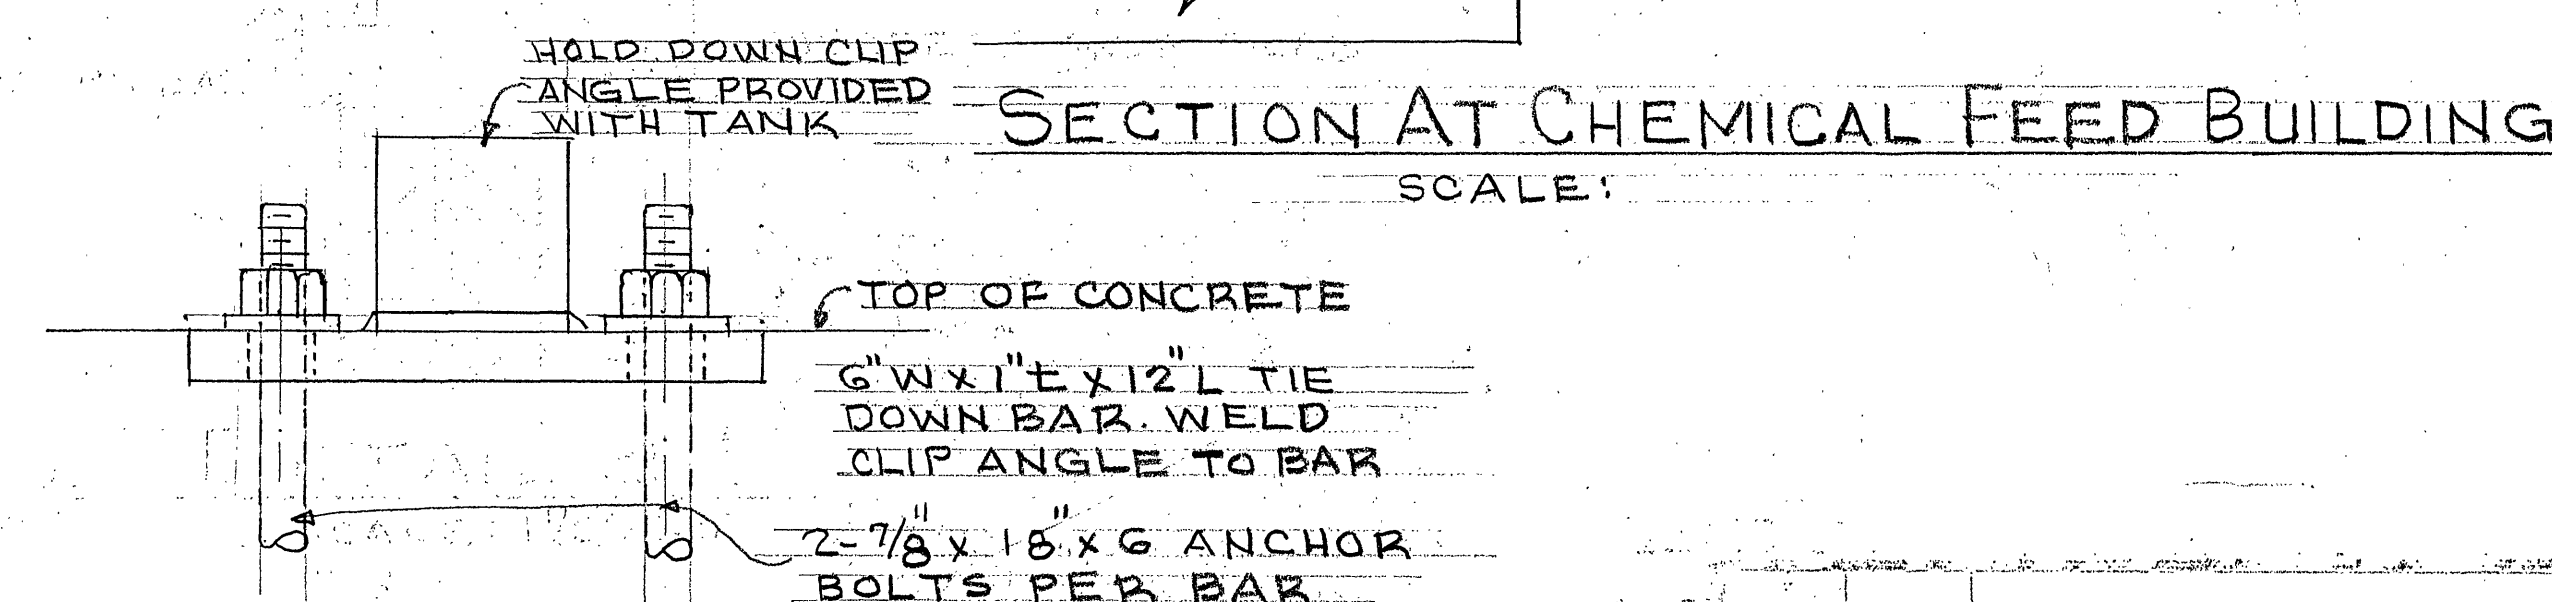
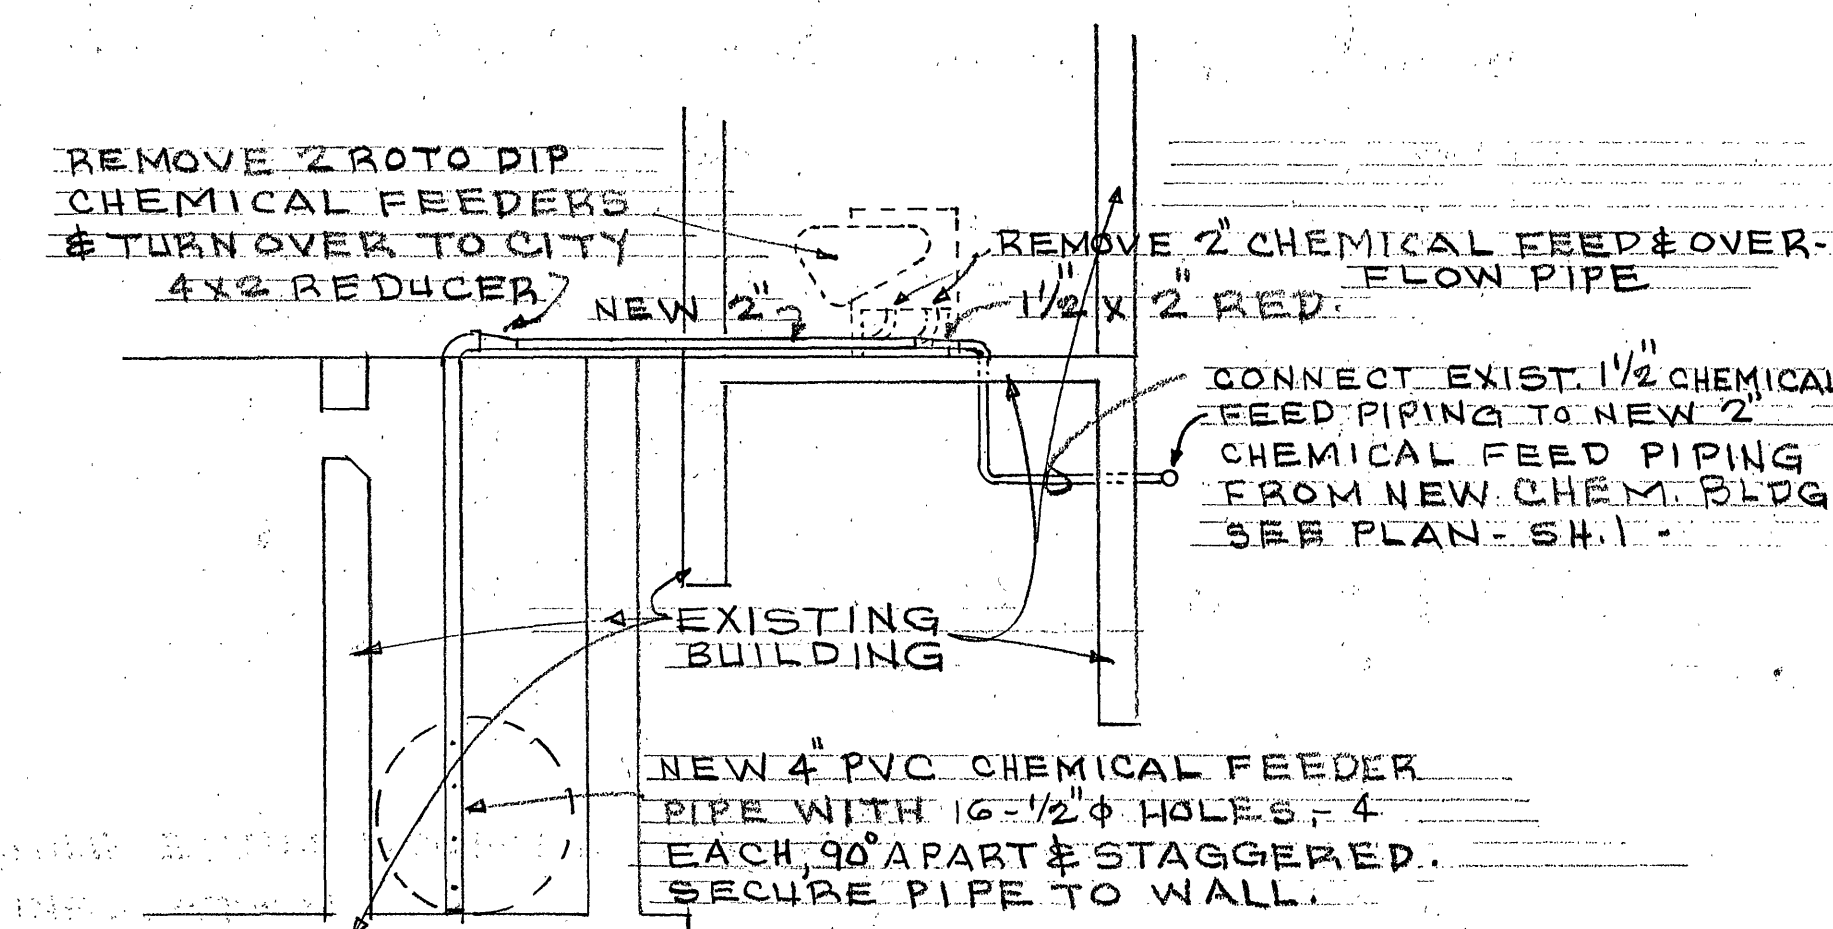
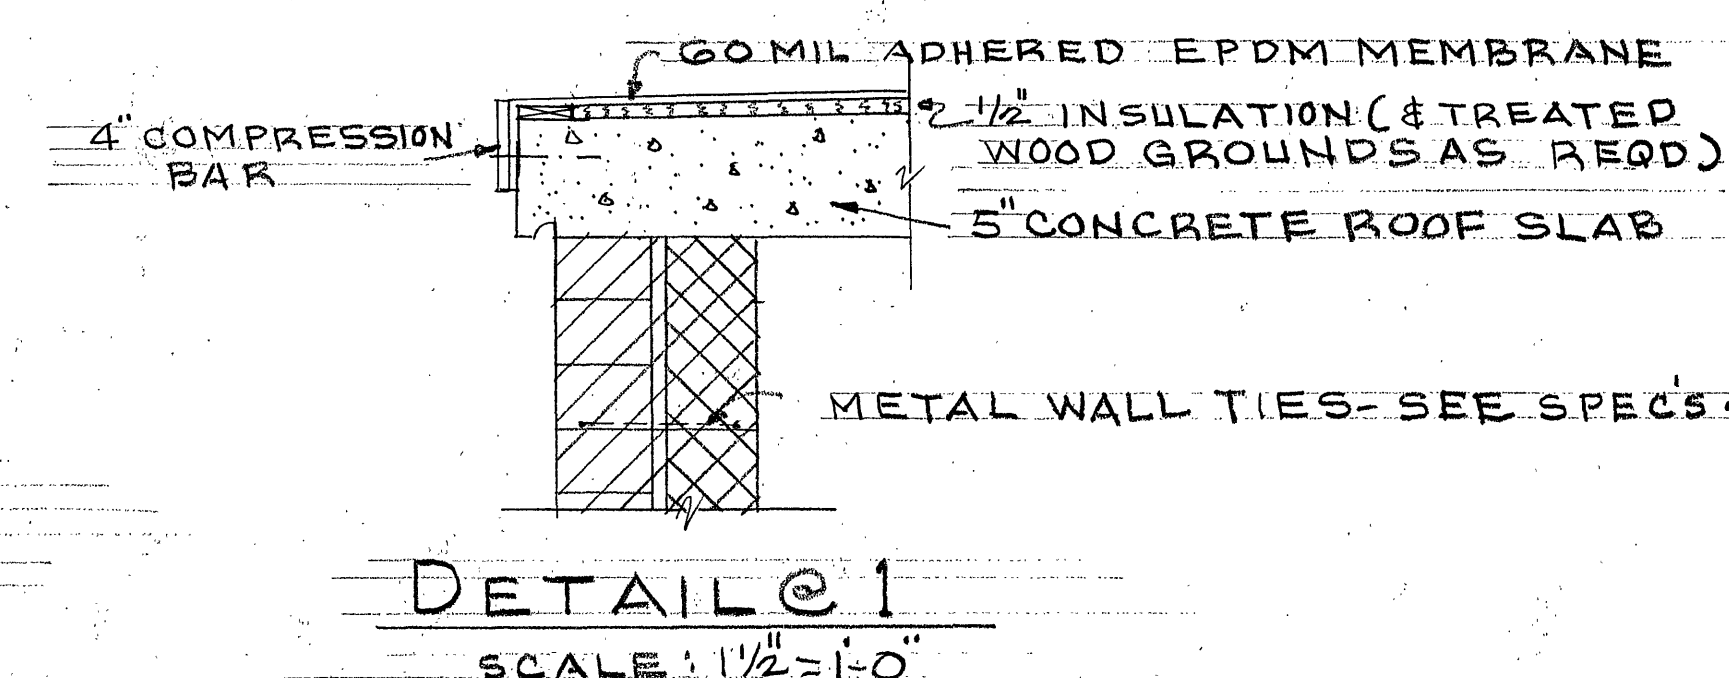
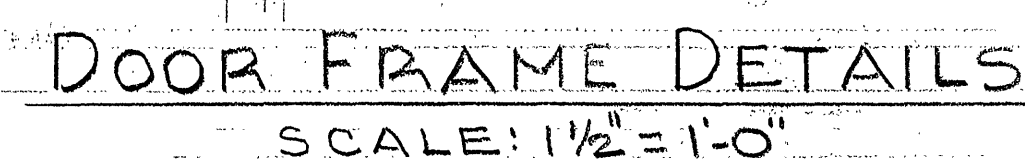
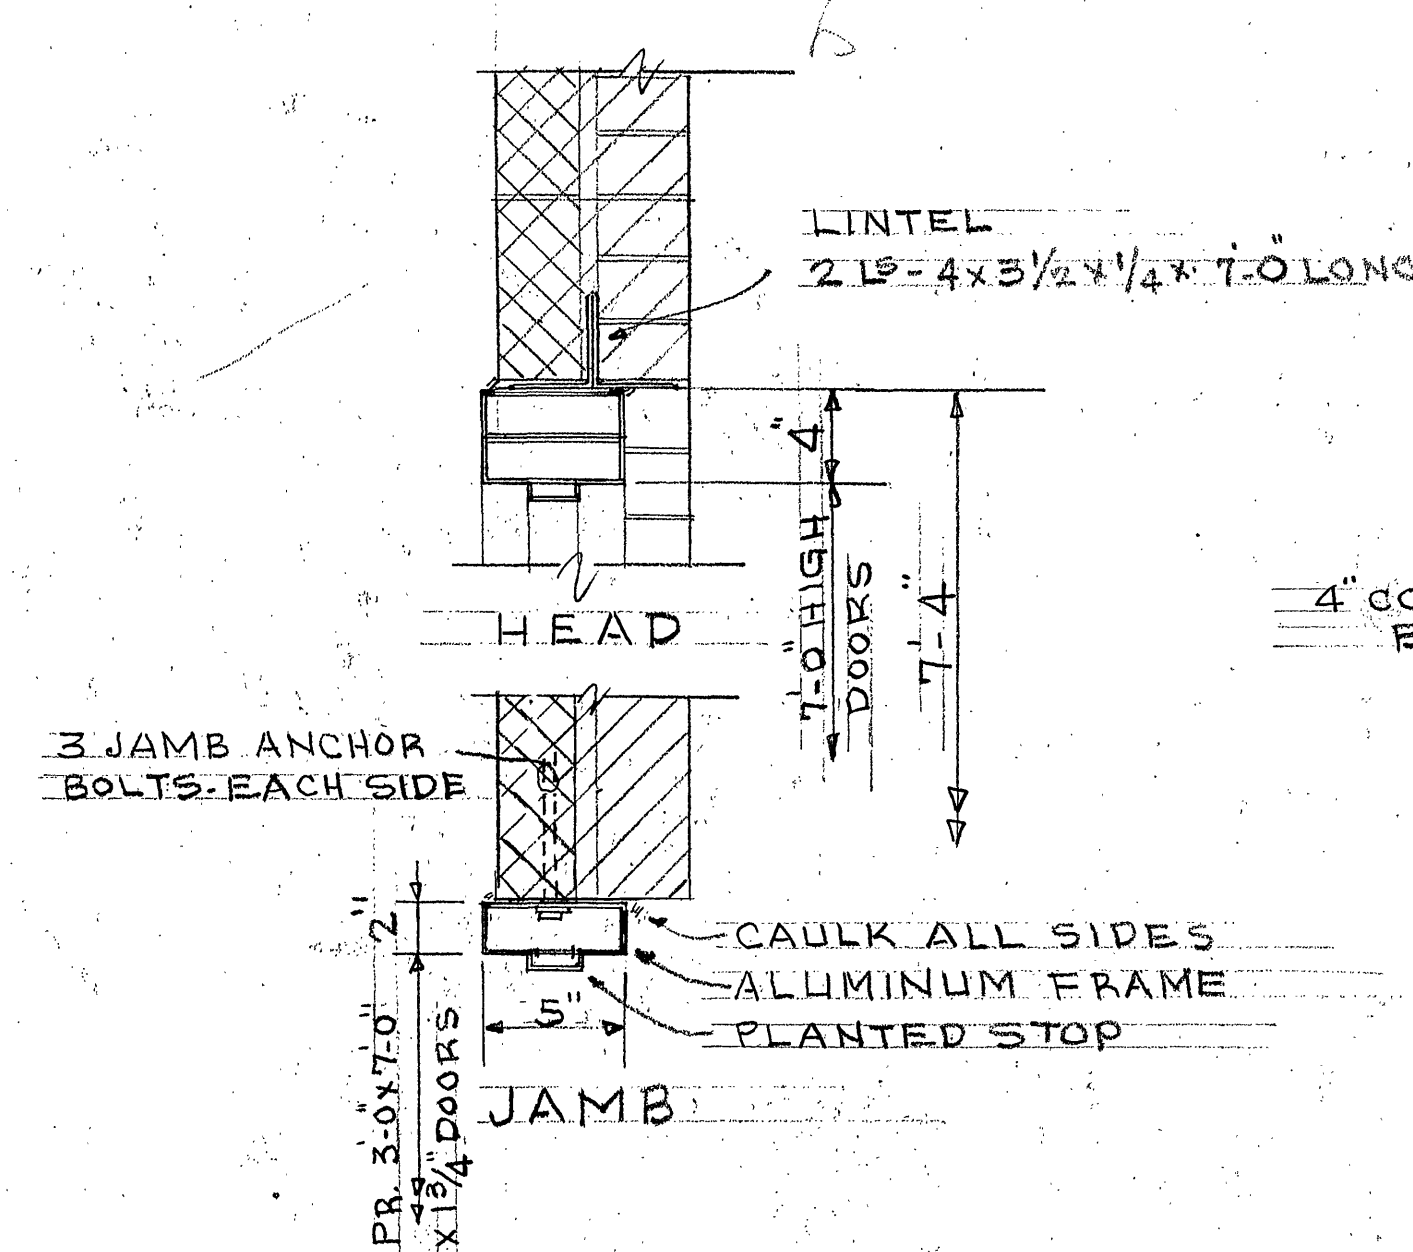
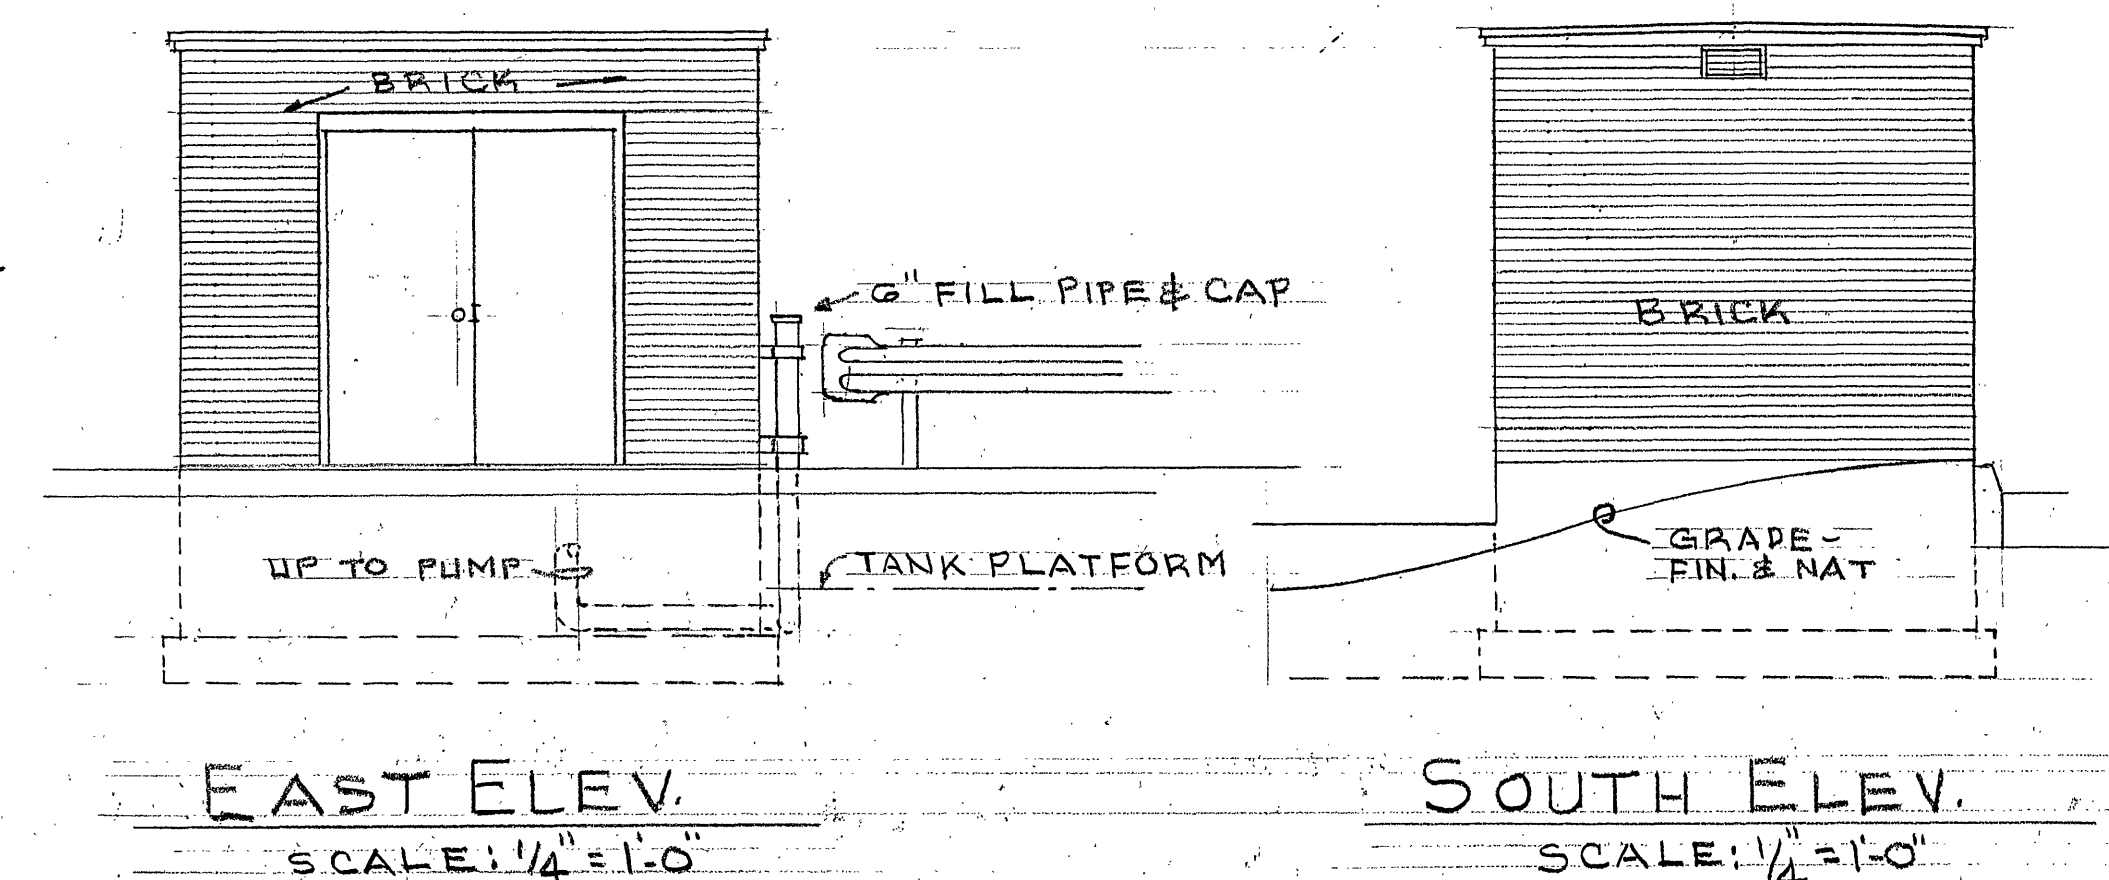
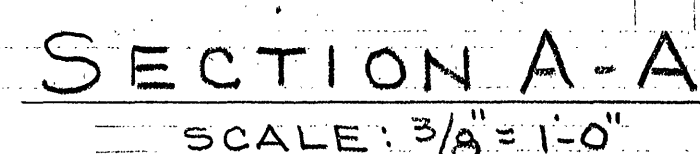


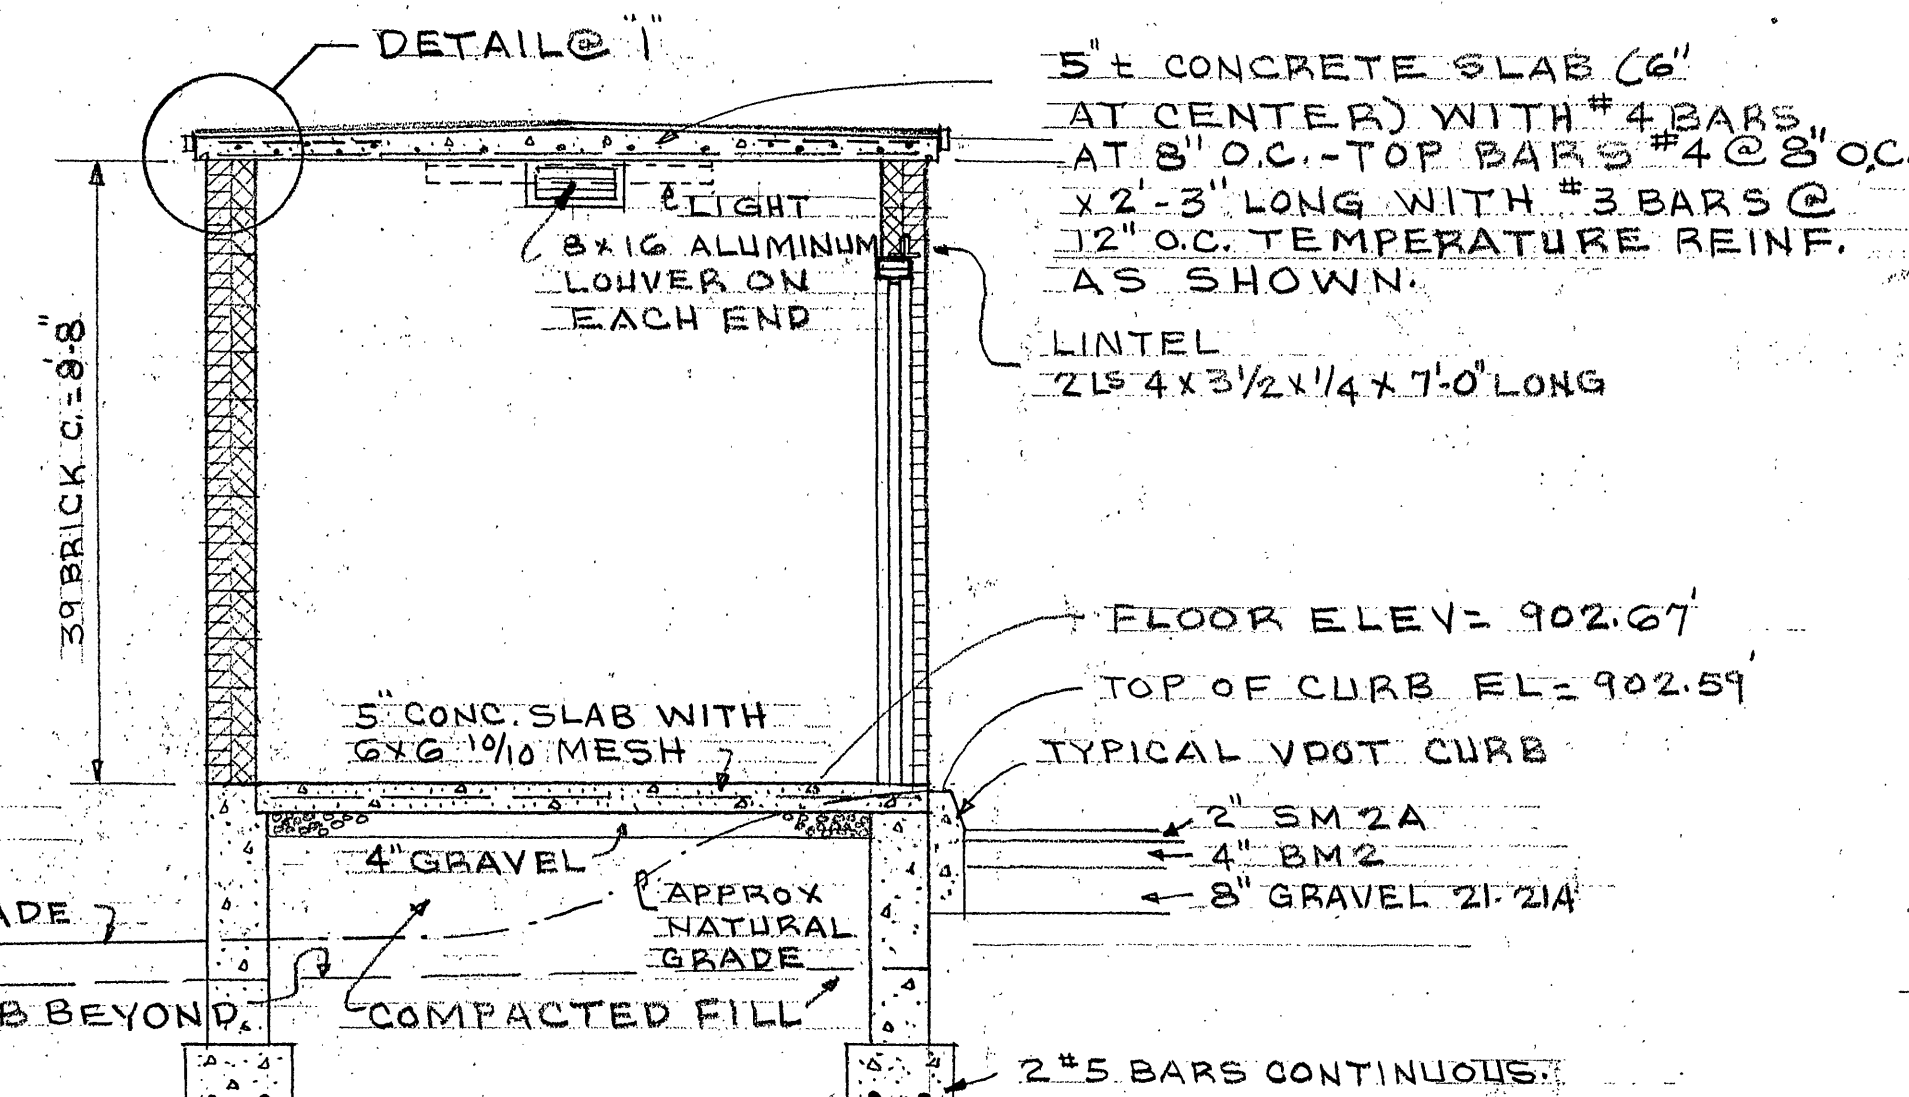

POWER SOURCE: 40A 480V 3PHASE BREAKER
IN EXISTING PANELBOARD ON WEST SIDE OF
CHLORINE BLDG @ S. END OLD CHLORINE BASINS
PANEL A: 100A 208/120V 3PH. 60HZ. 4 WIRE

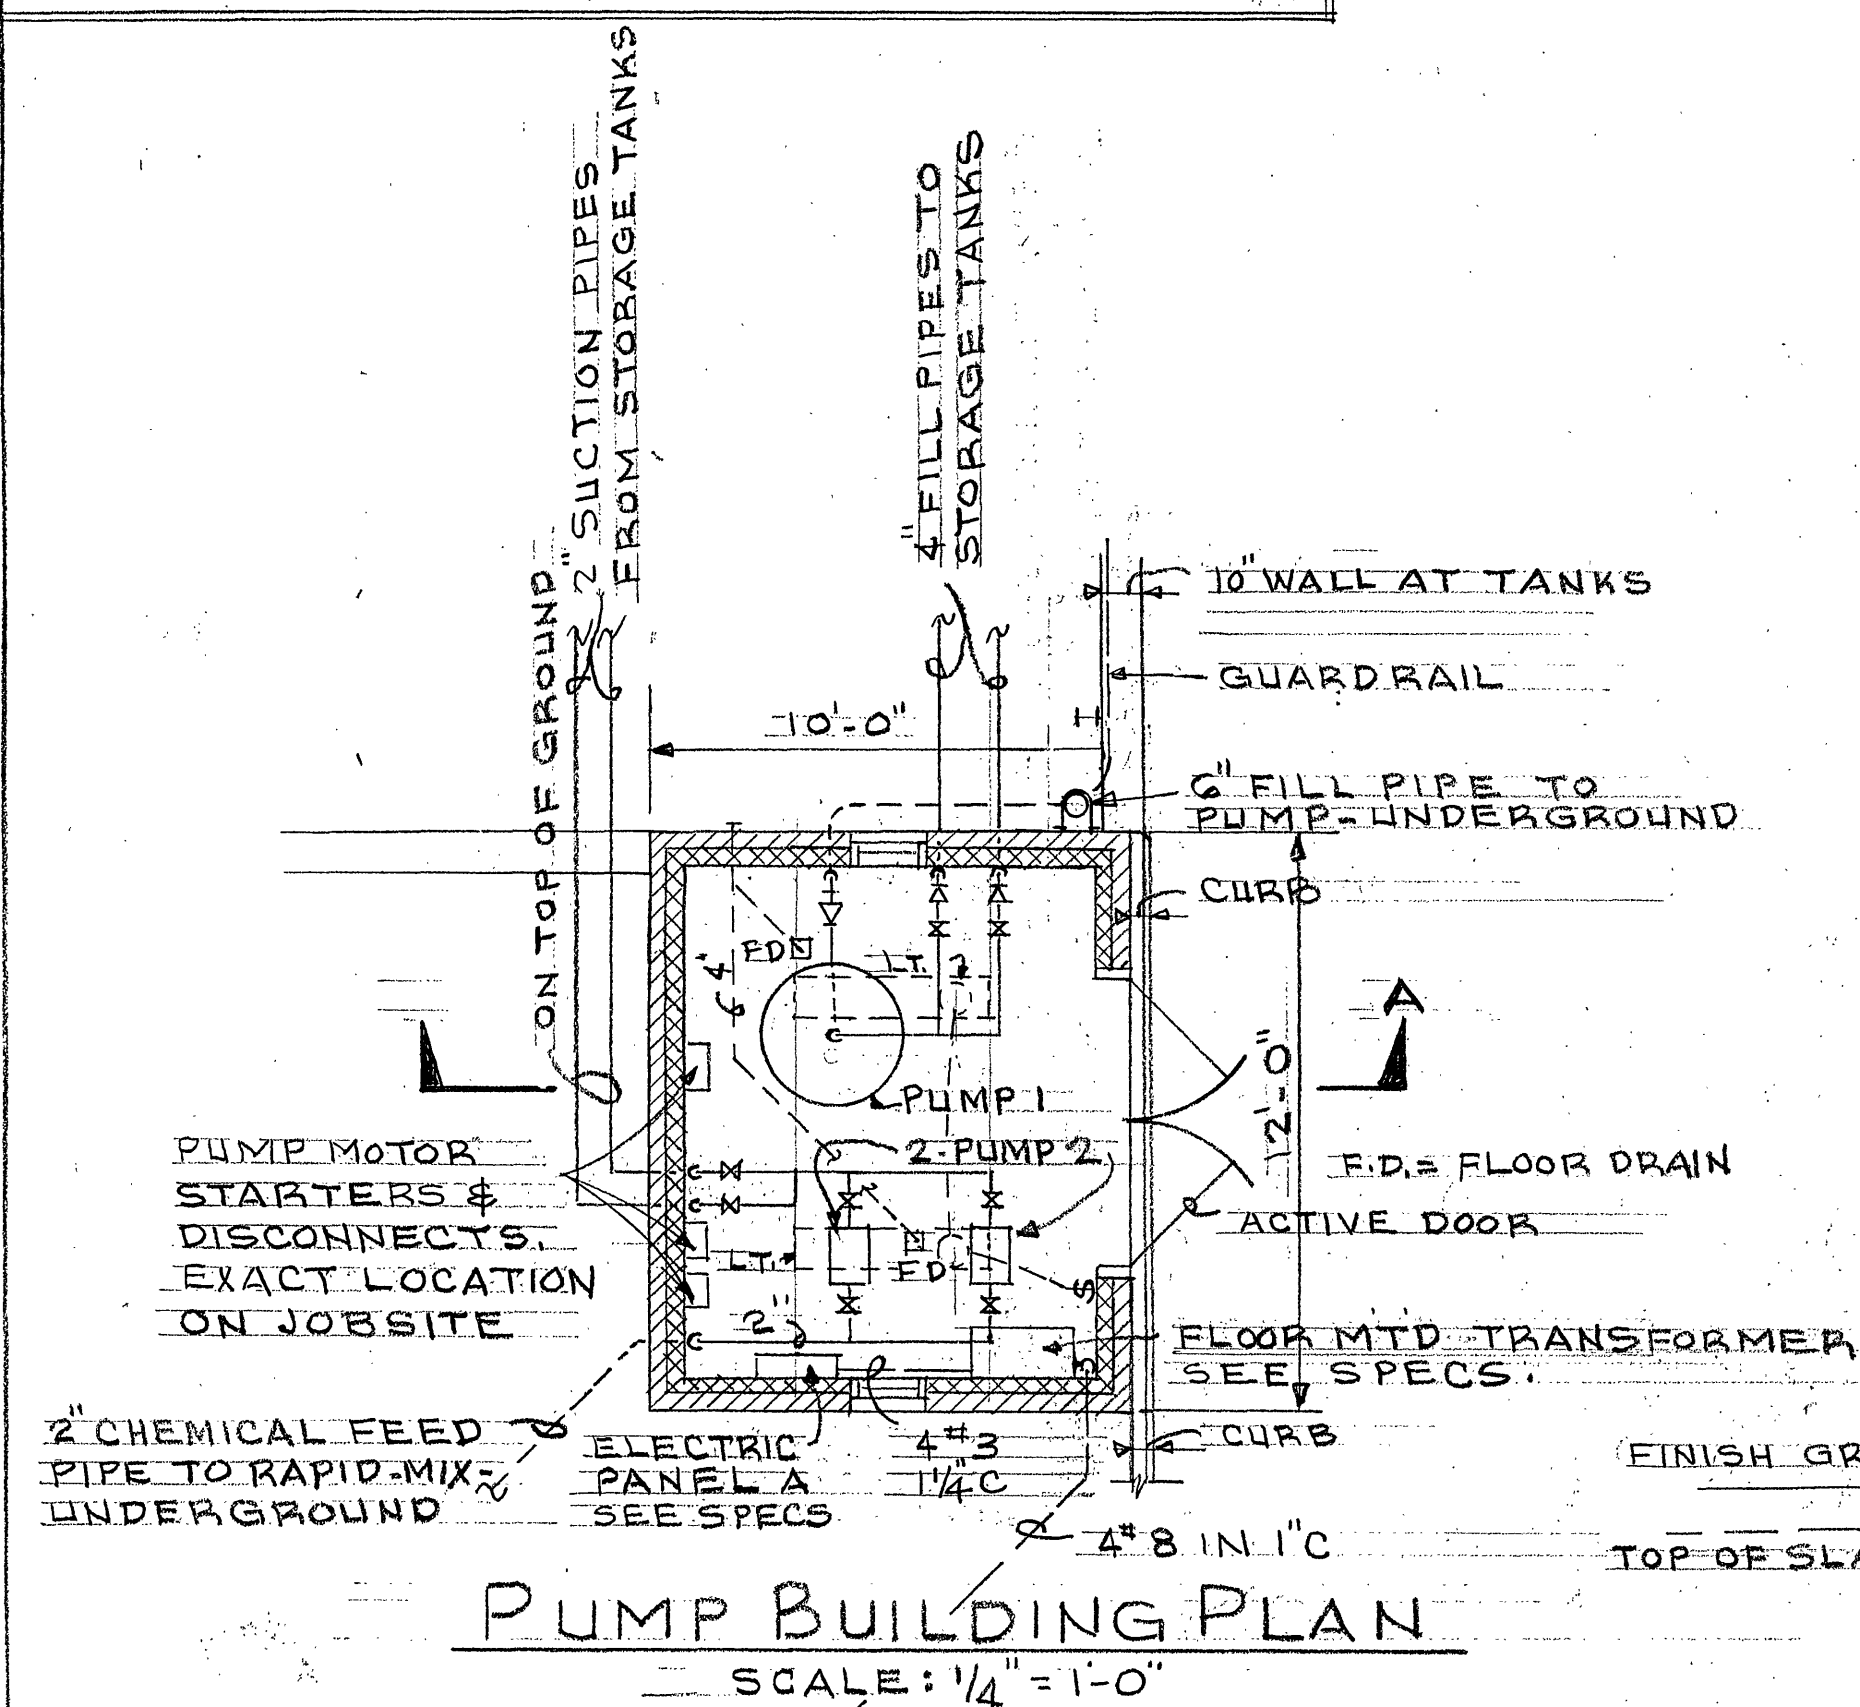

DATE	ENTRY	REVISION	BY
CHEMICAL STORAGE TANKS		CITY ENGINEER	
WATER POLLUTION CONTROL		LBC	
PLANT		CHECKED	
		APPROVED	
1402 BENNINGTON ST. SE.		DATE 11-94	
ROANOKE, VIRGINIA		11-94	
OFFICE OF CITY ENGINEER		19-94 A	
APPROVED FOR THE BOARD OF		2	
CITY ENGINEER		2	
		2	