
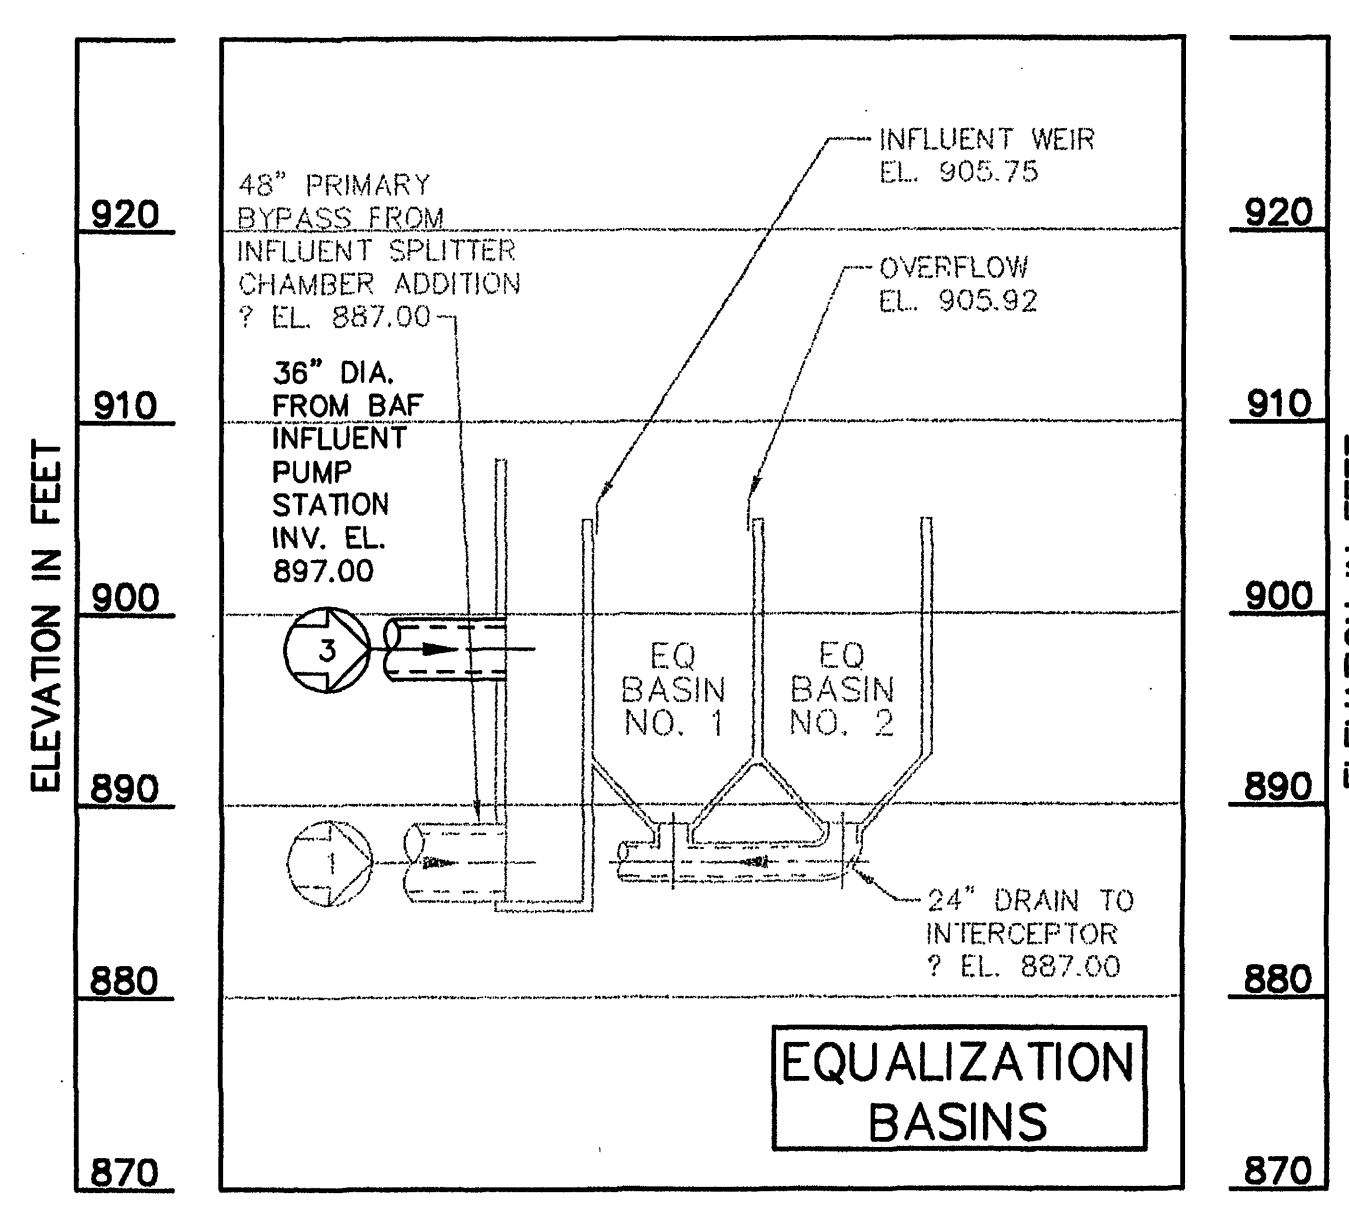
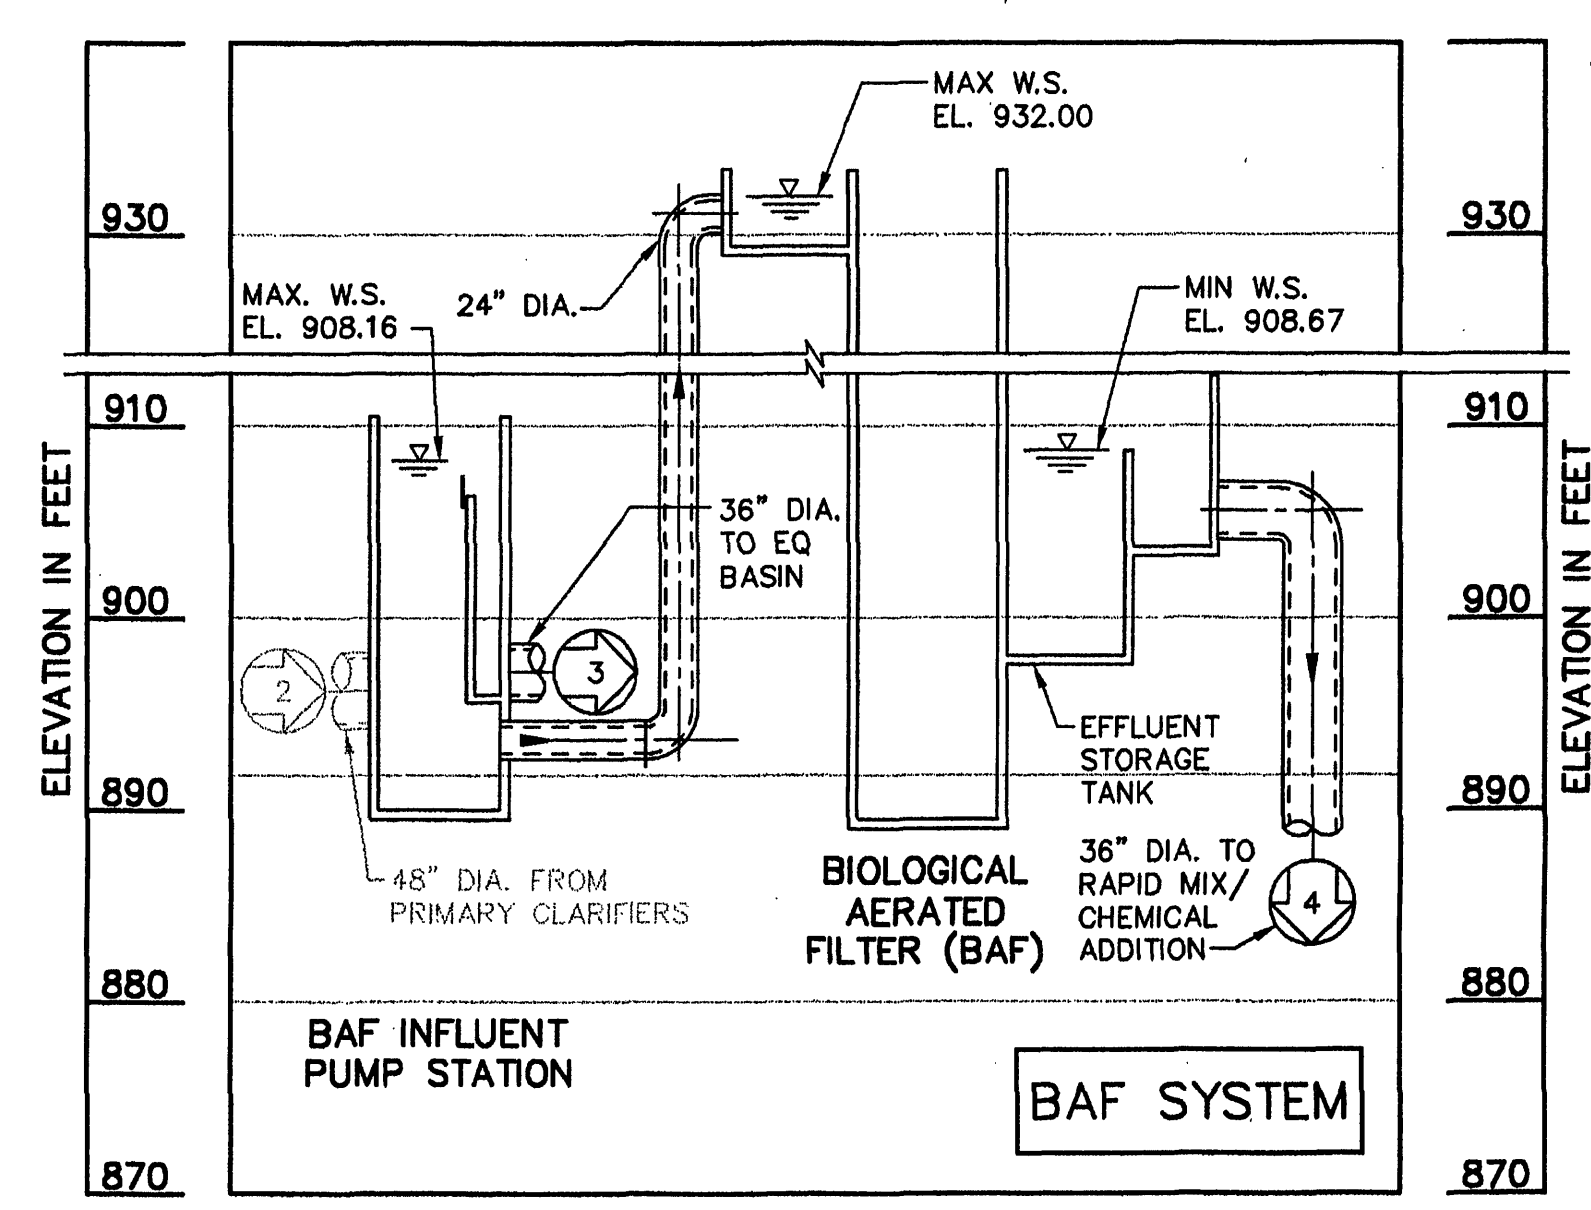
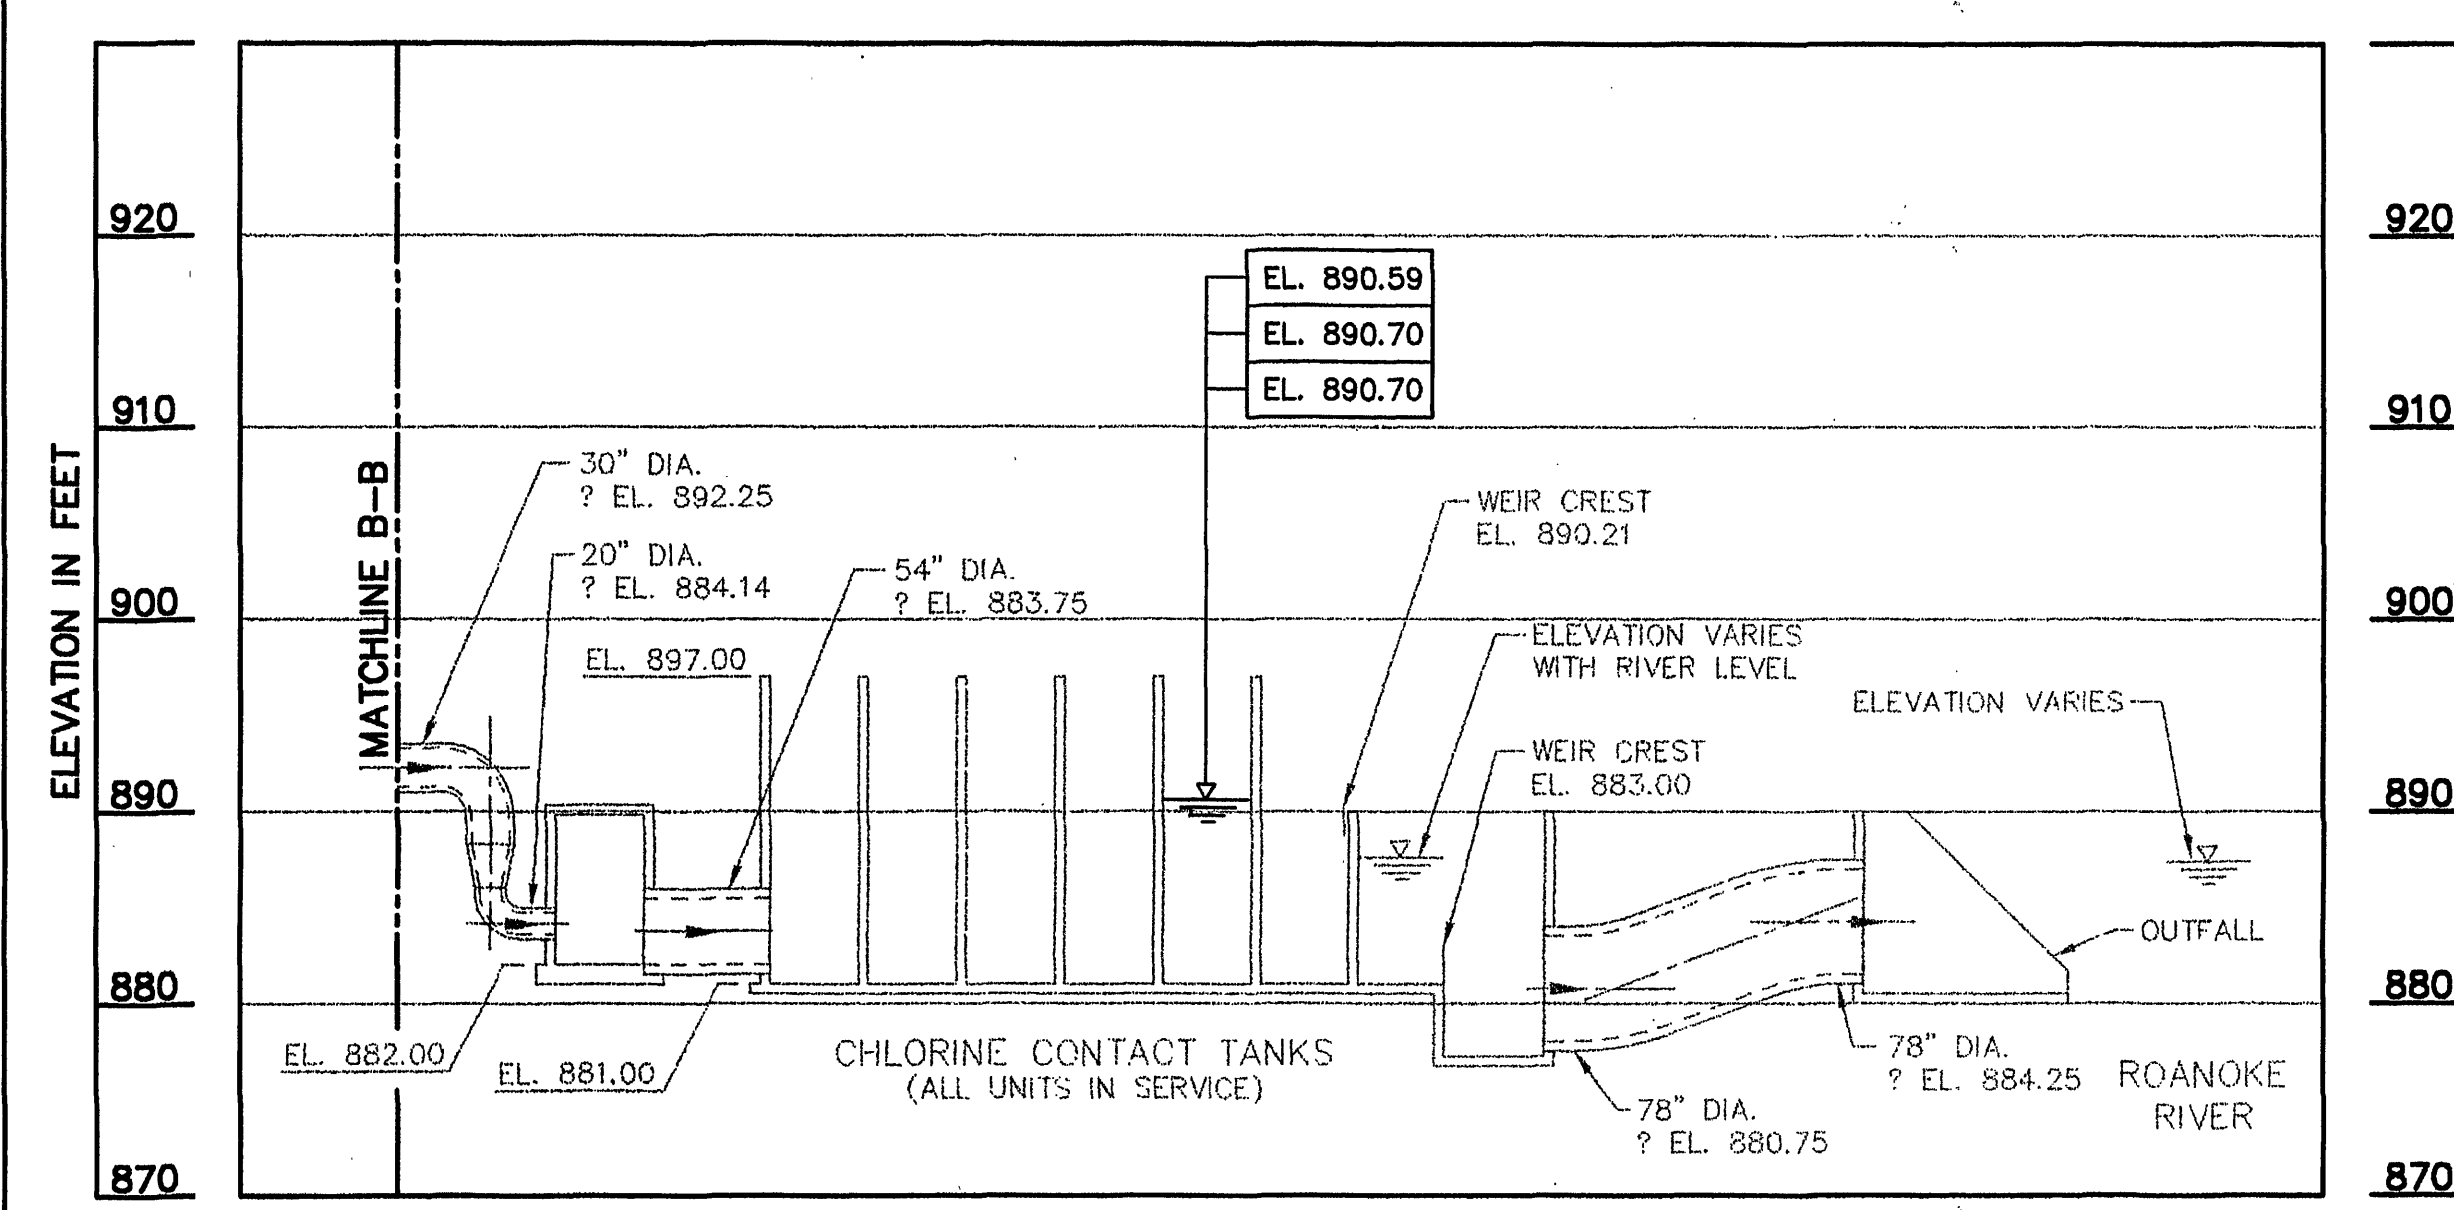
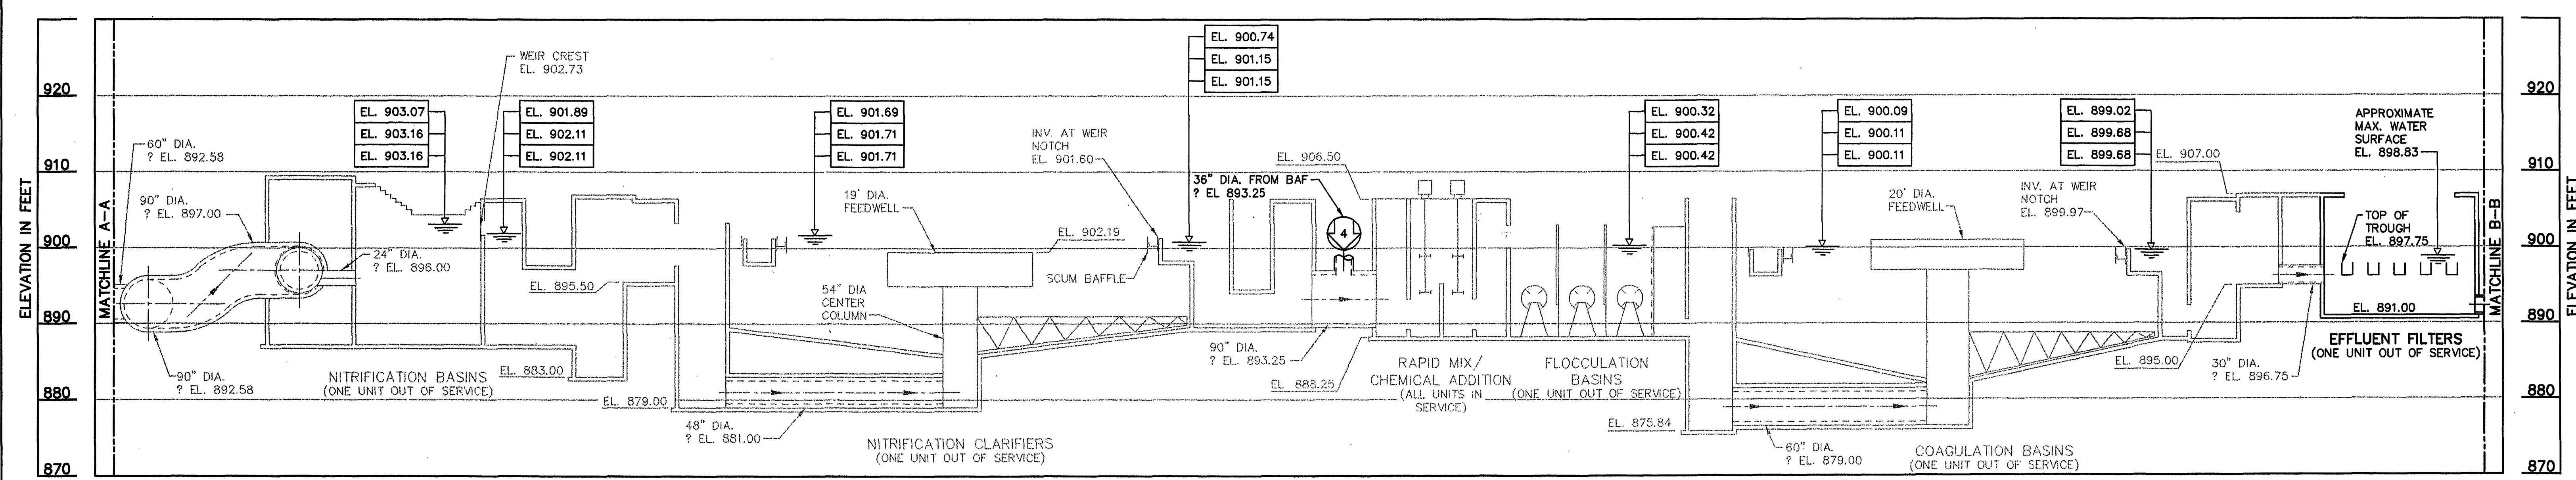


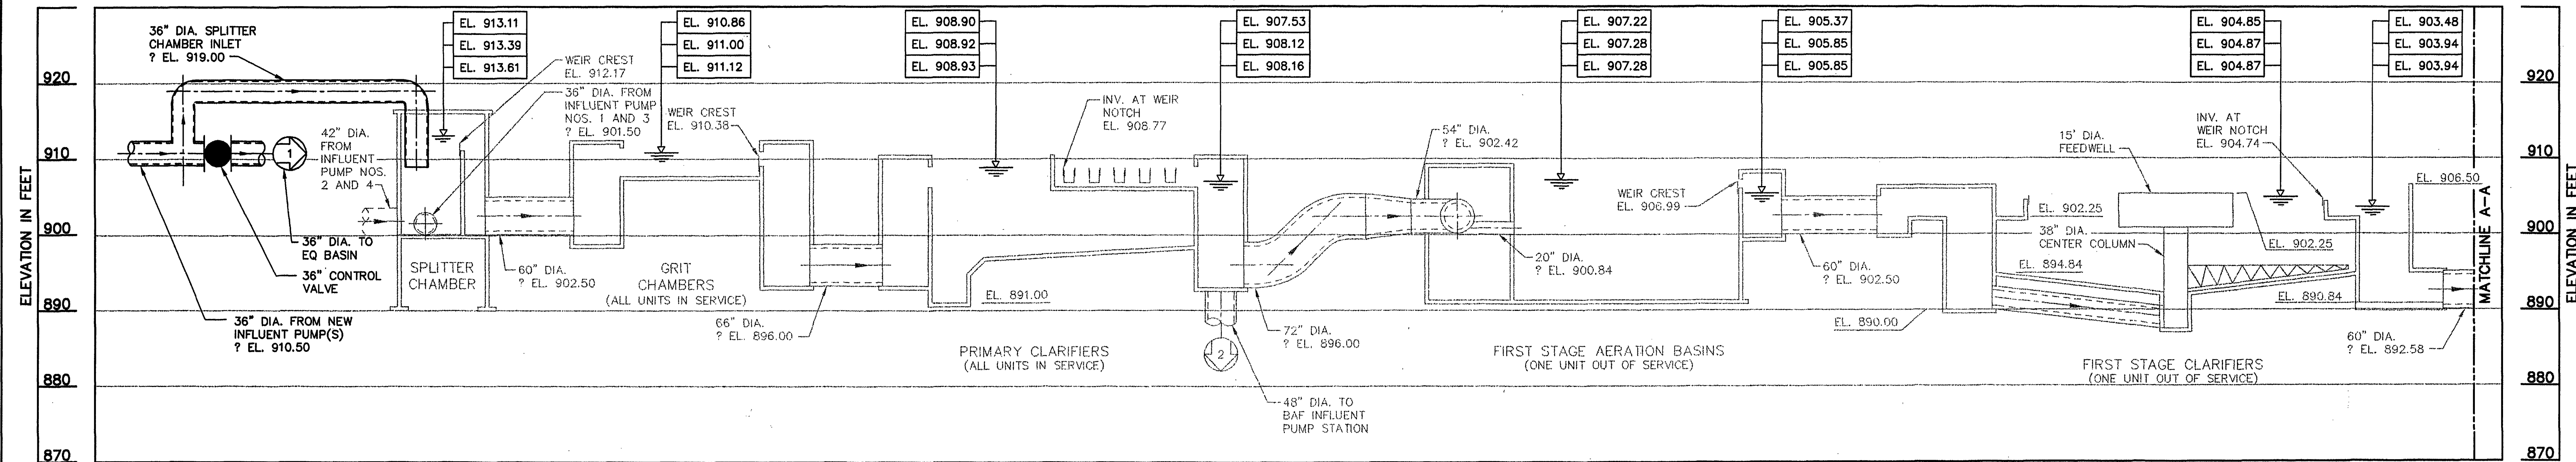

- AVERAGE FLOW (42 MGD):**
 PRIMARY SYSTEM: 42 MGD
 SECONDARY SYSTEM: 32 MGD
 BAF SYSTEM: 10 MGD
 TERTIARY SYSTEM: 42 MGD
 PRIMARY BYPASS: 0 MGD
 SECONDARY BYPASS: 0 MGD
- MAX MONTH (62 MGD):**
 PRIMARY SYSTEM: 62 MGD
 SECONDARY SYSTEM: 48 MGD
 BAF SYSTEM: 14 MGD
 TERTIARY SYSTEM: 62 MGD
 PRIMARY BYPASS: 0 MGD
 SECONDARY BYPASS: 0 MGD
- PEAK FLOW (105 MGD):**
 PRIMARY SYSTEM: 80 MGD
 SECONDARY SYSTEM: 48 MGD
 BAF SYSTEM: 14 MGD
 TERTIARY SYSTEM: 62 MGD
 PRIMARY BYPASS: 25 MGD
 SECONDARY BYPASS: 18 MGD
- LEGEND:**
 1 PRIMARY BYPASS
 2 BAF INFLUENT PUMP STATION
 3 SECONDARY BYPASS
 4 BAF EFFLUENT