



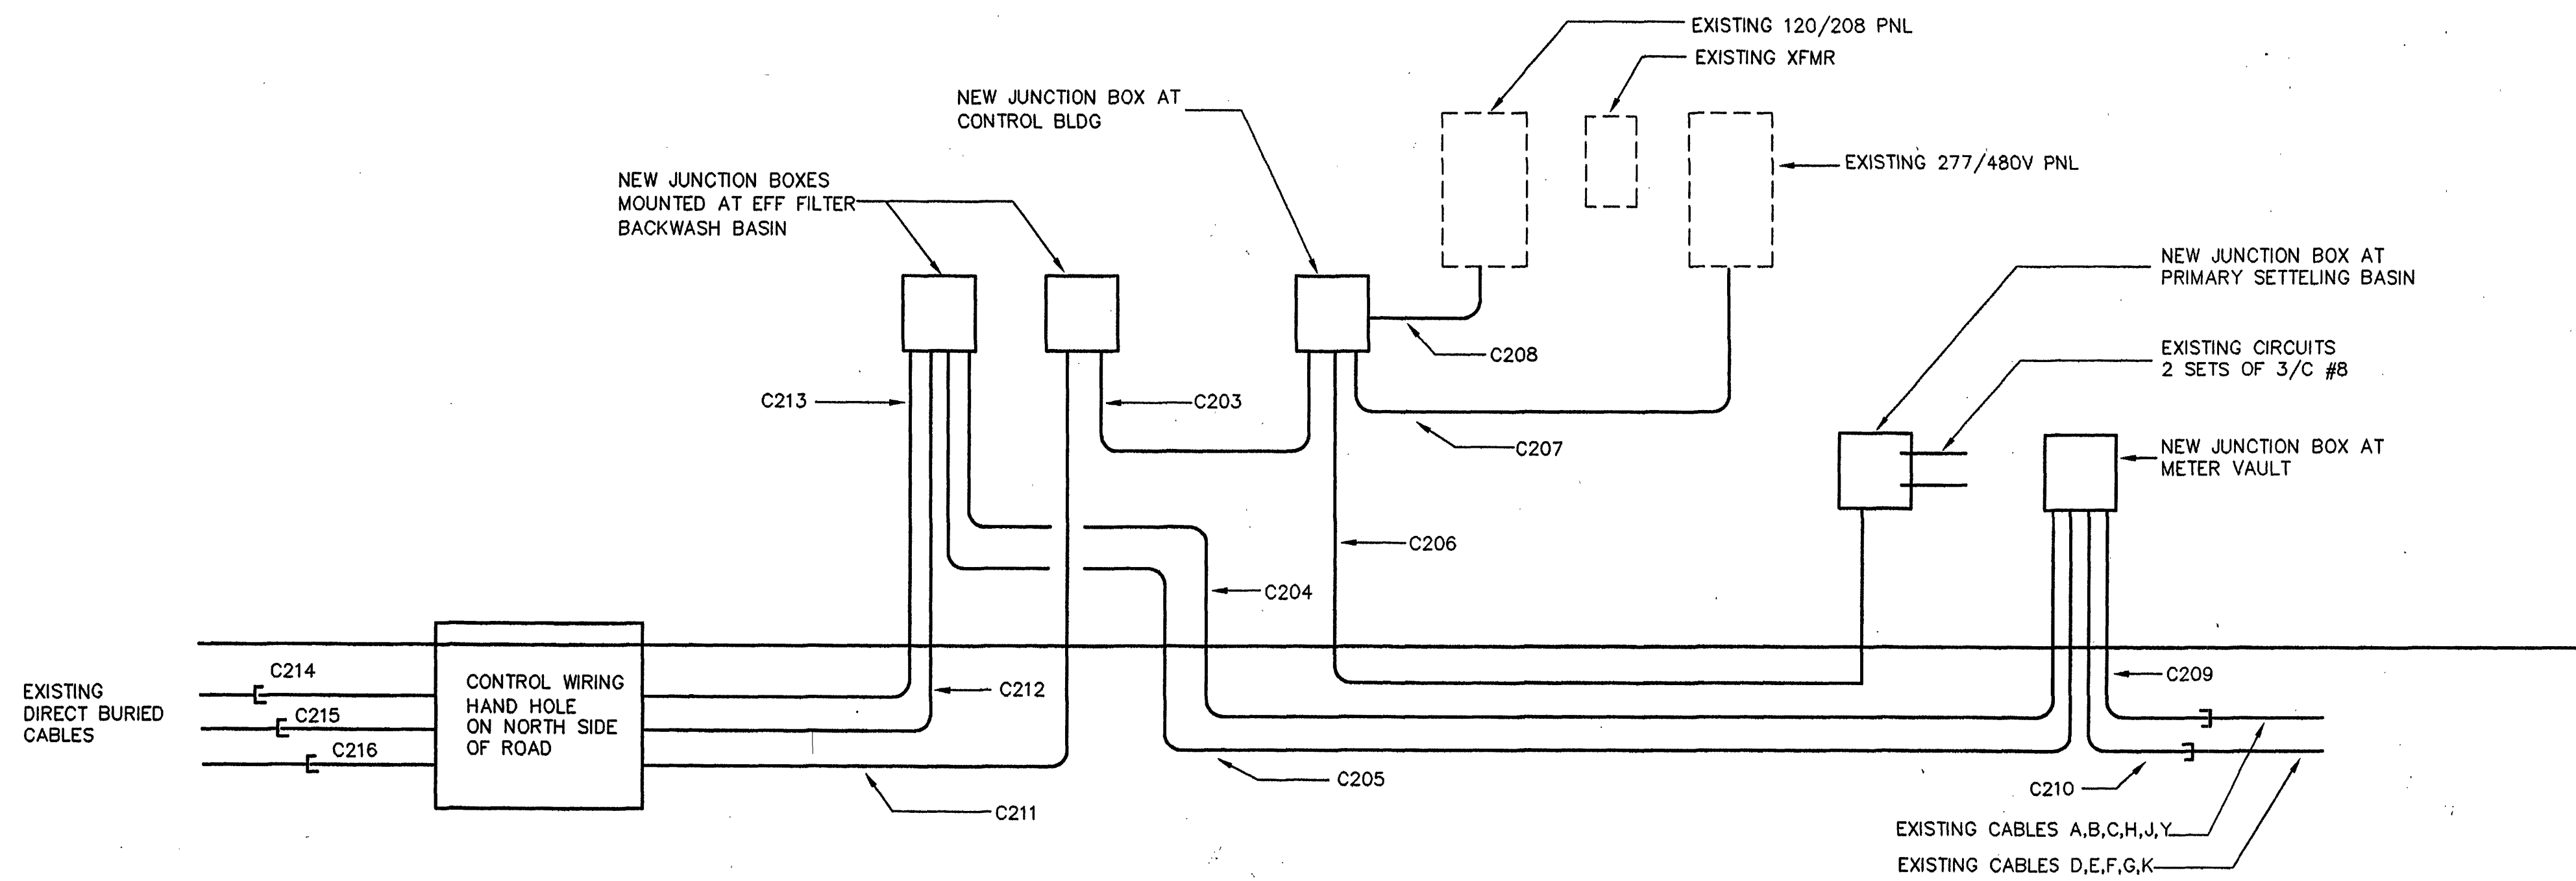

DESIGNATION	CONDUIT SIZE	CABLE TYPE	FROM	TO	REMARKS
A		1-PAIR #16 SHLD	LT-14 BASIN 1	RAW SEWAGE PUMP RM	LEVEL TRANSMITTER
B		1-PAIR #16 SHLD	LT-16 BASIN 2	RAW SEWAGE PUMP RM	LEVEL TRANSMITTER
C		1-PAIR #16 SHLD	EFFLUENT FLOW METER	RAW SEWAGE PUMP RM	FLOW TRANSMITTER
D		7/C #19/25	ALARM-CLARIFIERS	RAW SEWAGE PUMP RM	
E		7/C #19/25	FV-5 IN VALVE VAULT	RAW SEWAGE PUMP RM	VALVE OPERATOR
F		7/C #19/25	FV-6 IN VALVE VAULT	RAW SEWAGE PUMP RM	VALVE OPERATOR
G		5/C #19/25	FV-4 IN VALVE VAULT	RAW SEWAGE PUMP RM	VALVE OPERATOR
H		1-PAIR #16 SHLD	FV-4 IN VALVE VAULT	RAW SEWAGE PUMP RM	FLOW INDICATOR
J		1-PAIR #16 SHLD	FV-4 IN VALVE VAULT	RAW SEWAGE PUMP RM	FLOW TRANSMITTER
K		7/C #19/25	VALVE FV-7	RAW SEWAGE PUMP RM	VALVE OPERATOR
Y		(6) 1-PAIR #16 SHLD	FV-4 IN VALVE VAULT	RAW SEWAGE PUMP RM	
C-202	2"	EXISTING 3/C #4	J.B. IN VALVE VAULT	480V PNL AT CHLORINE BLDG	
C-203	1-1/2"	EXISTING 3/C #8	CHLORINE CONTACT BASIN	480V PNL AT CHLORINE BLDG	
C-204	3"	(3) #3 XHHW CU & (1) #8 GND (3) #8 XHHW CU & (1) #8 GND	J.B. IN VALVE VAULT		
C-205	2"	CABLE TYPES D,E,F,G,K (4) 7/C #12 STRANDED SO CABLE (1) 5/C #12 STRANDED SO CABLE			
C-206	1-1/4"	2 SETS OF (3) #8 XHHW CU & (1) #8 GND	J.B. PRIMARY SETTLING BASIN	480V PNL AT CHLORINE BLDG	
C-207	1-1/2"	(3) #3 XHHW CU & (1) #8 GND (3) #8 XHHW CU & (1) #8 GND (3) #8 XHHW CU & (1) #8 GND			
C-208	3/4"	(3) #8 XHHW CU & (1) #8 GND			
C-209	3"	EXISTING CABLES A,B,C,H,J,Y			
C-210	3"	EXISTING CABLES D,E,F,G,K			
C-211	1-1/4"	(3) #4 XHHW CU & (1) #8 GND	J.B. IN VALVE VAULT	480V PNL AT CHLORINE BLDG	
C-212	3"	CABLE TYPES D,E,F,G,K (4) 7/C #12 STRANDED SO CABLE (1) 5/C #12 STRANDED SO CABLE			
C-213	2"	CABLE TYPES A,B,C,H,J,Y (1) 1 PAIR #16 SHLD			
C-214	1-1/4"	EXISTING 3/C #4			
C-215	2"	EXISTING CABLES A,B,C,H,J,Y			
C-216	3"	EXISTING CABLES D,E,F,G,K			

UNDERGROUND CABLE RELOCATION @ BAF PUMP STATION AND ACROSS THE NORTH ROAD


NTS

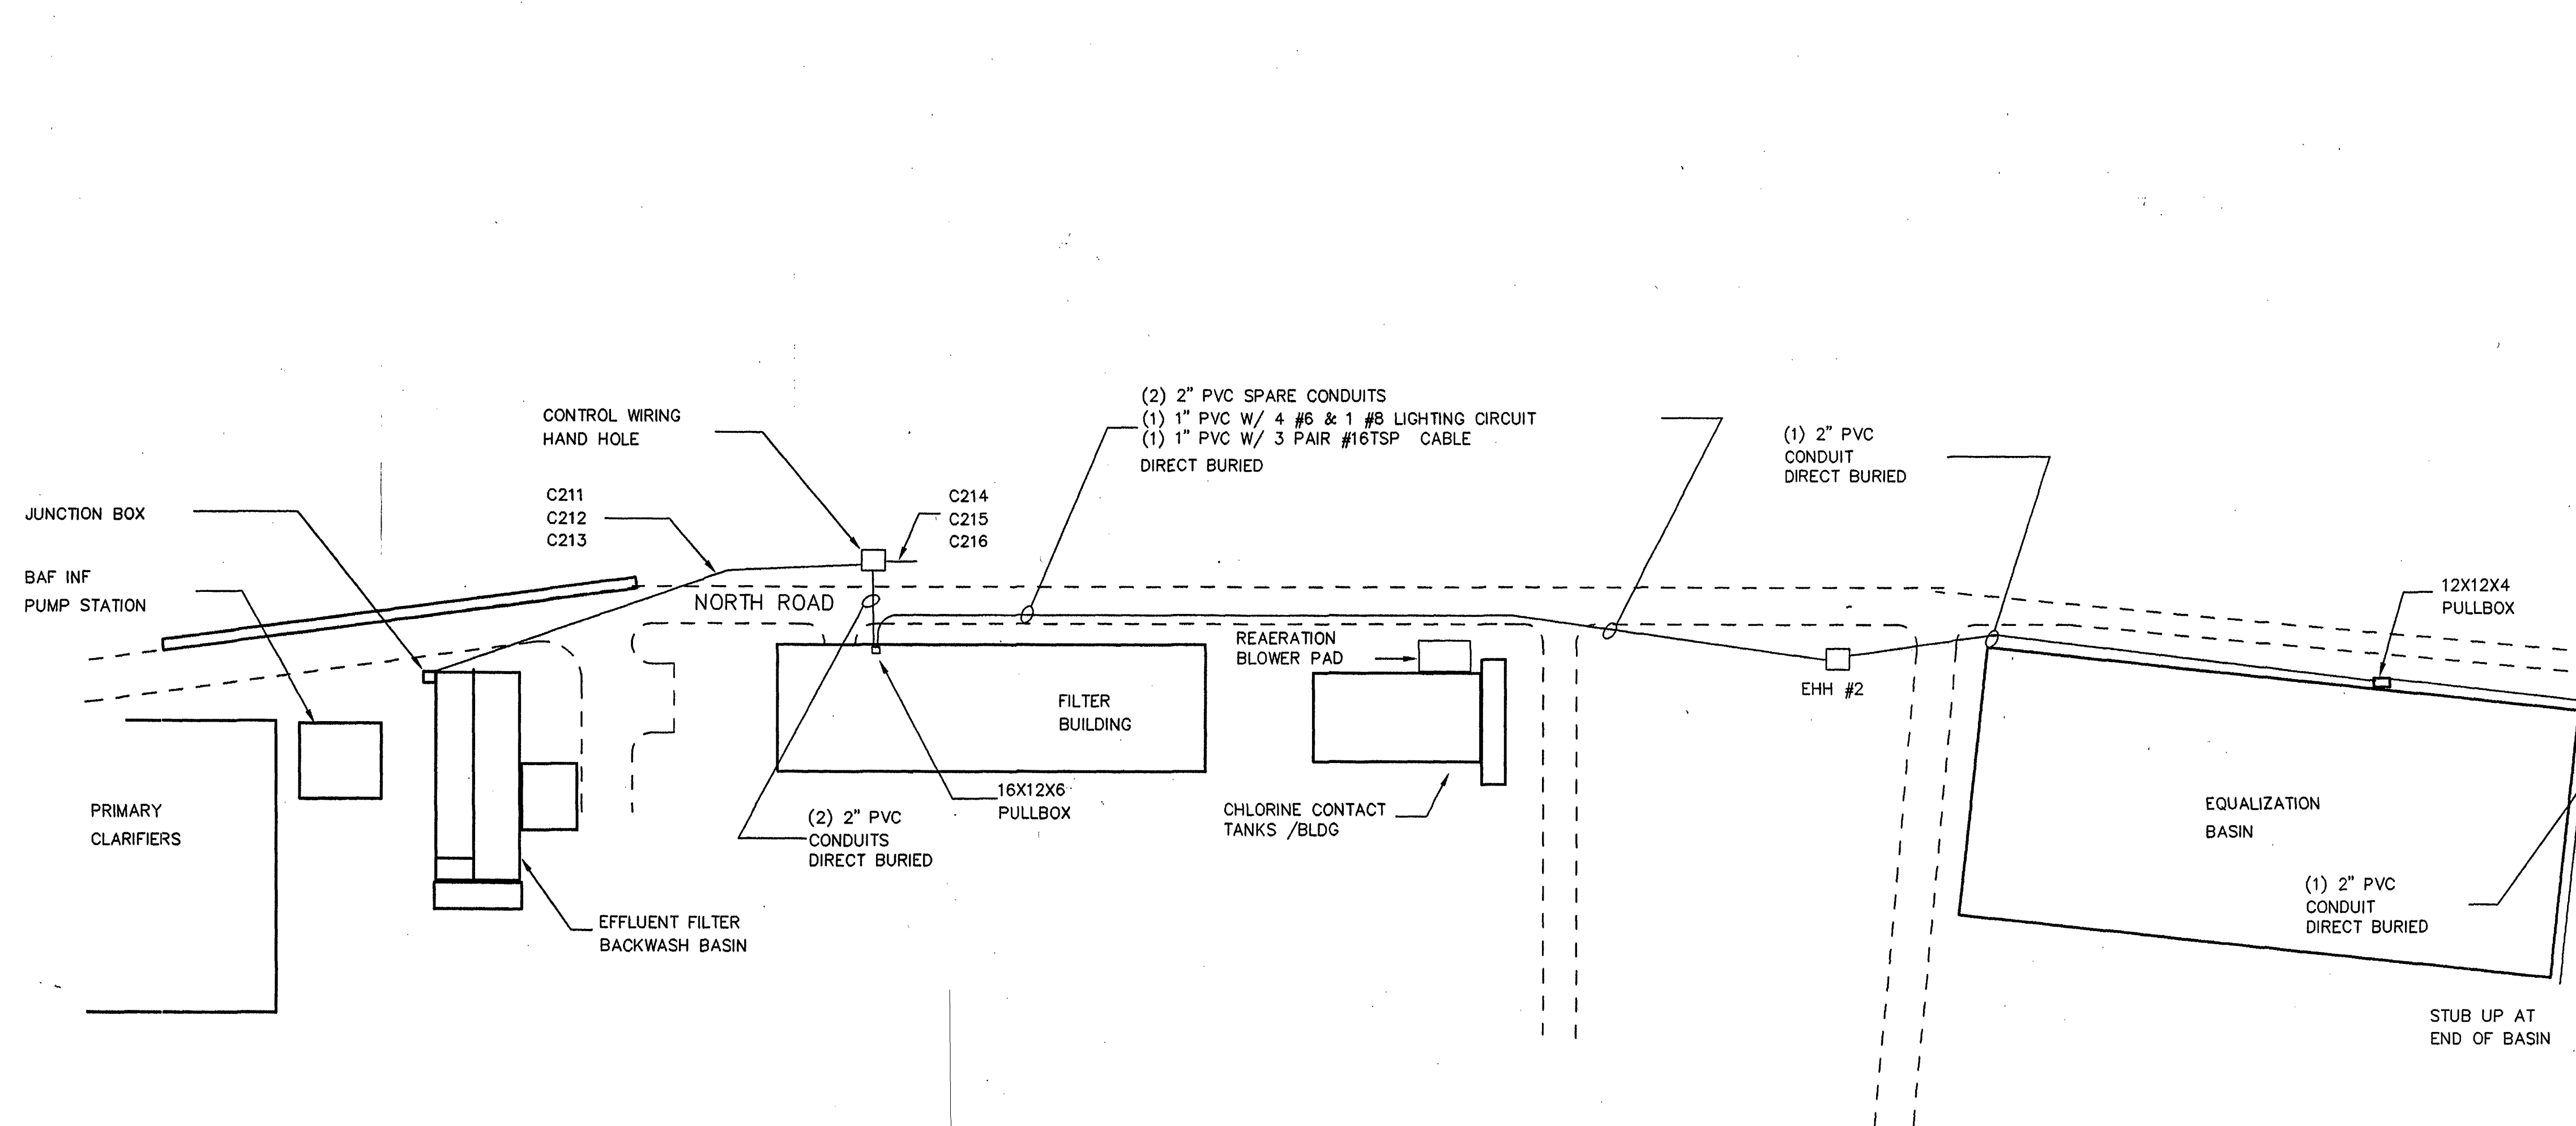

CONDUIT SYSTEM - NORTH ROAD

NTS

ERHEAD LINE
SEE NOTE #12)

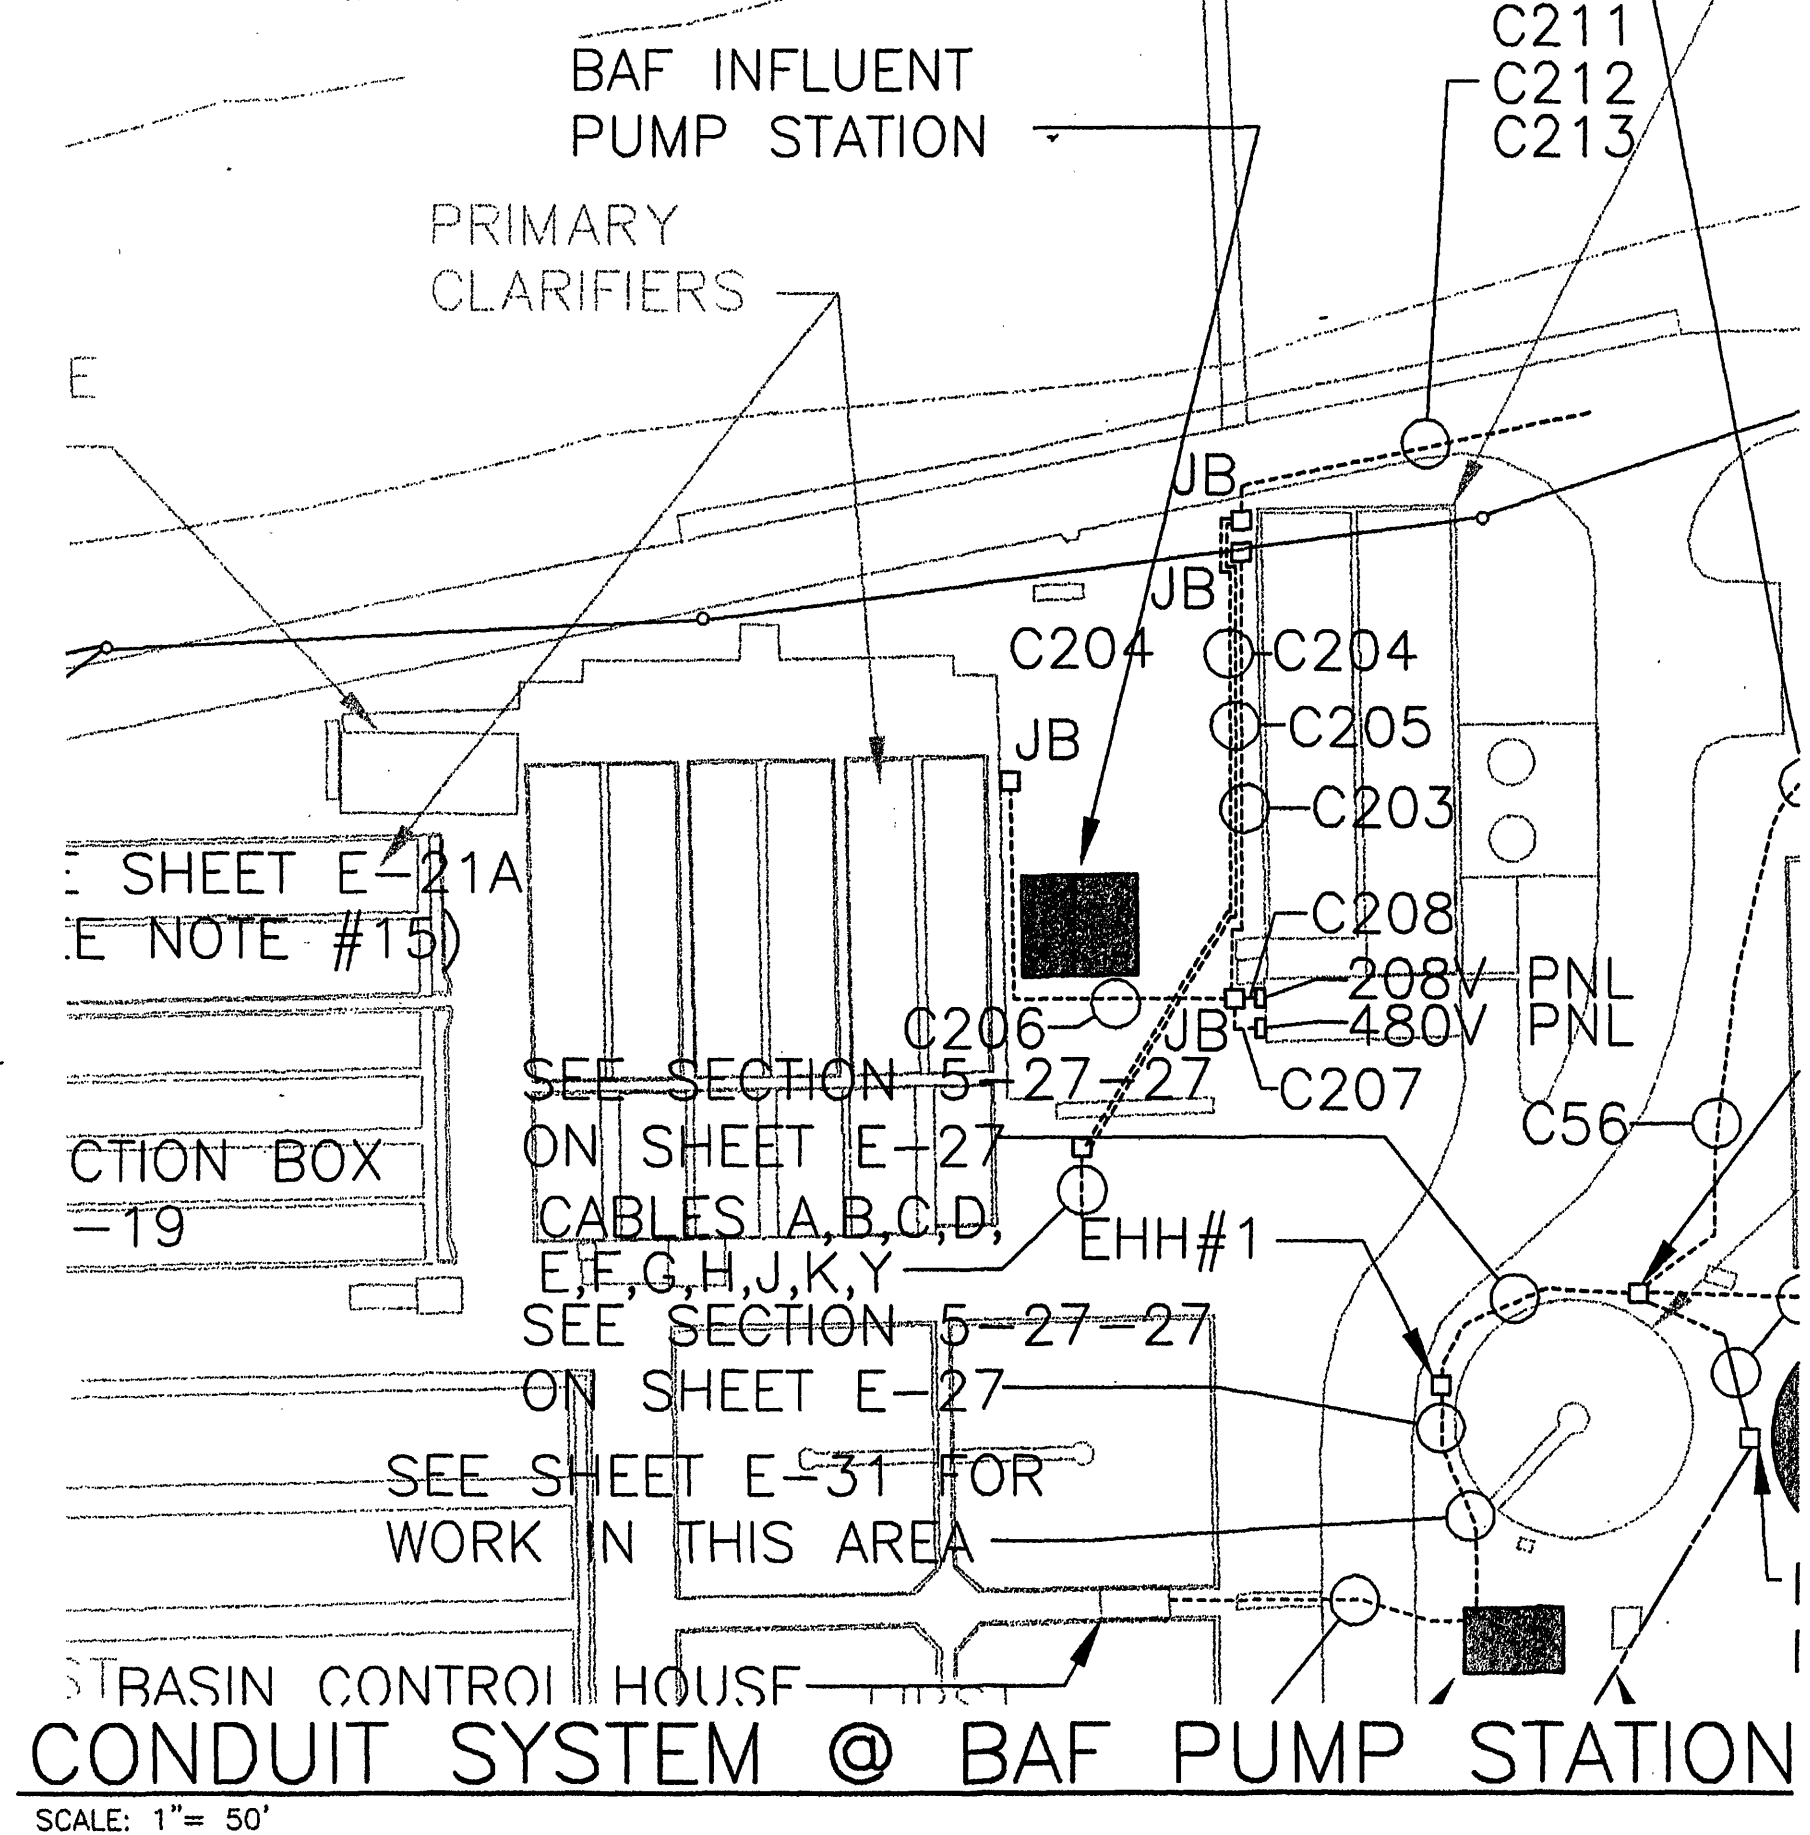

CONDUIT SYSTEM @ BAF PUMP STATION

SCALE: 1"= 50'